



WASHINGTON ELEMENTARY SCHOOL DISTRICT



WASHINGTON ELEMENTARY
SCHOOL DISTRICT

ROOFING IMPROVEMENTS PALO VERDE MIDDLE SCHOOL SFB PROJECT NO.: BRG-DSGN-00415

7502 NORTH 39th AVENUE
PHOENIX, ARIZONA 85051

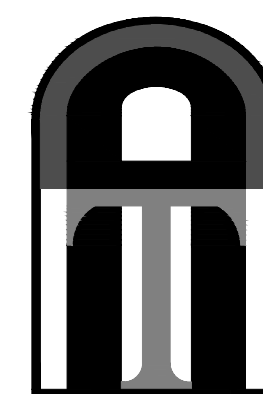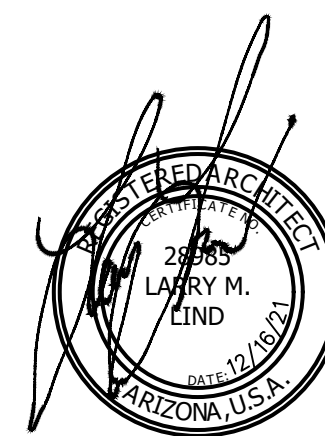

ARCHITECHNOLOGY


ARCHITECTURE - ROOF CONSULTING
5229 NORTH 7th AVENUE #101
PHOENIX, ARIZONA 85013
PHONE: 602.347.5226
FAX: 602.234.1561



ABBREVIATIONS

A.B.	ANCHOR BOLT	I.D.	INSIDE DIAMETER
ACT	ACOUSTICAL CEILING TILE	INSUL.	INSULATION
A.F.F.	ABOVE FINISHED FLOOR	INT.	INTERIOR
AGGR.	AGGREGATE		
AL.	ALUMINUM	JAN.	JANITOR
ALT.	ALTERNATE	JNT.	JOINT
APPROX.	APPROXIMATE	JST.	JOIST
ARCH.	ARCHITECTURAL		
		KIT.	KITCHEN
BD.	BOARD		
BLDG.	BUILDING	LAB.	LABORATORY
BLK.	BLOCK	LAM.	LAMINATE
BLKG	BLOCKING	LAV.	LAVATORY
BM	BEAM	LT.	LIGHT
BOT.	BOTTOM		
BTWN.	BETWEEN	MAX.	MAXIMUM
B.U.R.	BUILT UP ROOFING	MECH.	MECHANICAL
B.W.	BOTH WAYS	MEMB.	MEMBRANE
		MFR.	MANUFACTURER
C.J.	CONTROL JOINT	M.H.	MANHOLE
CLG.	CEILING	MIN.	MINIMUM
CLKG.	CAULKING	MISC.	MISCELLANEOUS
CLR.	CLEAR	M.O.	MASONRY OPENING
CMU	CONCRETE MASONRY UNIT	MTL.	METAL
COL.	COLUMN	MUL.	MULLION
CONC.	CONCRETE		
CONSTR.	CONSTRUCTION	N	NORTH
CONT.	CONTINUOUS	N.I.C.	NOT IN CONTRACT
C.T.	CARPET TILE	NO.	NUMBER
		NOM.	NOMINAL
		N.T.S.	NOT TO SCALE
DEG.	DEGREE		
DET. / DETL.	DETAIL	O.C.	ON CENTER
D.F.	DRINKING FOUNTAIN	O.D.	OUTSIDE DIAMETER
DIAG.	DIAGONAL	OH.	OVERHEAD
DIA.	DIAMETER	OPG.	OPENING
DN.	DOWN	OPP.	OPPOSITE
DS.	DOWNSPOUT		
DWG.	DRAWING	PCT.	PRE-CAST
		P.L.	PROPERTY LINE
E	EAST	PLAM.	PLASTIC LAMINATE
(E)	EXISTING	P.	PLASTER
EA.	EACH	PLYWD.	PLYWOOD
E.J.	EXPANSION JOINT	PR.	PAIR
E.I.F.S.	EXTERIOR INSULATION & FINISH SYSTEM		
EL. / ELEV.	ELEVATION	R.	RISER
ELEC.	ELECTRICAL	R.D.	ROOF DRAIN
EMER.	EMERGENCY	RE:	REFER TO
ENCL.	ENCLOSURE	REFR.	REFRIGERATOR
EQ.	EQUAL	REQ'D	REQUIRED
EQUIP.	EQUIPMENT	RM	ROOM
E.W.	EACH WAY	R.O.	ROUGH OPENING
E.W.C.	ELECTRIC WATER COOLER		
EXP.	EXPANSION	S	SOUTH
EXT.	EXTERIOR	S.C.	SOLID CORE
		SCHED.	SCHEDULE
F.A.	FIRE ALARM	SECT.	SECTION
F.D.	FLOOR DRAIN	S.F.	SQUARE FOOT
F.D.C.	FIRE DEPARTMENT CONNECTION	SHT.	SHEET
F.E.	FIRE EXTINGUISHER	SIM.	SIMILAR
F.E.C.	FIRE EXTINGUISHER CABINET	SPEC.	SPECIFICATION
F.F.	FINISH FLOOR	SQ.	SQUARE
F.H.C.	FIRE HOSE CABINET	S.S.	STAINLESS STEEL
FIN.	FINISH	STAGG.	STAGGERED
F.L.	FLOW LINE	STD.	STANDARD
FLR.	FLOOR	STIFF.	STIFFENER
FLUOR.	FLUORESCENT	STL.	STEEL
FND.	FOUNDATION	STRUC.	STRUCTURAL
F.O.B.	FACE OF BRICK	SUSP.	SUSPENDED
F.O.C.	FACE OF CONCRETE		
F.S.	FULL SIZE	TR.	READ
FT.	FOOT OR FEET	T & B	TOP AND BOTTOM
FTG.	FOOTING	TER.	TERRAZZO
FURR.	FURRING	T & G	TONGUE AND GROOVE
		THK.	THICK
		T/	TOP OF
		TYP.	TYPICAL
GA.	GAUGE	VCT	VINYL COMPOSITION TILE
GALV.	GALVANIZED	VER.	VERIFY
G.C.	GENERAL CONTRACTOR	VERT.	VERTICAL
GL.	GLASS	W	WEST
GR.	GRADE	W/	WITH
GYP.	GYPSUM	W.C.	WATER CLOSET
GYP. BD.	GYPSUM BOARD	WD.	WOOD
		W/O	WITHOUT
H.B.	HOSE BIB		
H.C.	HOLLOW CORE		
H/C	HANDICAPPED		
HDWD.	HARDWOOD		
HDWE.	HARDWARE		
H.M.	HOLLOW METAL		
HR.	HOUR		
HT.	HEIGHT		

REFERENCE SITE PLAN

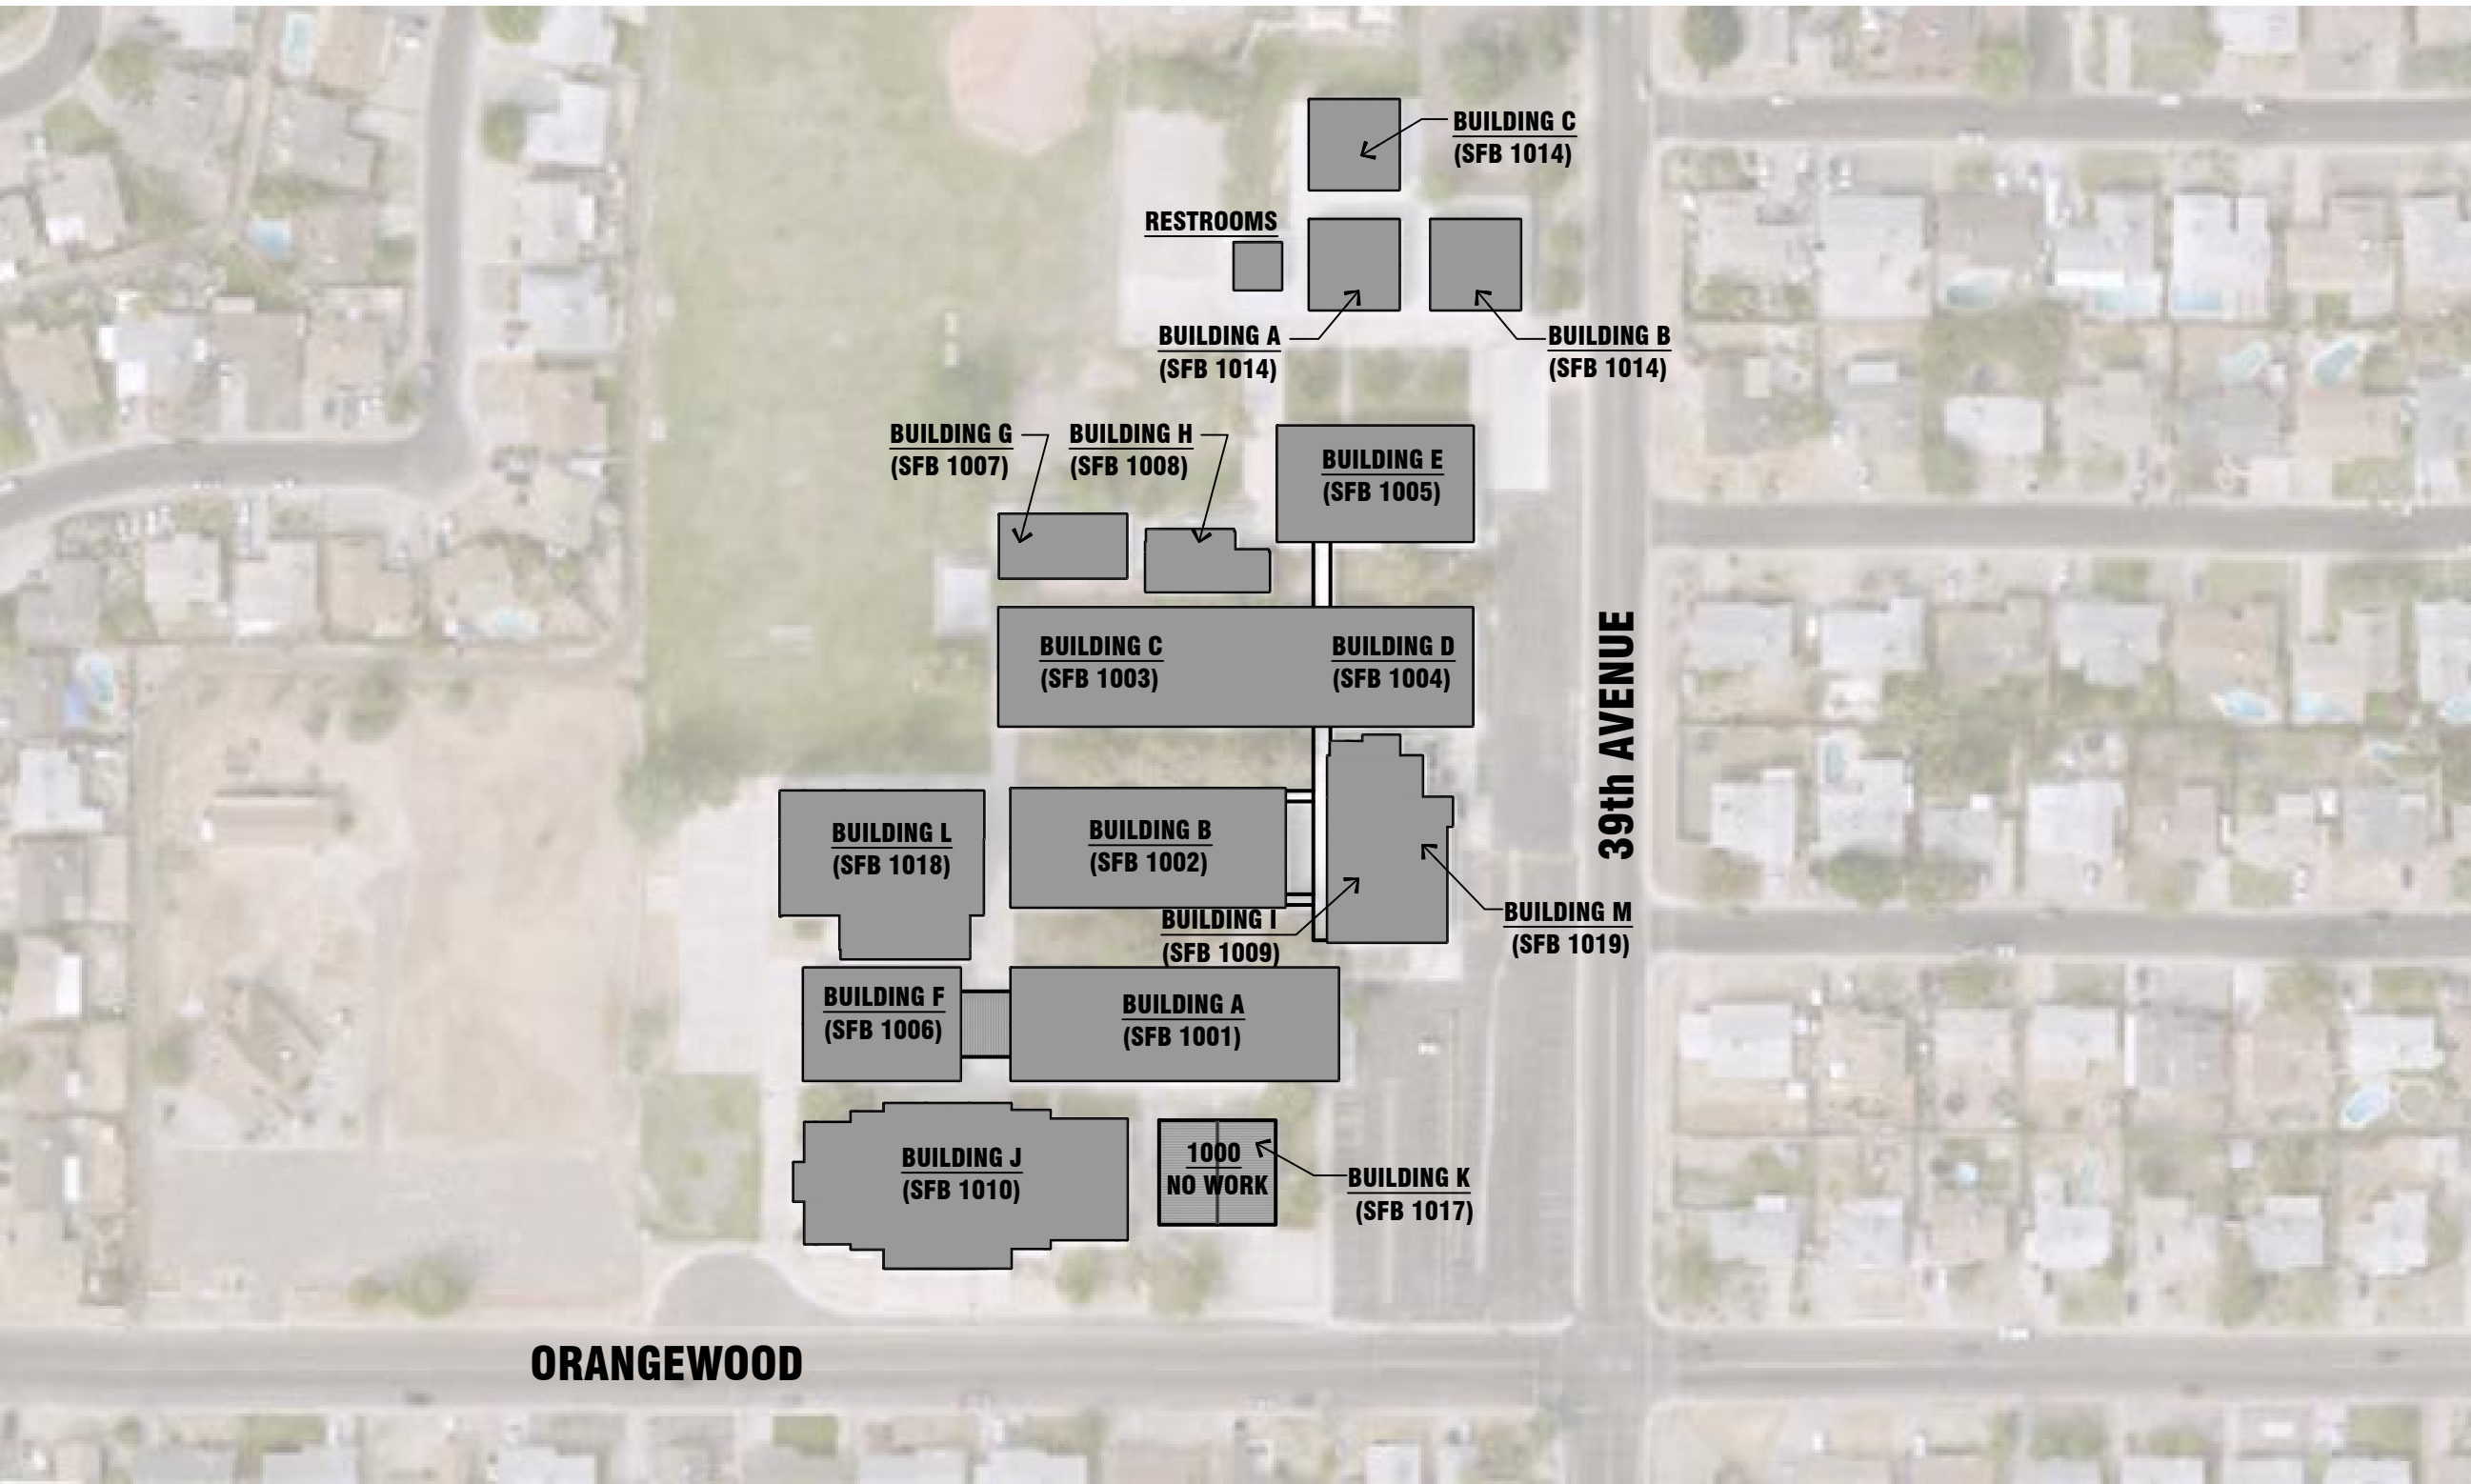

ORANGEWOOD

39TH AVENUE

NAILING SCHEDULE

DESCRIPTION OF BUILDING ELEMENTS	NUMBER AND TYPE ^{a,b,c,d}	SPACING
JOIST TO SILL OR GIRDER, TOENAIL	3-8d	
1" x 6" SUBFLOOR OR LESS TO EACH JOINT, FACE NAIL	2-8d, 2 staples 1 3/4"	
2" SUBFLOOR TO JOIST OR GIRDER, BLIND AND FACE NAIL	2-16d	
SOLE PLATE TO JOIST OR GIRDER, FACE NAIL	16d @ 16" O.C.	
TOP OR SOLE PLATE TO STUD, END NAIL	2-16d	
STUD TO SOLE PLATE, TOE NAIL	3-8d or 2-16d	
DOUBLE STUDS, FACE NAIL	10d @ 24" O.C.	
DOUBLE TOP PLATES, FACE NAIL	10d @ 24" O.C.	
SOLE PLATE TO JOIST OR BLOCKING AT BRACED WALL PANELS	3-16d @ 16" O.C.	
DOUBLE TOP PLATES, MIN. 48" OFFSET OF END JOISTS, FACE NAIL IN LAPPED AREA	8-16d	
BLOCKING BETWEEN JOISTS OR RAFTERS TO TOP PLATE, TOE NAIL	3-8d	
RIM JOIST TO TOP PLATE, TOE NAIL	8d @ 6" O.C.	
TOP PLATES, LAPS AT CORNERS AND INTERSECTIONS, FACE NAIL	2-10d	
BUILT-UP HEADER, TWO PIECES WITH 1/2" SPACER	16d @ 16" o.c. along each edge	
CONTINUED HEADER, TWO PIECES	16d @ 16" o.c. along each edge	
CEILING JOIST TO PLATE, TOE NAIL	3-8d	
CONTINUOUS HEADER TO STUD, TOE NAIL	4-8d	
CEILING JOIST, LAPS OVER PARTITIONS, FACE NAIL	3-10d	
CEILING JOIST TO PARALLEL RAFTERS, FACE NAIL	3-10d	
RAFTER TO PLATE, TOE NAIL	2-16d	
1" BRACE TO EACH STUD AND PLATE, FACE NAIL	2-8d, 2 staples 1 3/4"	
1" x 6" SHEATHING TO EACH BEARING, FACE NAIL	2-8d, 2 staples 1 3/4"	
1" x 8" SHEATHING TO EACH BEARING, FACE NAIL	2-8d, 3 staples 1 3/4"	
WIDER THAN 1" x 6" SHEATHING TO EACH BEARING, FACE NAIL	3-8d, 4 staples 1 3/4"	
BUILT-UP CORNER STUDS	16d @ 24" O.C.	
BUILT-UP GIRDERS AND BEAMS, 2" LUMBER LAYERS	10d @ 32" o.c. at top and bottom and staggered	
	2 nails at ends and at each splice	
	2-16d at each bearing	

DESCRIPTION OF BUILDING ELEMENTS	FASTENER ^{b,c,d,e,f}	EDGES ^g	INTER. SUPPORTS ^{h,i}
1/2" REGULAR CELLULOASIC FIBERBOARD SHEATHING	1 1/2" galv. roofing nail 6d common nail staple 16 ga., 1 1/2"		3 6
1/2" STRUCTURAL CELLULOASIC FIBERBOARD SHEATHING	1 1/2" galv. roofing nail 8d common nail staple 16 ga., 1 1/2"		3 6
25/32" STRUCTURAL CELLULOASIC FIBERBOARD SHEATHING	1 3/4" galv. roofing nail 8d common nail staple 16 ga., 1 3/4"		3 6
1/2" GYP SUM SHEATHING	1 1/2" galv. roofing nail, 6d common nail, staple galv., 1 1/2"; 1 1/4" screws, type w or s	4 8	
5/8" GYP SUM SHEATHING	1 3/4" galv. roofing nail, 6d common nail, staple galv., 1 5/8"; 1 5/8" screws, type w or s	4 8	

WOOD STRUCTURAL PANELS, COMBINATION SUBFLOOR UNDERLAYMENT TO FRAMING	8d deformed nail or 8d common nail	6 12
3/4" OR LESS	8d common nail or 8d deformed nail	6 12
7/8" - 1"	10d common nail or 8d deformed nail	6 12
1 1/8" - 1 1/4"		

- All nails are smooth-common, box or deformed shanks except where otherwise stated.
- Staples are 16 gage wire and have a min. 7/16" on diameter crown width.
- Nails shall be spaced at not more than 6 inches on center at all supports where spans are 48 inches or greater
- Four-foot-by-8-foot or 4-foot-by-9-foot panels shall be applied vertically.
- Spacing of fasteners not included in this table shall be based on Table R602.3(1)
- For regions having basic wind speed of 110 mph or greater, 8d deformed nails shall be used for attaching plywood and wood structural panel roof sheathing to framing within min. 48-inch distance from gable end walls, if mean roof height is more than 25 feet, up to 35 feet max.
- For regions having basic wind speed of 100 mph or less, nails for attaching wood structural panel roof sheathing to gable end wall framing shall be spaced 6 inches on center. When basic wind speeds is greater than 100 mph, nails for attaching panel roof sheathing to intermediate supports shall be spaced 6 inches on center for min. 48-inch distance from ridges, eaves and gable end walls, and 4 inches on center to gable end wall framing.
- Gypsum sheathing shall conform to ASTM C 70 and shall be installed in accordance with GA 253. Fiberboard sheathing shall conform to either AIA 194.1 or ASTM C 208.
- Spacing of fasteners on roof sheathing panel edges applies to panel edges supported by framing members and at all floor perimeters only. Spacing of fasteners on roof sheathing panel edges applies to panel edges supported by framing members and at all roof plane perimeters. Blocking of roof or floor sheathing panel edges perpendicular to the framing members shall not be required at intersection of adjacent roof planes. Floor and roof perimeter shall be supported by framing members or solid blocking.

ROOFING GENERAL NOTES

- ALL NEW ROOF PENETRATIONS TO BE FULLY WATER TIGHT. REPAIR EXISTING METAL FLASHING/FASCIA AS REQUIRED. REFER TO DETAILS.
- ROOF AREA NUMBERS ARE SHOWN FOR ROOF AREA LOCATION COMMUNICATION PURPOSES ONLY.
- ALL MECHANICAL UNITS, EXHAUST FANS, MECHANICAL EQUIPMENT, ETC. MOUNTED ON ROOF SHALL BE PROVIDED WITH CRICKETING AS REQUIRED TO PROVIDE POSITIVE ROOF DRAINAGE, TYPICAL.
- VERIFY ALL ROOF DECK CONDITIONS PRIOR TO ANY ROOFING ACTIVITIES.
- COORDINATE ALL MECHANICAL ROOF MOUNTED EQUIPMENT FOR PROPER CURB REQUIREMENTS AND PENETRATION OPENINGS SO THAT PROPER FLASHING MAY BE INSTALLED AS TO CONFORM WITH THE MANUFACTURER'S STANDARD DETAILS / INSTALLATION REQUIREMENTS.
- NOT ALL PENETRATIONS MAY BE INDICATED. CONTRACTOR TO FIELD VERIFY. FOR TYPICAL VENT AND PIPE PENETRATIONS THROUGH ROOF MEMBRANE, SEE TYPICAL DETAILS
- ALL SHEET METAL FABRICATIONS TO COMPLY WITH THE LATEST SMACNA ARCHITECTURAL SHEET METAL MANUAL - TYPICAL.
- REMOVE ALL EXISTING PARAPET WALL REGLETS (U.N.O.) EXISTING PARAPET WALL COUNTER FLASHING AT REGLET TO BE REMOVED FOR INSTALLATION OF NEW ROOF MEMBRANE. INSTALL NEW COUNTER FLASHING AS REQUIRED TO CONFORM WITH MANUFACTURES ROOF WARRANTY. PAINT ALL REGLETS AND COUNTER FLASHING COLOR TO MATCH ADJACENT PARAPET WALLS.
- MECHANICAL UNITS, EQUIPMENT, VENTS, ETC. SHOWN ARE DIAGRAMMATIC. THEY ARE NOT TO SCALE AND THE LOCATIONS ARE APPROXIMATE. NOT ALL ROOFING PENETRATIONS HAVE BEEN SHOWN. CONTRACTOR TO FIELD VERIFY QUANTITIES, SIZES, AND LOCATIONS OF MECHANICAL AND ELECTRICAL PENETRATIONS PRIOR TO BIDDING. NO ADDITIONAL COMPENSATION WILL BE ALLOWED FOR ADDITIONAL ROOFING PENETRATIONS NOT INDICATED ON DRAWINGS.

CONTRACTOR IS RESPONSIBLE TO VISIT SITE TO ASCERTAIN THE FULL EXTENT OF THE WORK REQUIRED. NO ADDITIONAL COMPENSATION WILL BE ALLOWED FOR FAILURE TO ASCERTAIN FULL EXTENT OF THE WORK REQUIRED THROUGH VISUAL INSPECTION OF EXISTING CONDITIONS AND THAT DETAILED AND SPECIFIED WITHIN THE CONTRACT DOCUMENTS.

ROOF SLOPED INDICATED ARE APPROXIMATE. CONTRACTOR TO VERIFY IF SLOPE IS PROVIDED IN THE STRUCTURE OF BUILDING OR IF TAPERED INSULATION WILL BE REQUIRED TO PROVIDE SLOPE

CONTRACTOR TO PROVIDE WARRANTED WATER TIGHT ROOF CONSTRUCTION AND FLASHING AT ALL NEW ROOFING INSTALLATIONS EXCEPT AT EXISTING ROOFING TO REMAIN. CONTRACTOR TO VISUALLY INSPECT ALL METAL COPING TO REMAIN FOR POTENTIAL SOURCES OF LEAKS AND PROVIDE REPORT TO ARCHITECT FOR REVIEW.

CONTRACTOR IS RESPONSIBLE FOR INSPECTING INTERIOR ROOF LEADERS TO ENSURE THAT THEY ARE NOT LEAKING. IF LEAKS ARE DISCOVERED, THE CONTRACTOR SHALL NOTIFY THE OWNER AND THE ARCHITECT.

GENERAL STRUCTURAL NOTES

- CODE:
- INTERNATIONAL BUILDING CODE, IBC 2018 ED.
- LOADS:
- ROOF DEAD LOAD - 15 PSF .
ROOF LIVE LOAD - 20 PSF .
WIND DESIGN CRITERIA - PER CHAPTER 16, SECTION 1609,
BASIC WIND SPEED 90 MPH, EXPOSURE C.
- STRUCTURAL STEEL:
- All structural steel construction to conform to AISC Manual of Steel Construction. Steel materials to be as follows:
- Beams-----ASTM A992, Fy=50 ksi
Angles, channels, & plates-----ASTM A36, Fy=36 ksi
Pipe Columns-----ASTM A501, Fy=35 ksi
Steel to steel bolts-----ASTM A-325
Anchor bolts-----ASTM A307
Anchor bolt nuts-----ASTM A563
- All welding to be performed by welders holding valid certificates and having current experience in type of weld shown on the drawings or notes. Certificates shall be those issued by and accepted testing agency. All welding by E70 Series low hydrogen rods. Welding per American Welding Society Standards.
- WOOD AND CARPENTRY
- All lumber shall bear the stamp of a recognized lumber grading agency.
Erect all wood framing in a workmanlike manner. Materials shall be as follows:
- Vertical framing Douglas Fir No.2
Horizontal FramingDouglas Fir No.1
Ledgers--Douglas Fir No.2
Wood Deck Sheathing board to comply and conform to PS 1. Nail deck per drawings and details.
Rough hardwareRough hardware Simpson
All nails to be common nails, sizes as indicated on nailing schedule and on drawings.
- Submit complete calculations and shop drawings for all wood truss members. Shop drawings to include placement drawings, erection drawings, and final and temporary bracing.
- GENERAL:
- The contract drawings and specifications represent the finished structure. They do not indicate the method of construction. The contractor shall provide all measures necessary to protect the structure and any surrounding structures during construction. Such measures shall include, but not be limited to, bracing, shoring for loads due to construction equipment, and etc. Observation visits to the site by the Architect shall not include inspection of the above items.
- Construction materials shall be spread out if placed on framed floor or roofs. Load shall not exceed the design live load per square foot.
- SHOP DRAWINGS:
- The following is the minimum shop drawings and submittal that are required for this project. Refer to project specifications for additional requirements and procedures. This list is included in these notes as an aid to the contractor in preparing his submittal. This is not intended to be a complete list of drawings and submittal that the contractor will require to do his work. This list specifically excludes architectural items except where they may have a structural impact. Refer to the specifications for additional shop drawing and submittal requirements and procedures. Incomplete or incorrect submittal will be rejected.
- IT IS NOTED THAT THIS PROJECT CONSISTS OF REPAIR AND REPLACEMENT OF COMPONENTS IN AN EXISTING BUILDING. THE CONTRACTOR IS TO EXERCISE CARE NOT TO DAMAGE OTHER PORTIONS OF THE STRUCTURE DURING THESE REPAIRS. PROVIDE ALL NECESSARY SHORING, BARRICADES AND OTHER SAFETY MEASURES AS REQUIRED BY LOCAL, STATE AND FEDERAL AGENCIES FOR THIS TYPE OF CONSTRUCTION.
- SUPPLEMENTARY STRUCTURAL NOTES
- 1.01 SPECIAL CONSIDERATION FOR RENOVATION PROJECTS
- A. In undertaking work of a rehabilitation or stabilization nature, it is inevitable that there will be conditions unknown to all parties involved. Therefore, certain items of the work may not be fully delineated or specified.
- B. The contractor shall preserve conditions of the original work, to the extent possible, with the exception of changes from original conditions explicitly indicated or specified.
- C. Contractor to exercise care that damage to existing building is minimized during the repair process and construction.
- 1.02 WORKMANSHIP
- A. Where not more specifically described in any of the various notes of these drawings, workmanship shall conform to all of the methods and operations of best standards and accepted practices of the trade or trades involved, and shall include all items of fabrication, construction or installation regularly furnished or required for completion, including any finish, and for successful operation as intended.
- B. All work shall be executed by mechanics skilled in their respective lines of work.
- C. When completed, all parts shall have been durably and substantially built and shall present a neat, workmanlike appearance.
- 1.03 SAFETY
- A. Comply with all applicable provisions of Federal, State, and Local laws pertaining to safety.
- 1.04 DRAWINGS AND SPECIFICATIONS
- A. No responsibility will be assumed by the Owner or Engineer for omissions or duplications by the Contractor in the completion of the Contract due to any alleged error in the arrangement of the material in these Specifications or in the Drawings, nor shall any such segregation of work and materials operate to make the Engineer an arbiter in defining limits to the agreements between the Contractor and his Subcontractors and Suppliers.
- B. General Conditions, Supplementary General Conditions, Drawings, Specifications, and other contract Documents are complementary. Nothing within the individual Sections of these Specifications shall be considered to waive any requirements of the other Contract Documents.
- C. The misplacement, addition, or omission of any letter, word, or punctuation mark, or lack of capitalization of a word, shall in no way damage the true spirit, intent, or meaning of these Specifications.
- D. The words "shown," "indicated," "noted," "scheduled," or words of like effect shall be understood to mean that reference is made to the drawings accompanying these Specifications.
- E. Standards: Reference to known standards within these Specifications shall mean and intend the latest edition or amendment published prior to the date of these Specifications, unless specifically stated otherwise, and to such portions of it that relate and apply directly to the material or installation called for on the project.

PROJECT INFORMATION

PROJECT NAME:	ROOFING IMPROVEMENTS
OWNER:	WASHINGTON ELEMENTARY SCHOOL DISTRICT 4650 WEST SWEETWATER AVENUE PHOENIX, ARIZONA 85304
PROJECT SITE:	PALO VERDE MIDDLE SCHOOL 7502 S 39th AVENUE PHOENIX, ARIZONA 85051
ARCHITECT:	ARCHITECHNOLOGY INC. LARRY M. LIND, A.I.A. PRINCIPAL ARCHITECT / ROOF CONSULTANT 5229 N. 7TH AVE. STE 101 PHOENIX, ARIZONA 85013 P (602) 347-5226 F (602) 234-1561

WASHINGTON ELEMENTARY SCHOOL DISTRICT

GOVERNING BOARD:	PRESIDENT - TEE LAMBERT
	VICE PRESIDENT - NIKKIE WHALEY
	BOARD MEMBER - JENNI ABBOTT-BAYARDI
	BOARD MEMBER - BILL ADAMS
	BOARD MEMBER - LINDSEY PETERSON
SUPERINTENDENT:	DR. PAUL STANTON

APPLICABLE CODES

CITY OF PHOENIX

2018 INTERNATIONAL BUILDING CODE
2018 INTERNATIONAL RESIDENTIAL CODE
2018 INTERNATIONAL MECHANICAL CODE
2018 INTERNATIONAL PLUMBING CODE
2018 INTERNATIONAL FUEL GAS CODE
2018 INTERNATIONAL ENERGY CONSERVATION CODE
2018 INTERNATIONAL EXISTING BUILDING CODE
2018 INTERNATIONAL GREEN CONSTRUCTION CODE
2018 INTERNATIONAL SWIMMING POOL AND SPA CODE
2017 NATIONAL ELECTRICAL CODE

SHEET INDEX

G0.0	COVER SHEET
G1.1	PROJECT INFORMATION / REFERENCE SITE PLAN
A1.1	BUILDING A (SFB 1001) AND BUILDING F (SFB 1006) ROOF PLANS
A1.2	BUILDING B (SFB 1002) ROOF PLAN
A1.3	BUILDING C (SFB 1003) AND BUILDING D (SFB 1004) ROOF PLANS
A1.4	BUILDING D (SFB 1005) ROOF PLAN
A1.5	BUILDING G (SFB 1007) AND BUILDING H (SFB 1008) ROOF PLANS
A1.6	BUILDING A (SFB 1014) AND RESTROOM BUILDING ROOF PLANS
A1.7	BUILDING L (SFB 1018) ROOF PLAN
A1.8	BUILDING I (SFB 1009) AND BUILDING M (SFB 1019) ROOF PLANS
A1.9	BUILDING J (SFB 1010) ROOF PLAN
A2.1	DETAILS

GENERAL NOTES

- THE CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE CODES, LAWS, AND ORDINANCES HAVING JURISDICTION ON THIS PROJECT.
- ALL OMISSIONS AND CONFLICTS BETWEEN THE VARIOUS ELEMENTS OF THE CONTRACT DOCUMENTS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT AND RESOLVED PRIOR TO PROCEEDING WITH ANY CONSTRUCTION SO INVOLVED.
- THE CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS, CLEARANCES, AND CONDITIONS. ANY DISCREPANCIES OR CONFLICTS SHALL BE REPORTED TO THE ARCHITECT PRIOR TO COMMENCEMENT OF WORK.
- WE CERTIFY TO THE BEST OF OUR KNOWLEDGE, INFORMATION AND BELIEF, THAT THE DESIGN OF THIS PROJECT COMPLIES WITH THE APPLICABLE PROVISIONS & REQUIREMENTS OF SECTION 34-4-1 TO 34-411 INCLUSIVE OF THE STATUTES OF THE STATE OF ARIZONA.
- AS PER THE SPECIFICATION SECTION FOR PROJECT CLOSE-OUT, THE ARCHITECT WILL ISSUE A "CERTIFICATE OF SUBSTANTIAL COMPLETION OF THE PROJECT WORK".
- ANY FUTURE CHANGE OR REVISIONS TO THESE PLANS SHALL BE SUBMITTED TO THE CITY FOR REVIEW, AND APPROVAL PRIOR TO COMMENCING ANY WORK.
- ALL CHANGES AND/OR REVISIONS SHALL BE NOTED ON THE PLANS BY "CLOUDING" THE AREAS AFFECTED BY THESE REVISIONS OR CHANGES, AND WITH "DELTA'S" INDICATING THE NUMBER OF TIMES THE CHANGES OCCUR. IN ADDITION, THE DATE OF THESE CHANGES OR REVISIONS SHALL BE INDICATED. THIS DATA SHALL ALSO BE PLACED IN THE TITLE BLOCK, IN AN APPROPRIATE BULLETIN OR SCHEDULE.
- SEE SPECIFICATIONS FOR PRIOR APPROVALS. IF NO PRIOR APPROVAL IS SUBMITTED THEN BID MUST BE TO ROOF MANUFACTURE SPECIFIED AS "BASIS OF DESIGN"

Architechnology

ARCHITECTURE - FACILITIES - C.M.

5229 N. 7th AVE. #101
PHOENIX, ARIZONA 85013
602.347.5226

WASHINGTON ELEMENTARY
SCHOOL DISTRICT

ROOFING IMPROVEMENTS
WASHINGTON ELEMENTARY SCHOOL DISTRICT
PALO VERDE MIDDLE SCHOOL
7502 NORTH 39th AVENUE
PHOENIX, ARIZONA 85051
SFB PROJECT NO.: BRG-DSGN-00415

PROJECT NO.:	21163
DRAWN BY:	B. TUTTLE
CHECKED BY:	L. LIND
DATE:	12/16/21

NO.	DATE	COMMENT	REVISIONS

COPYRIGHT


© 2021 - All designs, details, graphic and written material illustrated herein constitutes the original unpublished work of the Architect and may not be copied, published, reproduced electronically or by any other means, used on other projects for construction or recording without the written consent of the Architect. All rights reserved.

DRAWING TITLE

GENERAL INFORMATION /
REFERENCE SITE PLAN


DRAWING NUMBER

G1.1

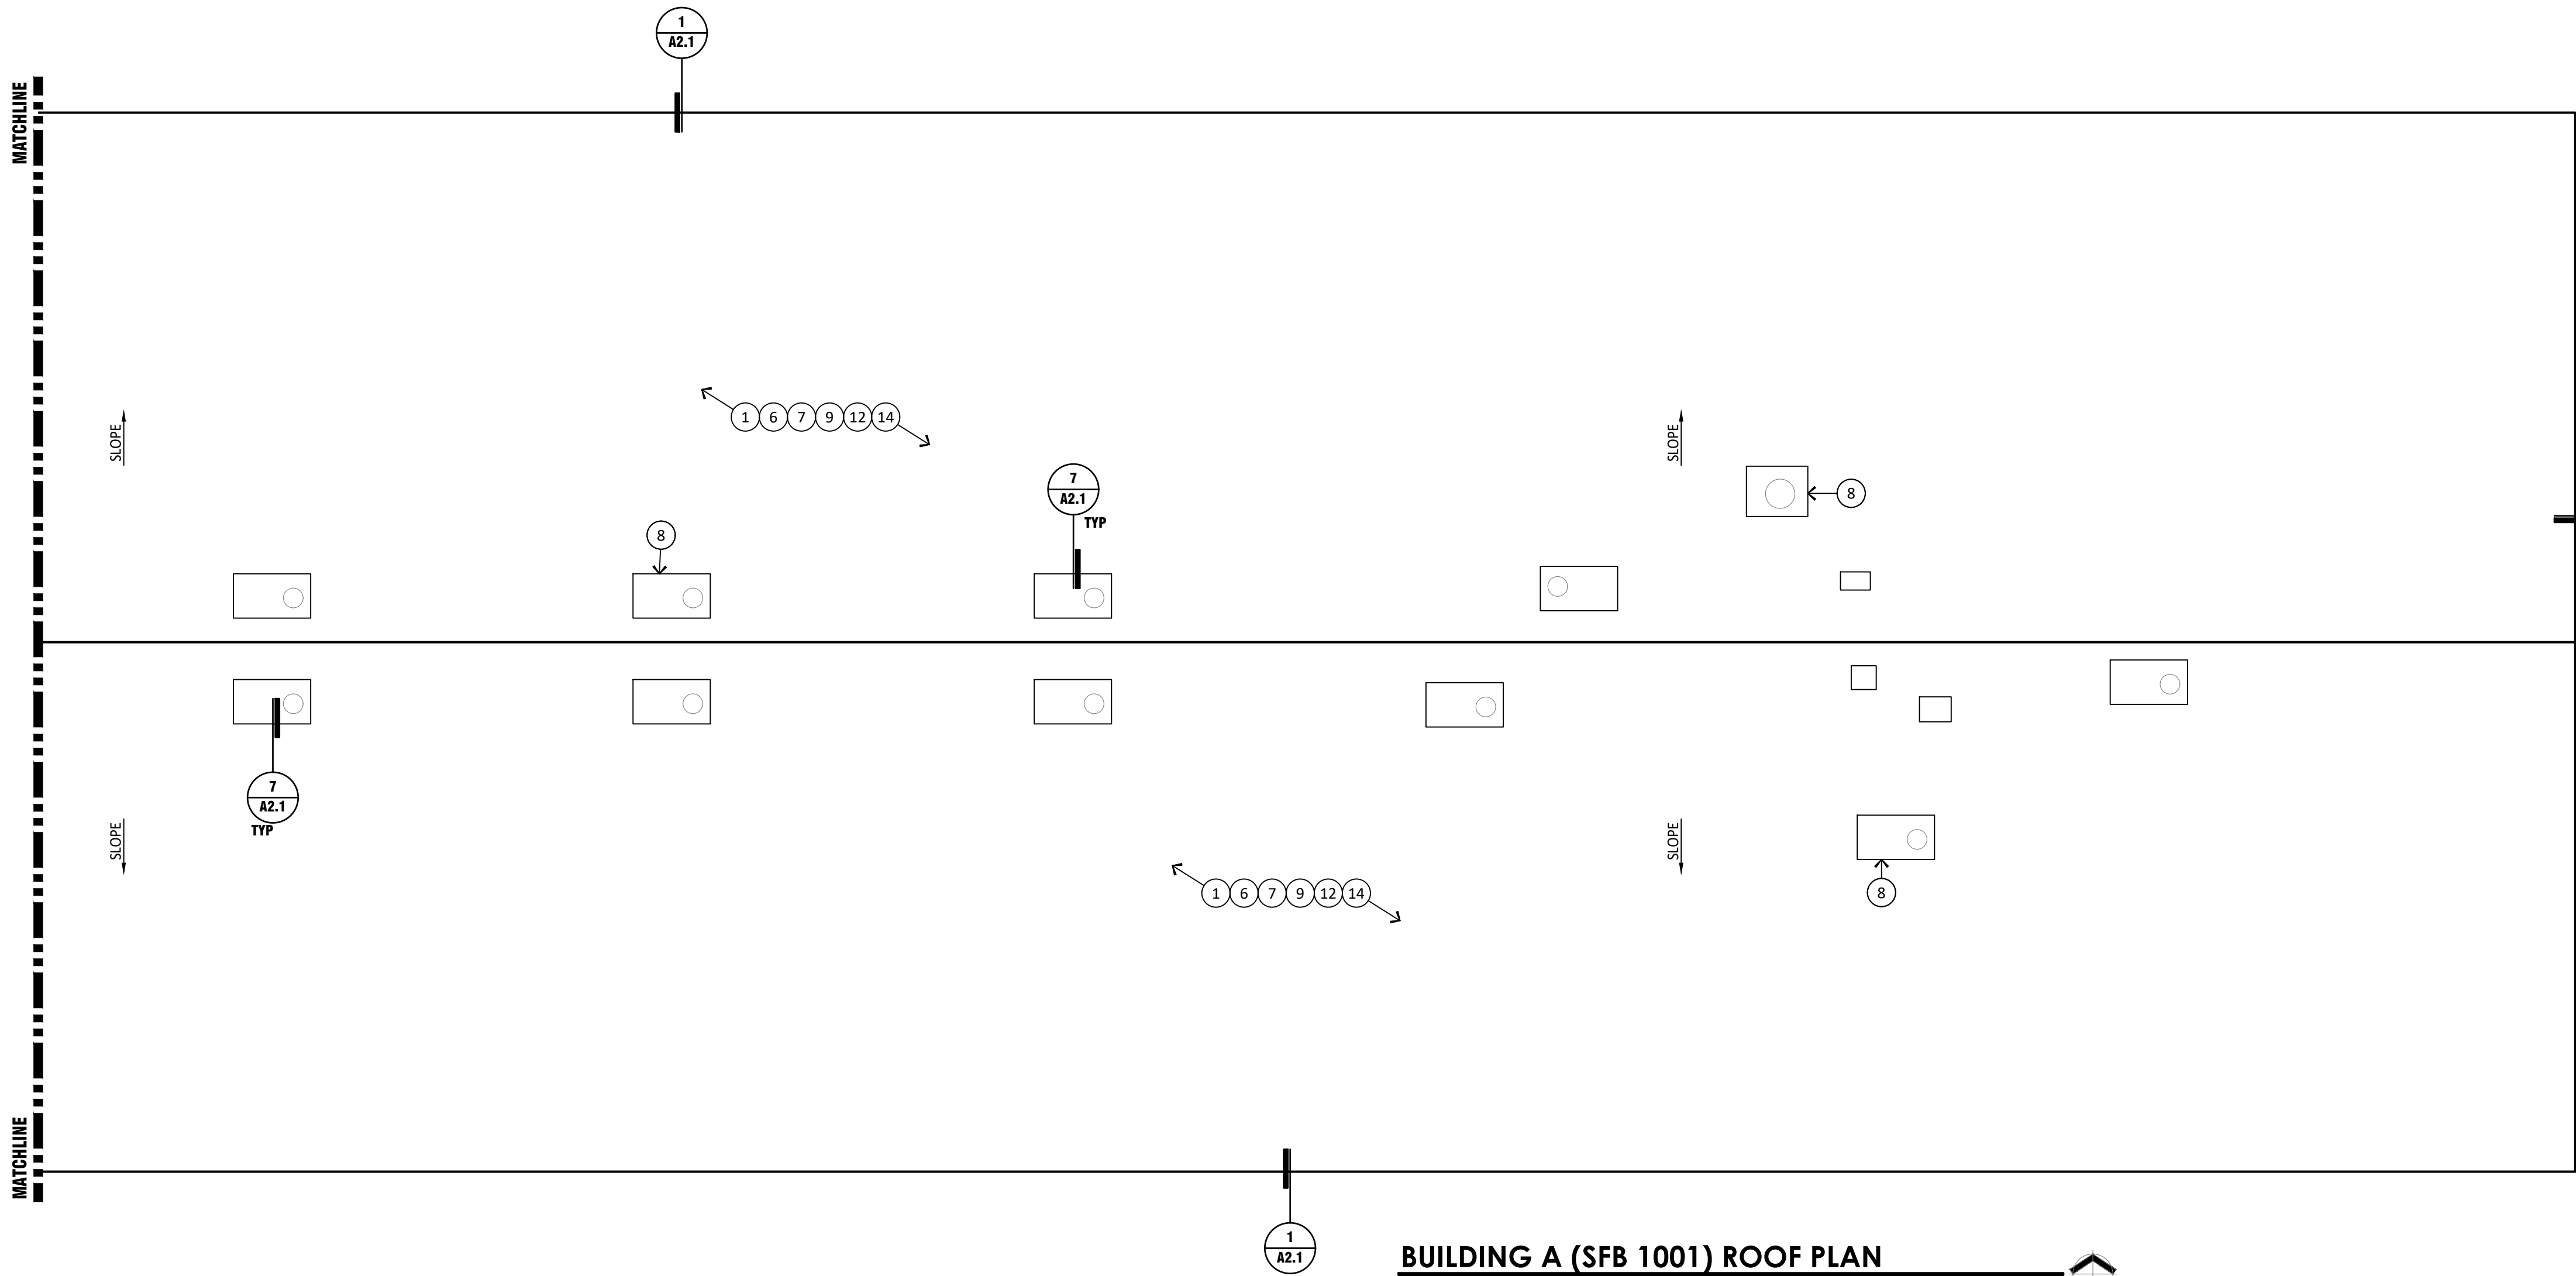

BUILDING A (SFB 1001) ROOF PLAN

1/8"=1'-0"

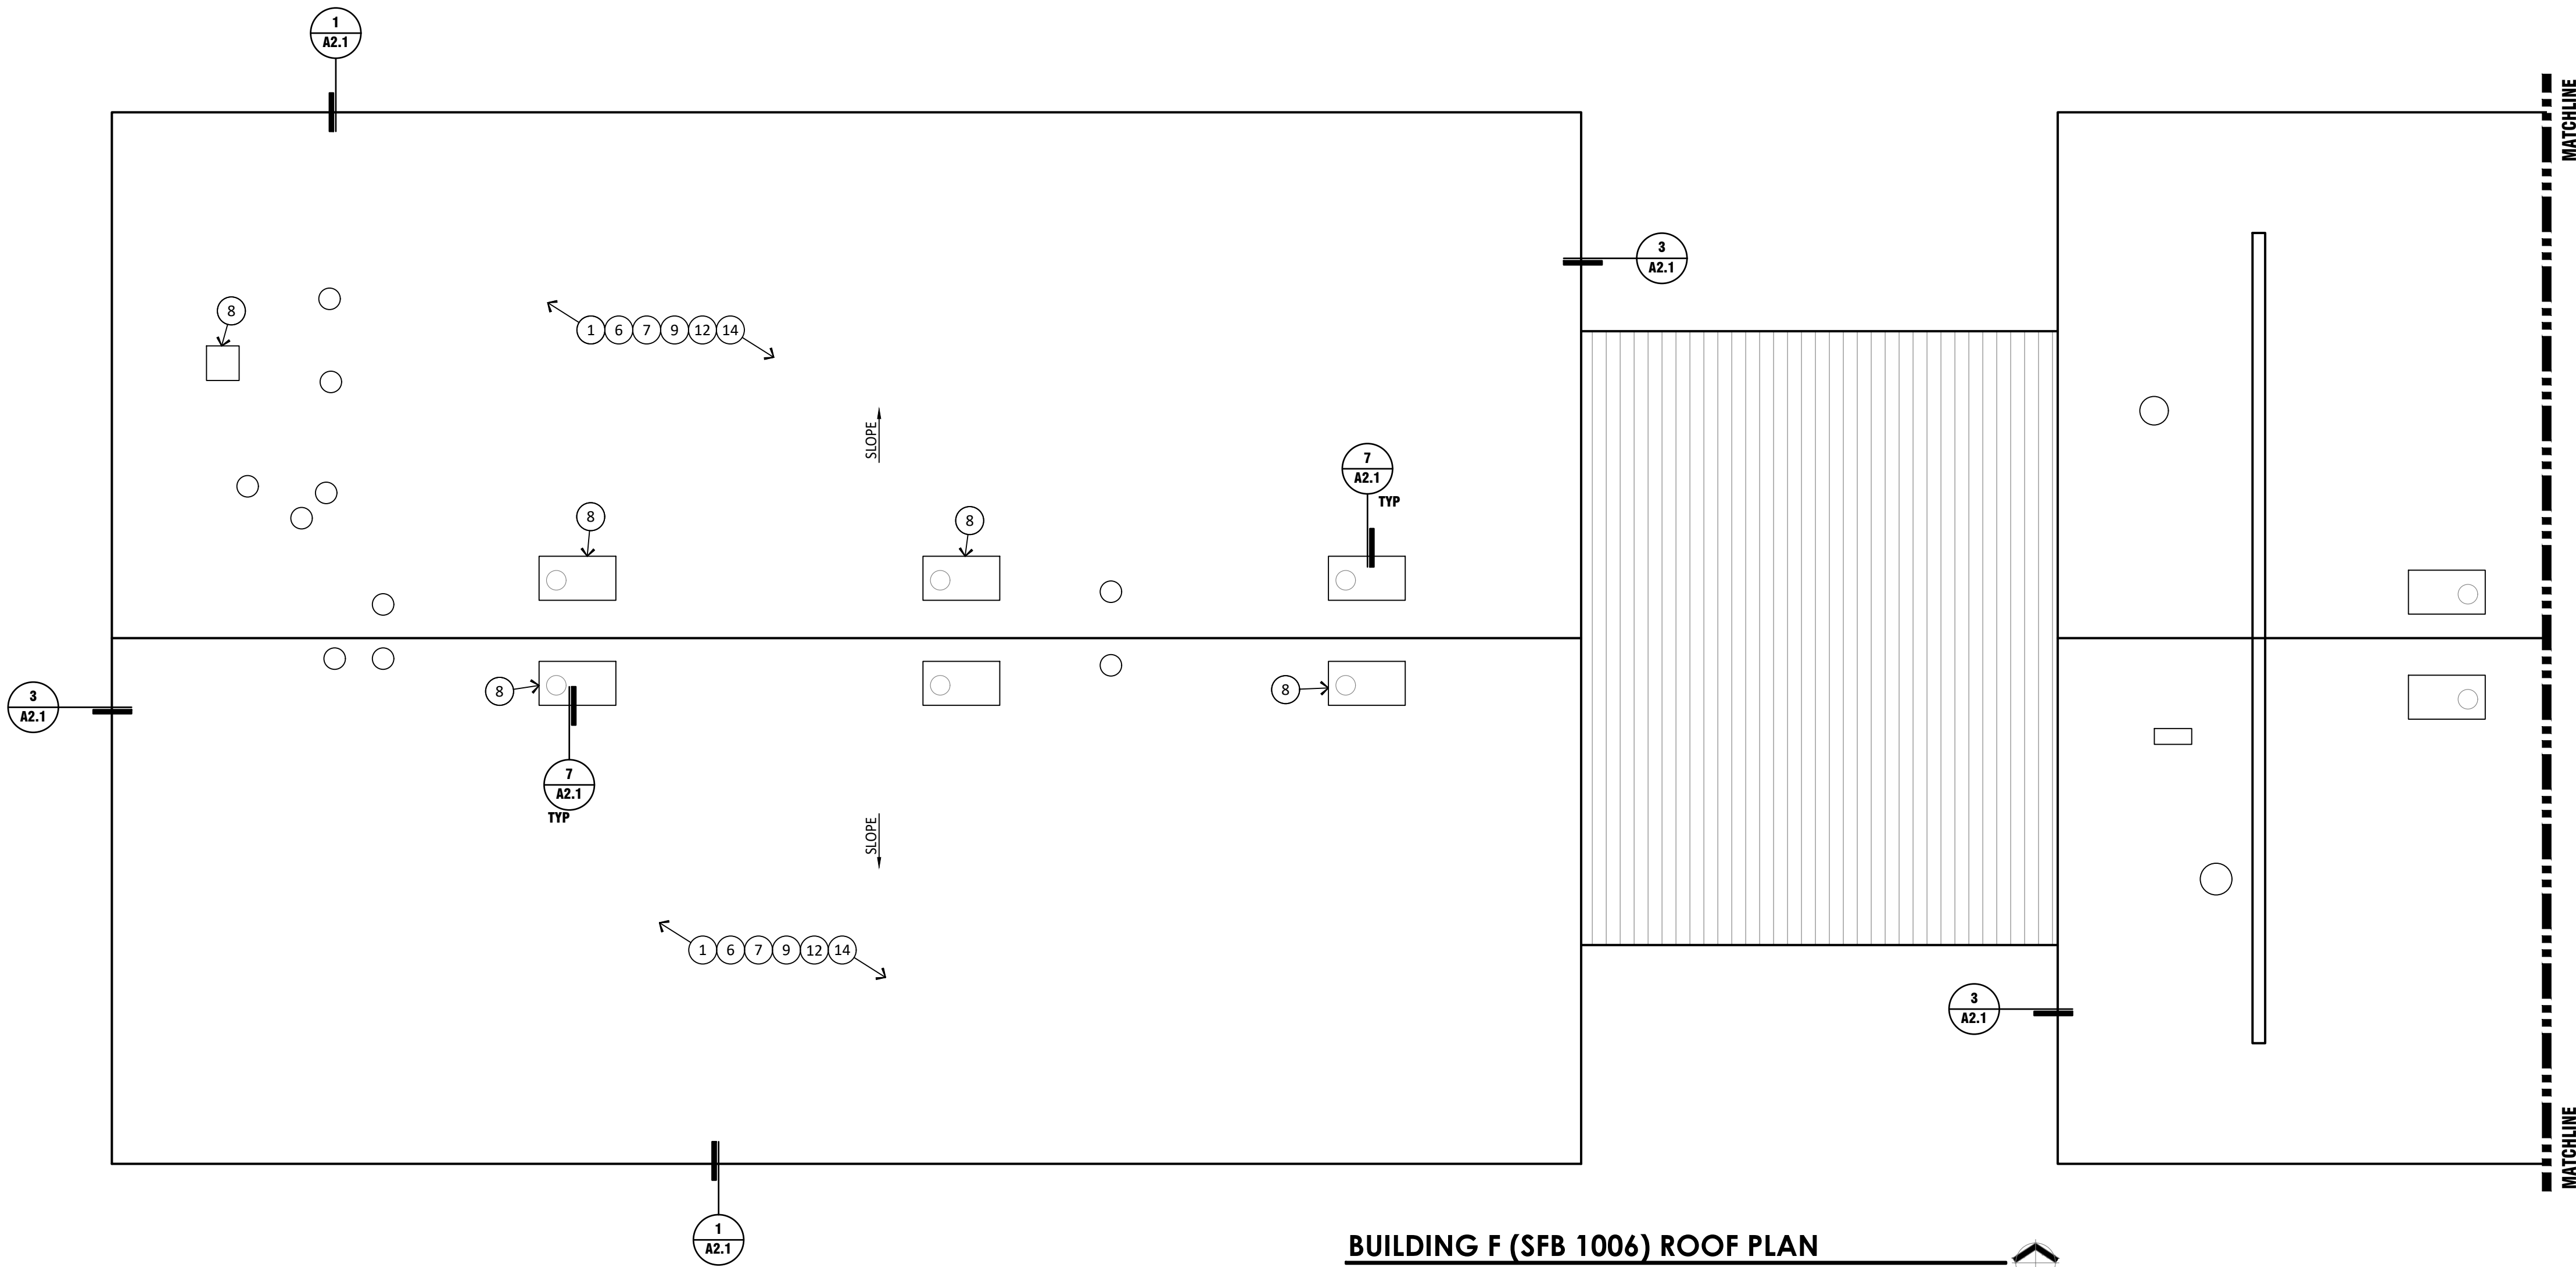

BUILDING F (SFB 1006) ROOF PLAN

1/8"=1'-0"

KEYED NOTES

- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON PLYWOOD OR TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON METAL DECK. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. TPO ROOF OVER BUILT UP ROOF OVER STRUCTURAL DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. MODIFIED BUILT UP ROOF OVER BUILT UP ROOF ON TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- GRIND EXISTING FOAM TO DECK SO THAT THE SURFACE IS CLEAN AND LEVEL FOR NEW ROOF INSTALLATION
- INSTALL NEW ROOFING ON COVER BOARD OVER RIGID INSULATION. TYPICAL - SEE SPECIFICATIONS.
- REMOVE AND REPLACE ALL METAL FLASHINGS, REGLETS, AND COUNTER FLASHINGS - TYPICAL - SEE SPECIFICATIONS.
- PROVIDE NEW FLASHING AT MECHANICAL CURBS. RAISE CURBS AS REQUIRED FOR MINIMUM 8" FLASHING. ENSURE CONDENSATE LINES ARE PROPERLY SUPPORTED. REMOVE AND REPLACE DUCT SEALANTS - SEE SPECIFICATIONS - TYPICAL
- REMOVE EXISTING SLEEPERS UNDER CONDUIT AND PIPE. PROTECT DURING CONSTRUCTION ACTIVITIES. PROVIDE NEW DURA-BLOK SUPPORTS - TYPICAL
- CLEAN EXISTING PARAPET WALLS ON ROOF SIDE. WRAP WALLS 4'-0" HIGH AND UNDER WITH KEE MEMBRANE THAT EXTENDS UP AND OVER NEW TREATED WOOD SLEEPERS.
- PROVIDE BLOCK FILL AND SEAL ROOF SIDE OF PARAPET WALL
- REMOVE ALL CONSTRUCTION JOINT CAULKING FROM ROOF SIDE OF PARAPET AND REPLACE PER SPECIFICATIONS
- PROVIDE NEW SUMPS AS REQUIRED AT EXISTING SCUPPER AND DRAIN LOCATIONS. CLEAR ALL DRAIN LEADERS AND ENSURE PROPER OPERATION - SEE SPECIFICATIONS - TYPICAL
- RAISE DUCT AS REQUIRED FOR PROPER FLASHING - TYPICAL
- PROVIDE NEW TREATED WOOD NAILERS AND METAL COPING CAPS PER SPECIFICATIONS
- PROVIDE NEW SHEET METAL SCUPPERS
- PROVIDE REPAIRS TO LAPS, SEAMS, RIVETS, PENETRATIONS AND OTHERS AS REQUIRED ON METAL ROOFS. SEAL AS REQUIRED - VERIFY IN FIELD. SEE SPECIFICATIONS



GENERAL NOTES

- CONTRACTOR TO REVIEW SPECIFICATIONS PRIOR TO BID. NOTIFY ARCHITECT OF ANY CONFLICTS.
- KEYNOTES ARE TYPICAL THROUGHOUT
- ANY INCIDENTAL MECHANICAL, PLUMBING OR ELECTRICAL ASSOCIATED WITH ROOFTOP EQUIPMENT SHALL BE PERFORMED BY PROPER LICENSED SUBCONTRACTORS UNDER THIS ROOFING CONTRACT - ALL WORK SHALL BE PERFORMED TO CURRENT CODES
- ADJUST EXISTING ELECTRICAL CONDUIT, CONDENSATE AND UTILITY LINES AS REQUIRED FOR NEW ROOF HEIGHT. PROVIDE NEW DURA BLOK SUPPORTS - TYPICAL - SEE SPECIFICATIONS.
- REMOVE EXISTING LOW VOLTAGE WIRE AND REINSTALL AFTER ROOF REPLACEMENT
- REMOVE AND PATCH ALL ABANDONED OPENINGS. NOTIFY ARCHITECT IF OPENING IS WIDER THAN 12" X 12"
- DEMO ALL ABANDONED PITCH PANS. CAP WATER AND POWER

TYPICAL DETAILS THROUGHOUT

10 A2.1	ROOF TOP PIPE SUPPORT	14 A2.1	PITCH POCKET
11 A2.1	PRE MANUFACTURED SUPPORT CURB	15 A2.1	PIPE PENETRATION
12 A2.1	PASSIVE VENT / AIR INTAKE	16 A2.1	COPING
13 A2.1	EXPANSION JOINT	17 A2.1	EXHAUST FAN

REFERENCE PLAN

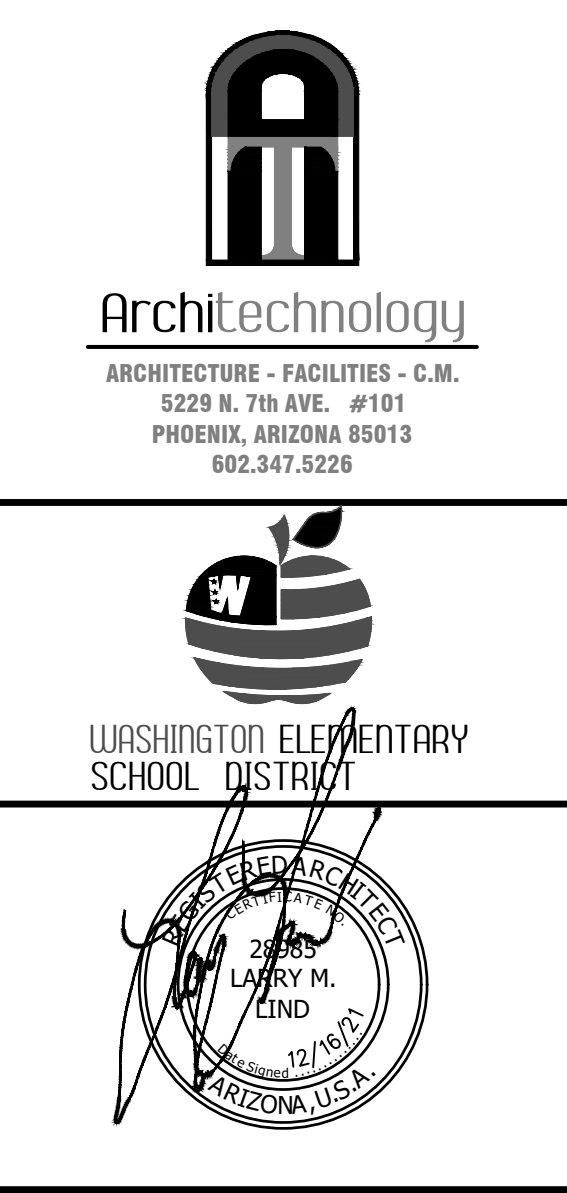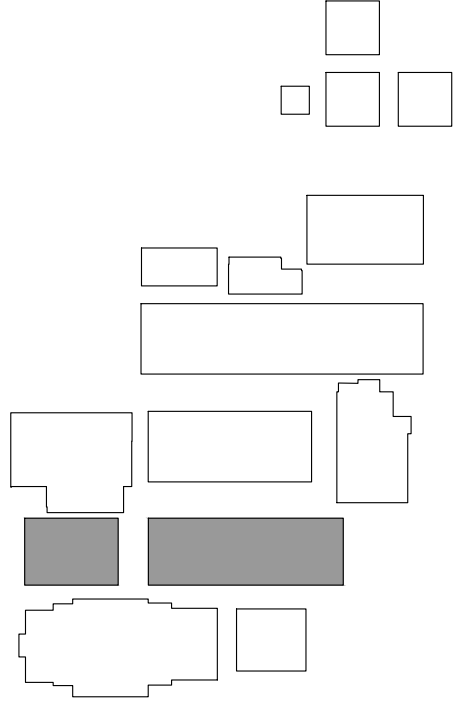

ROOFING IMPROVEMENTS
WASHINGTON ELEMENTARY SCHOOL DISTRICT
PALO VERDE MIDDLE SCHOOL
7502 NORTH 39th AVENUE
PHOENIX, ARIZONA 85051
SFB PROJECT NO.: BRG-DSGN-00415

PROJECT NO.: 21163
DRAWN BY: B. TUTTLE
CHECKED BY: L. LIND
DATE: 12/16/21


NO.	DATE	COMMENT	REVISIONS

COPYRIGHT
© 2021 - All designs, details, graphic and written material illustrated herein constitutes the original unpublished work of the Architect and may not be copied, published, reproduced electronically or by any other means, used on other projects for construction or recording without the written consent of the Architect. All rights reserved.

DRAWING TITLE
BUILDING A (SFB 1001)AND
BUILDING F (SFB 1006)
ROOF PLANS

DRAWING NUMBER

A1.1



Architect
ARCHITECTURE - FACILITIES - C.M.
5229 N. 7th AVE. #101
PHOENIX, ARIZONA 85013
602.347.5226



WASHINGTON ELEMENTARY
SCHOOL DISTRICT



ROOFING IMPROVEMENTS
WASHINGTON ELEMENTARY SCHOOL DISTRICT
PALO VERDE MIDDLE SCHOOL
7502 NORTH 39th AVENUE
PHOENIX, ARIZONA 85051
SFB PROJECT NO.: BRG-DSGN-00415

KEYED NOTES

- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON PLYWOOD OR TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON METAL DECK. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. TPO ROOF OVER BUILT UP ROOF OVER STRUCTURAL DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. MODIFIED BUILT UP ROOF OVER BUILT UP ROOF ON TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- GRIND EXISTING FOAM TO DECK SO THAT THE SURFACE IS CLEAN AND LEVEL FOR NEW ROOF INSTALLATION
- INSTALL NEW ROOFING ON COVER BOARD OVER RIGID INSULATION. TYPICAL - SEE SPECIFICATIONS.
- REMOVE AND REPLACE ALL METAL FLASHINGS, REGLETS, AND COUNTER FLASHINGS - TYPICAL - SEE SPECIFICATIONS.
- PROVIDE NEW FLASHING AT MECHANICAL CURBS. RAISE CURBS AS REQUIRED FOR MINIMUM 8" FLASHING. ENSURE CONDENSATE LINES ARE PROPERLY SUPPORTED. REMOVE AND REPLACE DUCT SEALANTS. - SEE SPECIFICATIONS - TYPICAL
- REMOVE EXISTING SLEEPERS UNDER CONDUIT AND PIPE. PROTECT DURING CONSTRUCTION ACTIVITIES. PROVIDE NEW DURA-BLOK SUPPORTS - TYPICAL
- CLEAN EXISTING PARAPET WALLS ON ROOF SIDE. WRAP WALLS 4'-0" HIGH AND UNDER WITH KEE MEMBRANE THAT EXTENDS UP AND OVER NEW TREATED WOOD SLEEPERS.
- PROVIDE BLOCK FILL AND SEAL ROOF SIDE OF PARAPET WALL
- REMOVE ALL CONSTRUCTION JOINT CAULKING FROM ROOF SIDE OF PARAPET AND REPLACE PER SPECIFICATIONS
- PROVIDE NEW SUMPS AS REQUIRED AT EXISTING SCUPPER AND DRAIN LOCATIONS. CLEAR ALL DRAIN LEADERS AND ENSURE PROPER OPERATION - SEE SPECIFICATIONS - TYPICAL
- RAISE DUCT AS REQUIRED FOR PROPER FLASHING - TYPICAL
- PROVIDE NEW TREATED WOOD NAILERS AND METAL COPING CAPS PER SPECIFICATIONS
- PROVIDE NEW SHEET METAL SCUPPERS
- PROVIDE REPAIRS TO LAPS, SEAMS, RIVETS, PENETRATIONS AND OTHERS AS REQUIRED ON METAL ROOFS. SEAL AS REQUIRED - VERIFY IN FIELD. SEE SPECIFICATIONS


GENERAL NOTES

- CONTRACTOR TO REVIEW SPECIFICATIONS PRIOR TO BID. NOTIFY ARCHITECT OF ANY CONFLICTS.
- KEYNOTES ARE TYPICAL THROUGHOUT
- ANY INCIDENTAL MECHANICAL, PLUMBING OR ELECTRICAL ASSOCIATED WITH ROOFTOP EQUIPMENT SHALL BE PERFORMED BY PROPER LICENSED SUBCONTRACTORS UNDER THIS ROOFING CONTRACT - ALL WORK SHALL BE PERFORMED TO CURRENT CODES
- ADJUST EXISTING ELECTRICAL CONDUIT, CONDENSATE AND UTILITY LINES AS REQUIRED FOR NEW ROOF HEIGHT. PROVIDE NEW DURA BLOK SUPPORTS - TYPICAL - SEE SPECIFICATIONS.
- REMOVE EXISTING LOW VOLTAGE WIRE AND REINSTALL AFTER ROOF REPLACEMENT
- REMOVE AND PATCH ALL ABANDONED OPENINGS. NOTIFY ARCHITECT IF OPENING IS WIDER THAN 12" X 12"
- DEMO ALL ABANDONED PITCH PANS. CAP WATER AND POWER

TYPICAL DETAILS THROUGHOUT


10 A2.1	ROOF TOP PIPE SUPPORT	14 A2.1	PITCH POCKET
11 A2.1	PRE MANUFACTURED SUPPORT CURB	15 A2.1	PIPE PENETRATION
12 A2.1	PASSIVE VENT / AIR INTAKE	16 A2.1	COPING
13 A2.1	EXPANSION JOINT	17 A2.1	EXHAUST FAN

REFERENCE PLAN

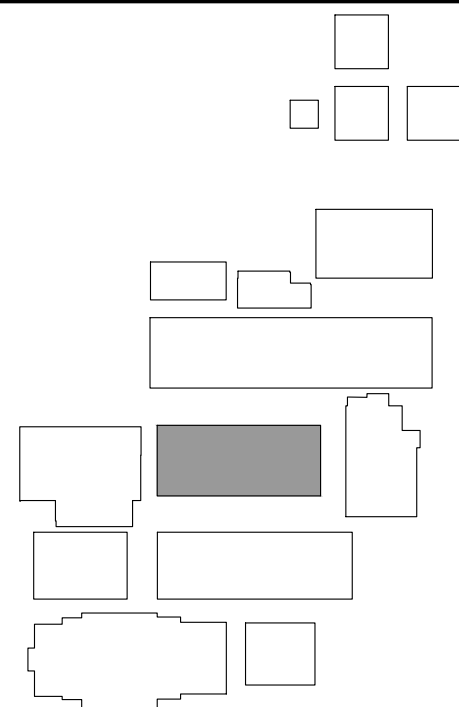

BUILDING B (1002) ROOF PLAN

1/8"=1'-0"

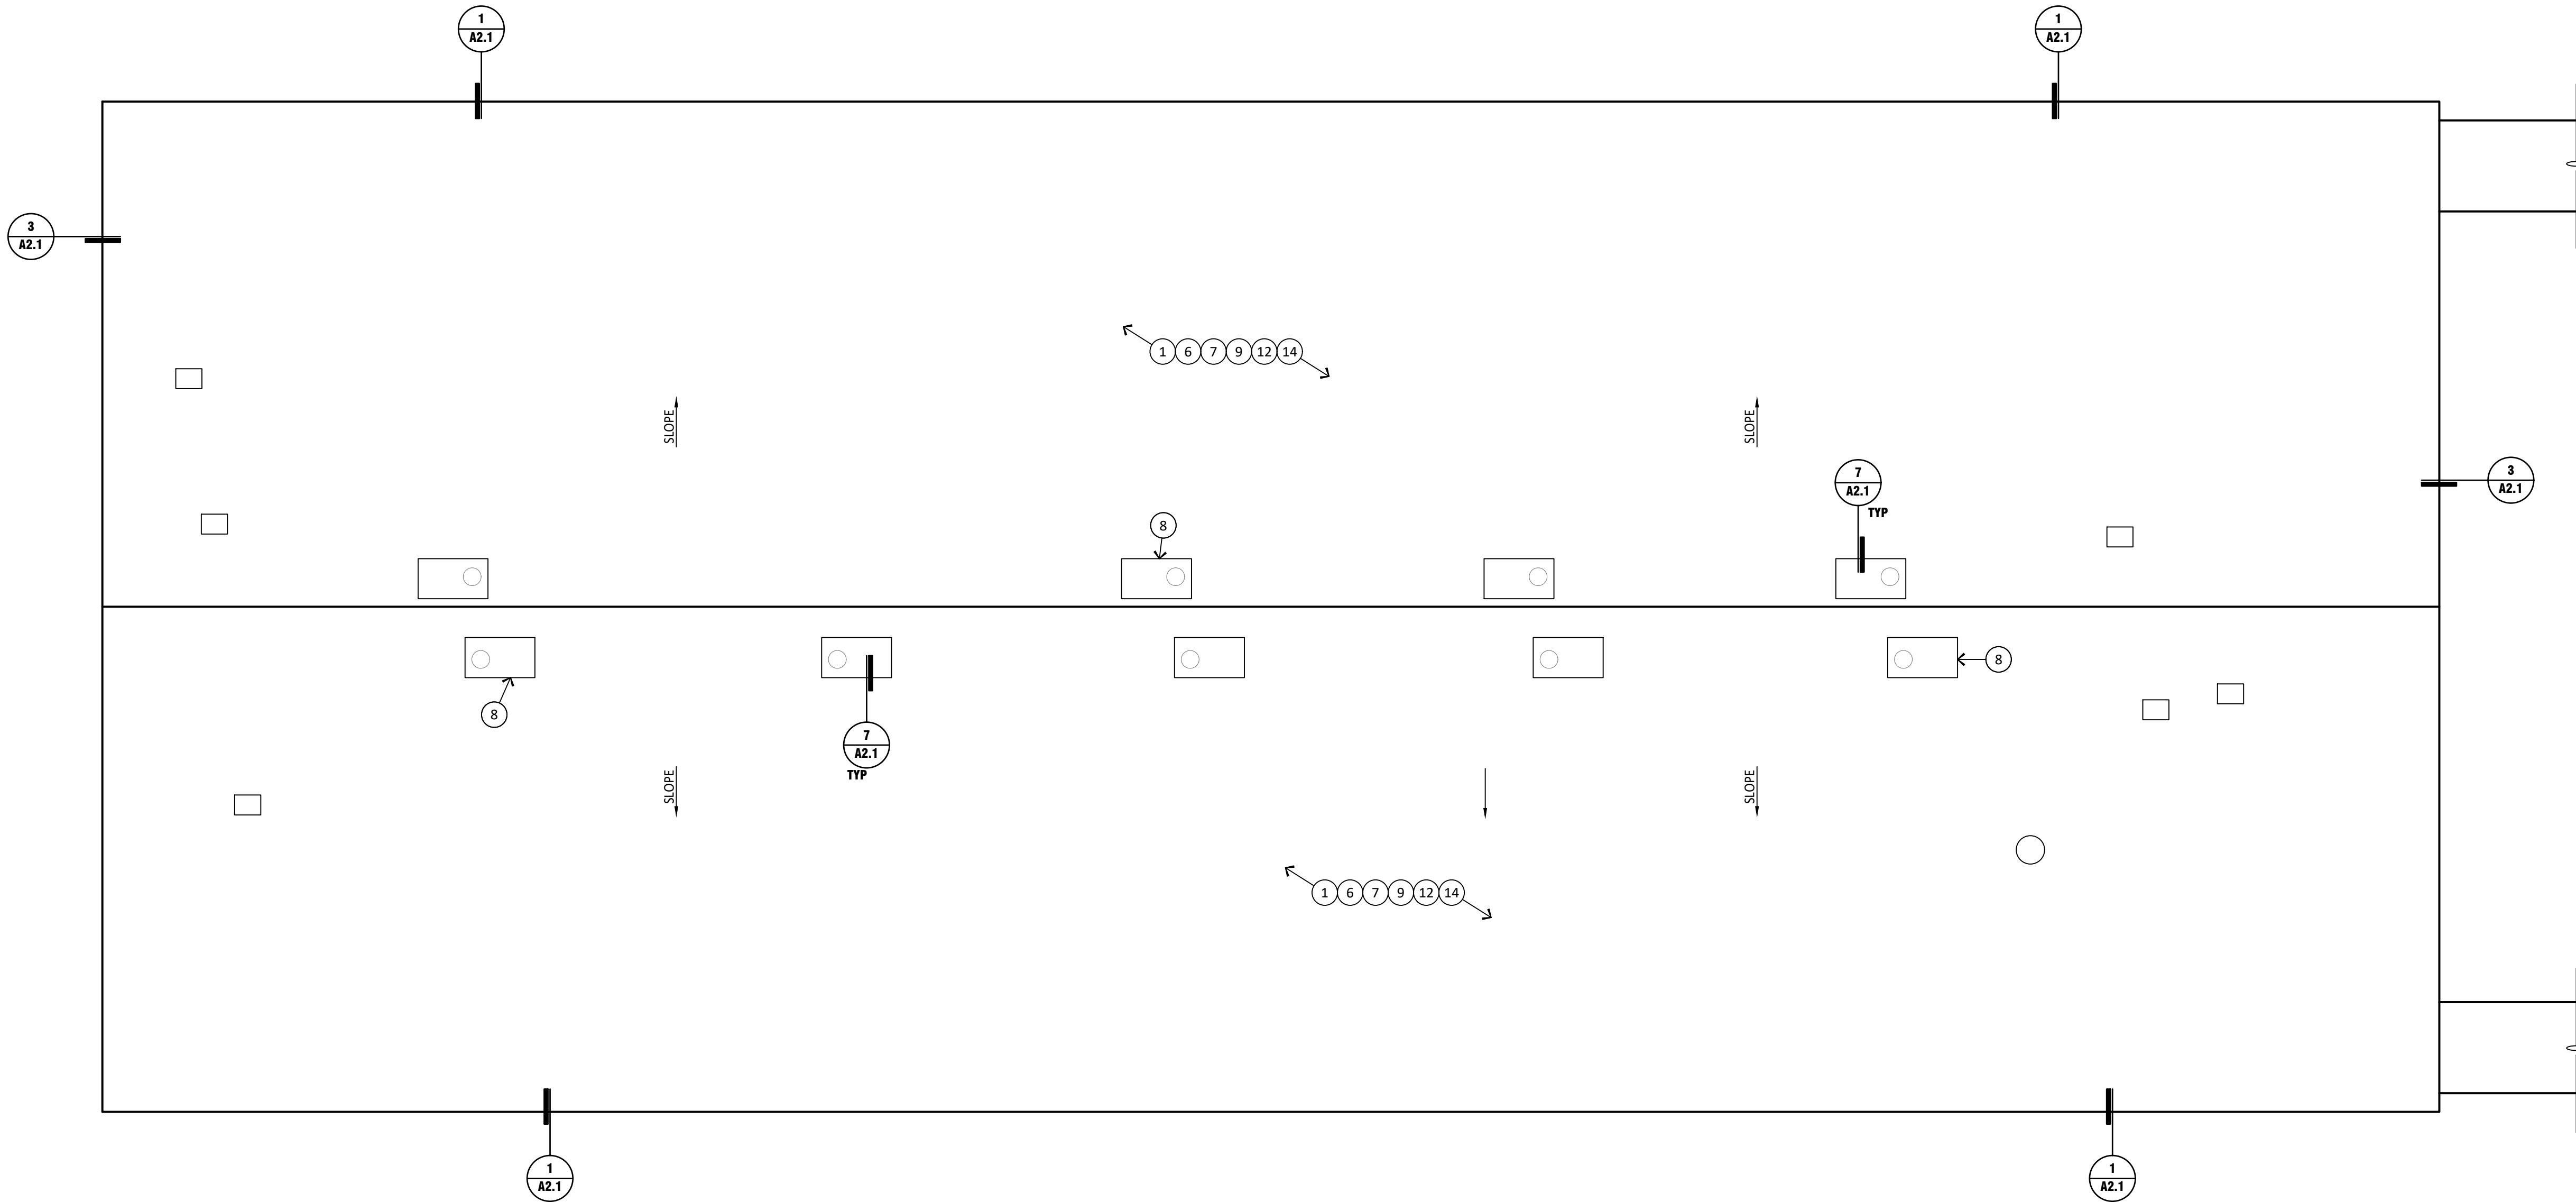

PROJECT NO.: 21163

DRAWN BY: B. TUTTLE

CHECKED BY: L. LIND

DATE: 12/16/21

NO.	DATE	COMMENT	REVISIONS

COPYRIGHT


© 2021 - All designs, details, graphic and written material illustrated herein constitutes the original unpublished work of the Architect and may not be copied, published, reproduced electronically or by any other means, used on other projects for construction or recording without the written consent of the Architect. All rights reserved.

DRAWING TITLE

BUILDING B (SFB 1002)
ROOF PLAN


DRAWING NUMBER

A1.2

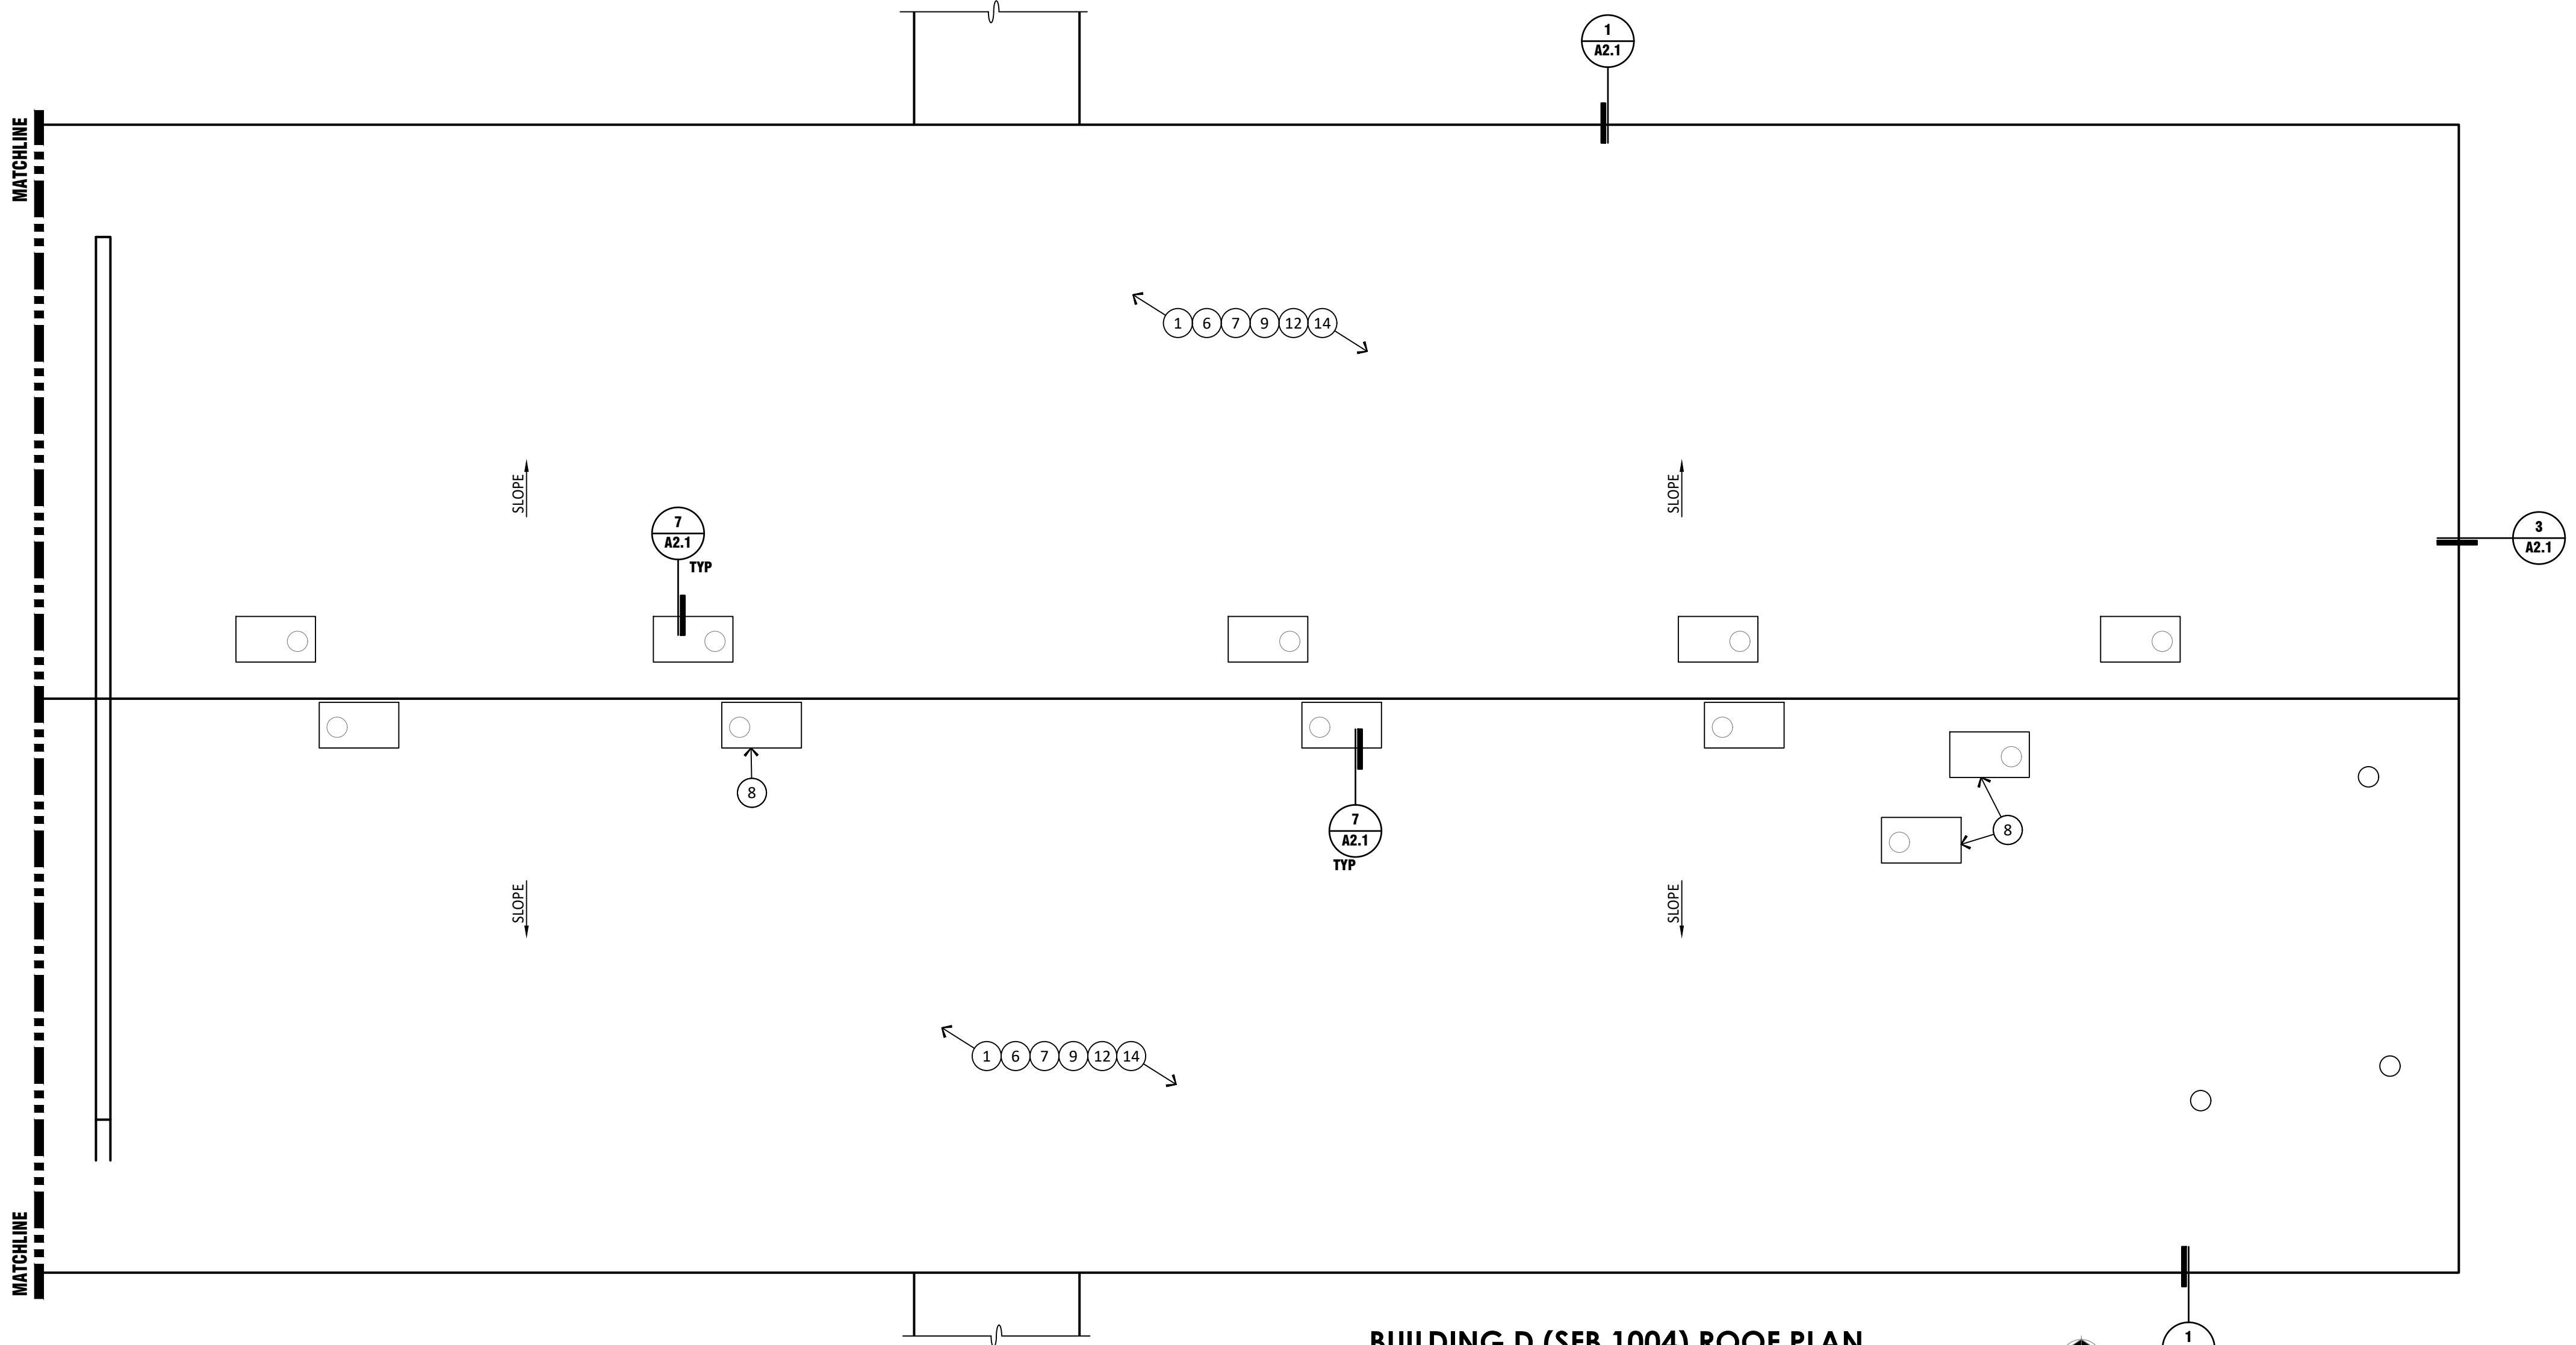

BUILDING D (SFB 1004) ROOF PLAN

1/8"=1'-0"

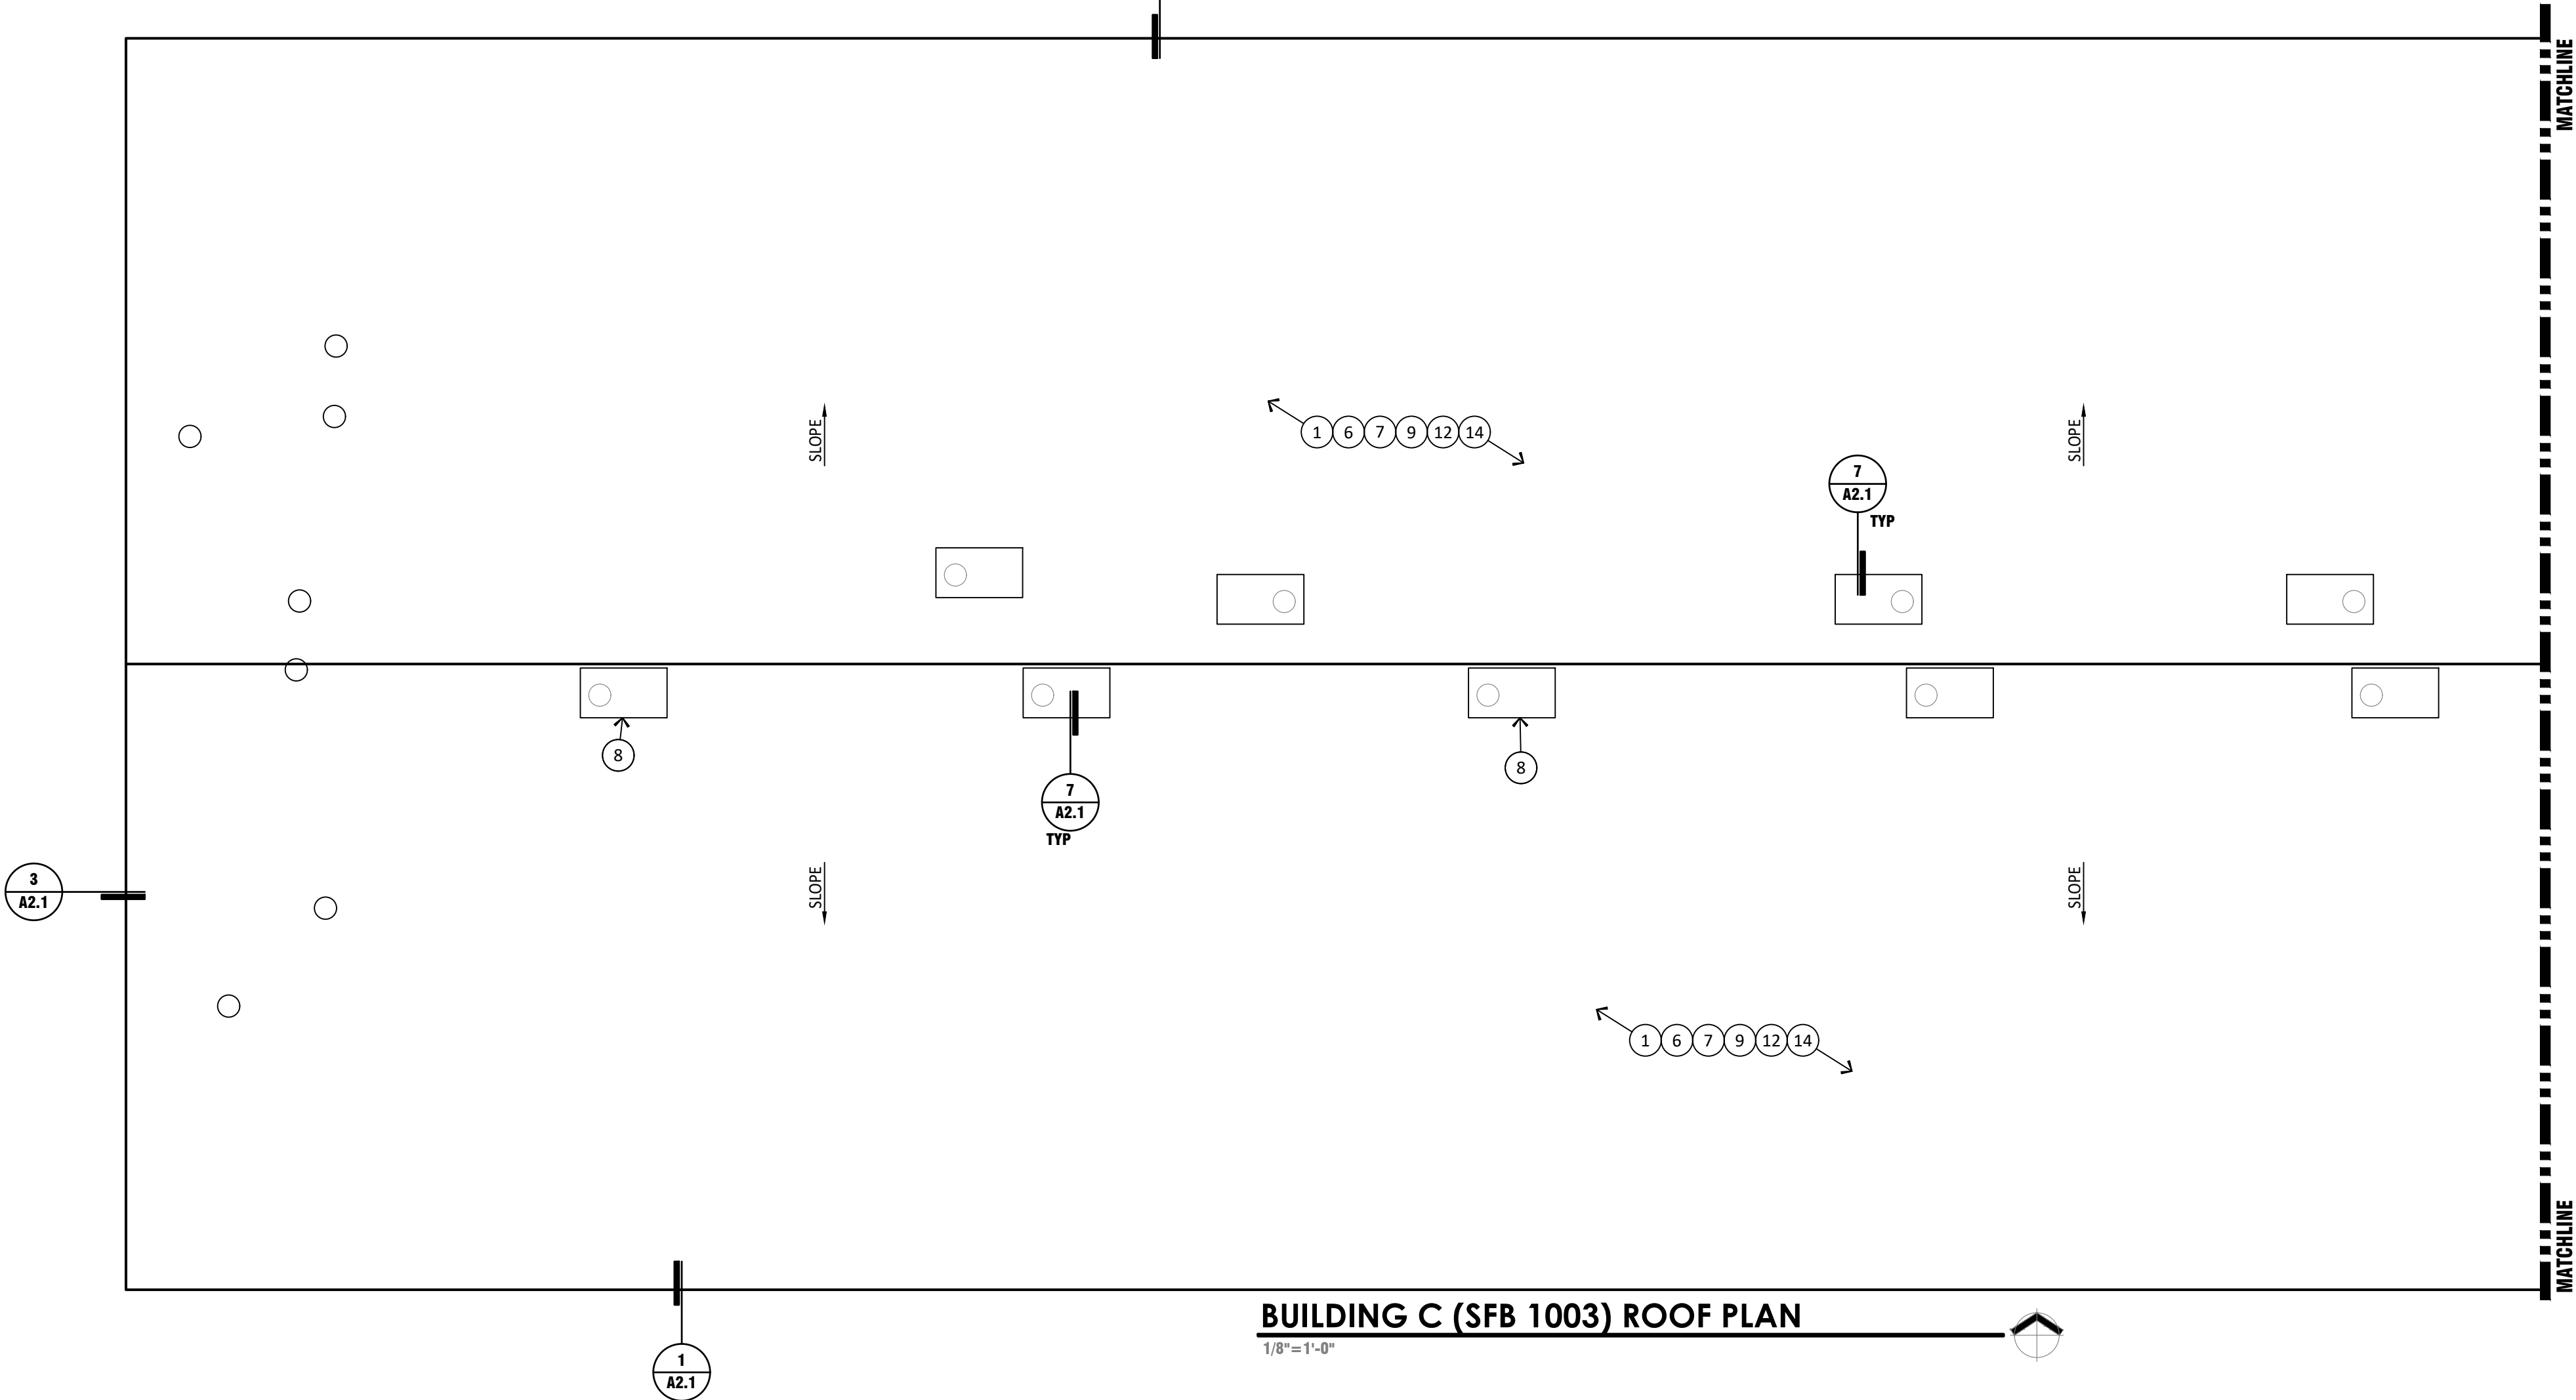

BUILDING C (SFB 1003) ROOF PLAN

1/8"=1'-0"

KEYED NOTES

- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON PLYWOOD OR TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON METAL DECK. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. TPO ROOF OVER BUILT UP ROOF OVER STRUCTURAL DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. MODIFIED BUILT UP ROOF OVER BUILT UP ROOF ON TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- GRIND EXISTING FOAM TO DECK SO THAT THE SURFACE IS CLEAN AND LEVEL FOR NEW ROOF INSTALLATION
- INSTALL NEW ROOFING ON COVER BOARD OVER RIGID INSULATION. TYPICAL - SEE SPECIFICATIONS.
- REMOVE AND REPLACE ALL METAL FLASHINGS, REGLETS, AND COUNTER FLASHINGS - TYPICAL - SEE SPECIFICATIONS.
- PROVIDE NEW FLASHING AT MECHANICAL CURBS. RAISE CURBS AS REQUIRED FOR MINIMUM 8" FLASHING. ENSURE CONDENSATE LINES ARE PROPERLY SUPPORTED. REMOVE AND REPLACE DUCT SEALANTS. - SEE SPECIFICATIONS - TYPICAL
- REMOVE EXISTING SLEEPERS UNDER CONDUIT AND PIPE. PROTECT DURING CONSTRUCTION ACTIVITIES. PROVIDE NEW DURA-BLOK SUPPORTS - TYPICAL
- CLEAN EXISTING PARAPET WALLS ON ROOF SIDE. WRAP WALLS 4'-0" HIGH AND UNDER WITH KEE MEMBRANE THAT EXTENDS UP AND OVER NEW TREATED WOOD SLEEPERS.
- PROVIDE BLOCK FILL AND SEAL ROOF SIDE OF PARAPET WALL
- REMOVE ALL CONSTRUCTION JOINT CAULKING FROM ROOF SIDE OF PARAPET AND REPLACE PER SPECIFICATIONS
- PROVIDE NEW SUMPS AS REQUIRED AT EXISTING SCUPPER AND DRAIN LOCATIONS. CLEAR ALL DRAIN LEADERS AND ENSURE PROPER OPERATION - SEE SPECIFICATIONS - TYPICAL
- RAISE DUCT AS REQUIRED FOR PROPER FLASHING - TYPICAL
- PROVIDE NEW TREATED WOOD NAILERS AND METAL COPING CAPS PER SPECIFICATIONS
- PROVIDE NEW SHEET METAL SCUPPERS
- PROVIDE REPAIRS TO LAPS, SEAMS, RIVETS, PENETRATIONS AND OTHERS AS REQUIRED ON METAL ROOFS. SEAL AS REQUIRED - VERIFY IN FIELD. SEE SPECIFICATIONS


GENERAL NOTES

- CONTRACTOR TO REVIEW SPECIFICATIONS PRIOR TO BID. NOTIFY ARCHITECT OF ANY CONFLICTS.
- KEYNOTES ARE TYPICAL THROUGHOUT
- ANY INCIDENTAL MECHANICAL, PLUMBING OR ELECTRICAL ASSOCIATED WITH ROOFTOP EQUIPMENT SHALL BE PERFORMED BY PROPER LICENSED SUBCONTRACTORS UNDER THIS ROOFING CONTRACT - ALL WORK SHALL BE PERFORMED TO CURRENT CODES
- ADJUST EXISTING ELECTRICAL CONDUIT, CONDENSATE AND UTILITY LINES AS REQUIRED FOR NEW ROOF HEIGHT. PROVIDE NEW DURA BLOK SUPPORTS - TYPICAL - SEE SPECIFICATIONS.
- REMOVE EXISTING LOW VOLTAGE WIRE AND REINSTALL AFTER ROOF REPLACEMENT
- REMOVE AND PATCH ALL ABANDONED OPENINGS. NOTIFY ARCHITECT IF OPENING IS WIDER THAN 12" X 12"
- DEMO ALL ABANDONED PITCH PANS. CAP WATER AND POWER

TYPICAL DETAILS THROUGHOUT

10 A2.1	ROOF TOP PIPE SUPPORT	14 A2.1	PITCH POCKET
11 A2.1	PRE MANUFACTURED SUPPORT CURB	15 A2.1	PIPE PENETRATION
12 A2.1	PASSIVE VENT / AIR INTAKE	16 A2.1	COPING
13 A2.1	EXPANSION JOINT	17 A2.1	EXHAUST FAN

REFERENCE PLAN

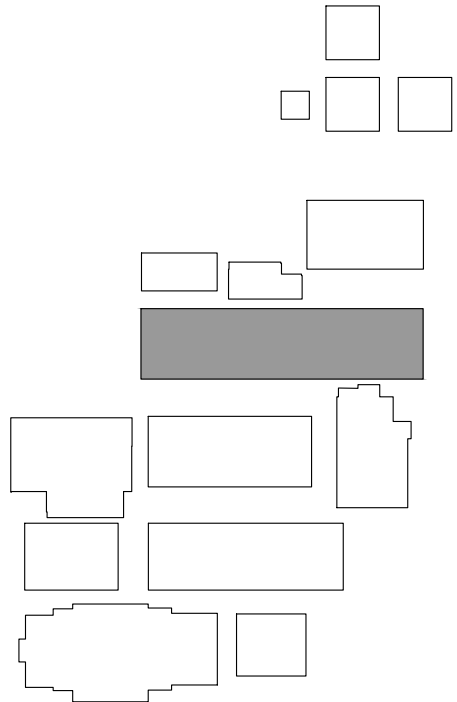

ROOFING IMPROVEMENTS
WASHINGTON ELEMENTARY SCHOOL DISTRICT
PALO VERDE MIDDLE SCHOOL
7502 NORTH 39th AVENUE
PHOENIX, ARIZONA 85051
SFB PROJECT NO.: BRG-DSGN-00415

PROJECT NO.: 21163
DRAWN BY: B. TUTTLE
CHECKED BY: L. LIND
DATE: 12/16/21

NO.	DATE	COMMENT	REVISIONS

COPYRIGHT
© 2021 - All designs, details, graphic and written material illustrated herein constitutes the original unpublished work of the Architect and may not be copied, published, reproduced electronically or by any other means, used on other projects for construction or recording without the written consent of the Architect. All rights reserved.

DRAWING TITLE
BUILDING C (SFB 1003)
ROOF PLAN

DRAWING NUMBER

A1.3

KEYED NOTES

- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON PLYWOOD OR TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON METAL DECK. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. TPO ROOF OVER BUILT UP ROOF OVER STRUCTURAL DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. MODIFIED BUILT UP ROOF OVER BUILT UP ROOF ON TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- GRIND EXISTING FOAM TO DECK SO THAT THE SURFACE IS CLEAN AND LEVEL FOR NEW ROOF INSTALLATION
- INSTALL NEW ROOFING ON COVER BOARD OVER RIGID INSULATION. TYPICAL - SEE SPECIFICATIONS.
- REMOVE AND REPLACE ALL METAL FLASHINGS, REGLETS, AND COUNTER FLASHINGS - TYPICAL - SEE SPECIFICATIONS.
- PROVIDE NEW FLASHING AT MECHANICAL CURBS. RAISE CURBS AS REQUIRED FOR MINIMUM 8" FLASHING. ENSURE CONDENSATE LINES ARE PROPERLY SUPPORTED. REMOVE AND REPLACE DUCT SEALANTS. - SEE SPECIFICATIONS - TYPICAL
- REMOVE EXISTING SLEEPERS UNDER CONDUIT AND PIPE. PROTECT DURING CONSTRUCTION ACTIVITIES. PROVIDE NEW DURA-BLOK SUPPORTS - TYPICAL
- CLEAN EXISTING PARAPET WALLS ON ROOF SIDE. WRAP WALLS 4'-0" HIGH AND UNDER WITH KEE MEMBRANE THAT EXTENDS UP AND OVER NEW TREATED WOOD SLEEPERS.
- PROVIDE BLOCK FILL AND SEAL ROOF SIDE OF PARAPET WALL
- REMOVE ALL CONSTRUCTION JOINT CAULKING FROM ROOF SIDE OF PARAPET AND REPLACE PER SPECIFICATIONS
- PROVIDE NEW SUMPS AS REQUIRED AT EXISTING SCUPPER AND DRAIN LOCATIONS. CLEAR ALL DRAIN LEADERS AND ENSURE PROPER OPERATION - SEE SPECIFICATIONS - TYPICAL
- RAISE DUCT AS REQUIRED FOR PROPER FLASHING - TYPICAL
- PROVIDE NEW TREATED WOOD NAILERS AND METAL COPING CAPS PER SPECIFICATIONS
- PROVIDE NEW SHEET METAL SCUPPERS
- PROVIDE REPAIRS TO LAPS, SEAMS, RIVETS, PENETRATIONS AND OTHERS AS REQUIRED ON METAL ROOFS. SEAL AS REQUIRED - VERIFY IN FIELD. SEE SPECIFICATIONS


GENERAL NOTES

- CONTRACTOR TO REVIEW SPECIFICATIONS PRIOR TO BID. NOTIFY ARCHITECT OF ANY CONFLICTS.
- KEYNOTES ARE TYPICAL THROUGHOUT
- ANY INCIDENTAL MECHANICAL, PLUMBING OR ELECTRICAL ASSOCIATED WITH ROOFTOP EQUIPMENT SHALL BE PERFORMED BY PROPER LICENSED SUBCONTRACTORS UNDER THIS ROOFING CONTRACT - ALL WORK SHALL BE PERFORMED TO CURRENT CODES
- ADJUST EXISTING ELECTRICAL CONDUIT, CONDENSATE AND UTILITY LINES AS REQUIRED FOR NEW ROOF HEIGHT. PROVIDE NEW DURA BLOK SUPPORTS - TYPICAL - SEE SPECIFICATIONS.
- REMOVE EXISTING LOW VOLTAGE WIRE AND REINSTALL AFTER ROOF REPLACEMENT
- REMOVE AND PATCH ALL ABANDONED OPENINGS. NOTIFY ARCHITECT IF OPENING IS WIDER THAN 12" X 12"
- DEMO ALL ABANDONED PITCH PANS. CAP WATER AND POWER

TYPICAL DETAILS THROUGHOUT

10 AZ.1	ROOF TOP PIPE SUPPORT	14 AZ.1	PITCH POCKET
11 AZ.1	PRE MANUFACTURED SUPPORT CURB	15 AZ.1	PIPE PENETRATION
12 AZ.1	PASSIVE VENT / AIR INTAKE	16 AZ.1	COPING
13 AZ.1	EXPANSION JOINT	17 AZ.1	EXHAUST FAN

REFERENCE PLAN

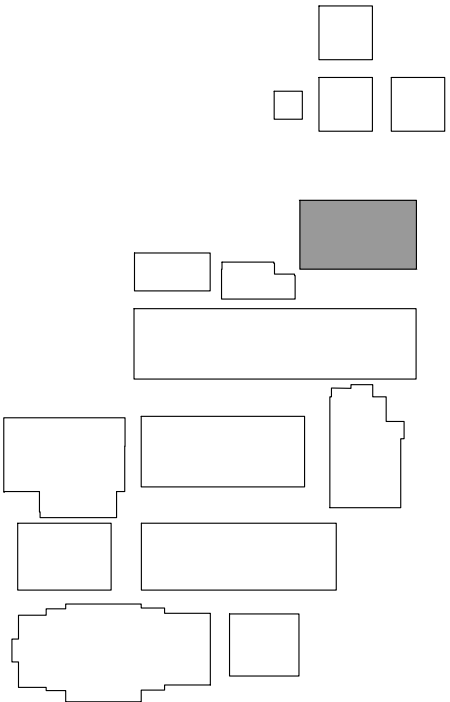

ROOFING IMPROVEMENTS
WASHINGTON ELEMENTARY SCHOOL DISTRICT
PALO VERDE MIDDLE SCHOOL
7502 NORTH 39th AVENUE
PHOENIX, ARIZONA 85051
SFB PROJECT NO.: BRG-DSGN-00415

PROJECT NO.: 21163
DRAWN BY: B. TUTTLE
CHECKED BY: L. LIND
DATE: 12/16/21

NO.	DATE	COMMENT	REVISIONS


COPYRIGHT
© 2021 - All designs, details, graphic and written material illustrated herein constitutes the original unpublished work of the Architect and may not be copied, published, reproduced electronically or by any other means, used on other projects for construction or recording without the written consent of the Architect. All rights reserved.

DRAWING TITLE

BUILDING E (SFB 1005)
ROOF PLAN

DRAWING NUMBER

A1.4

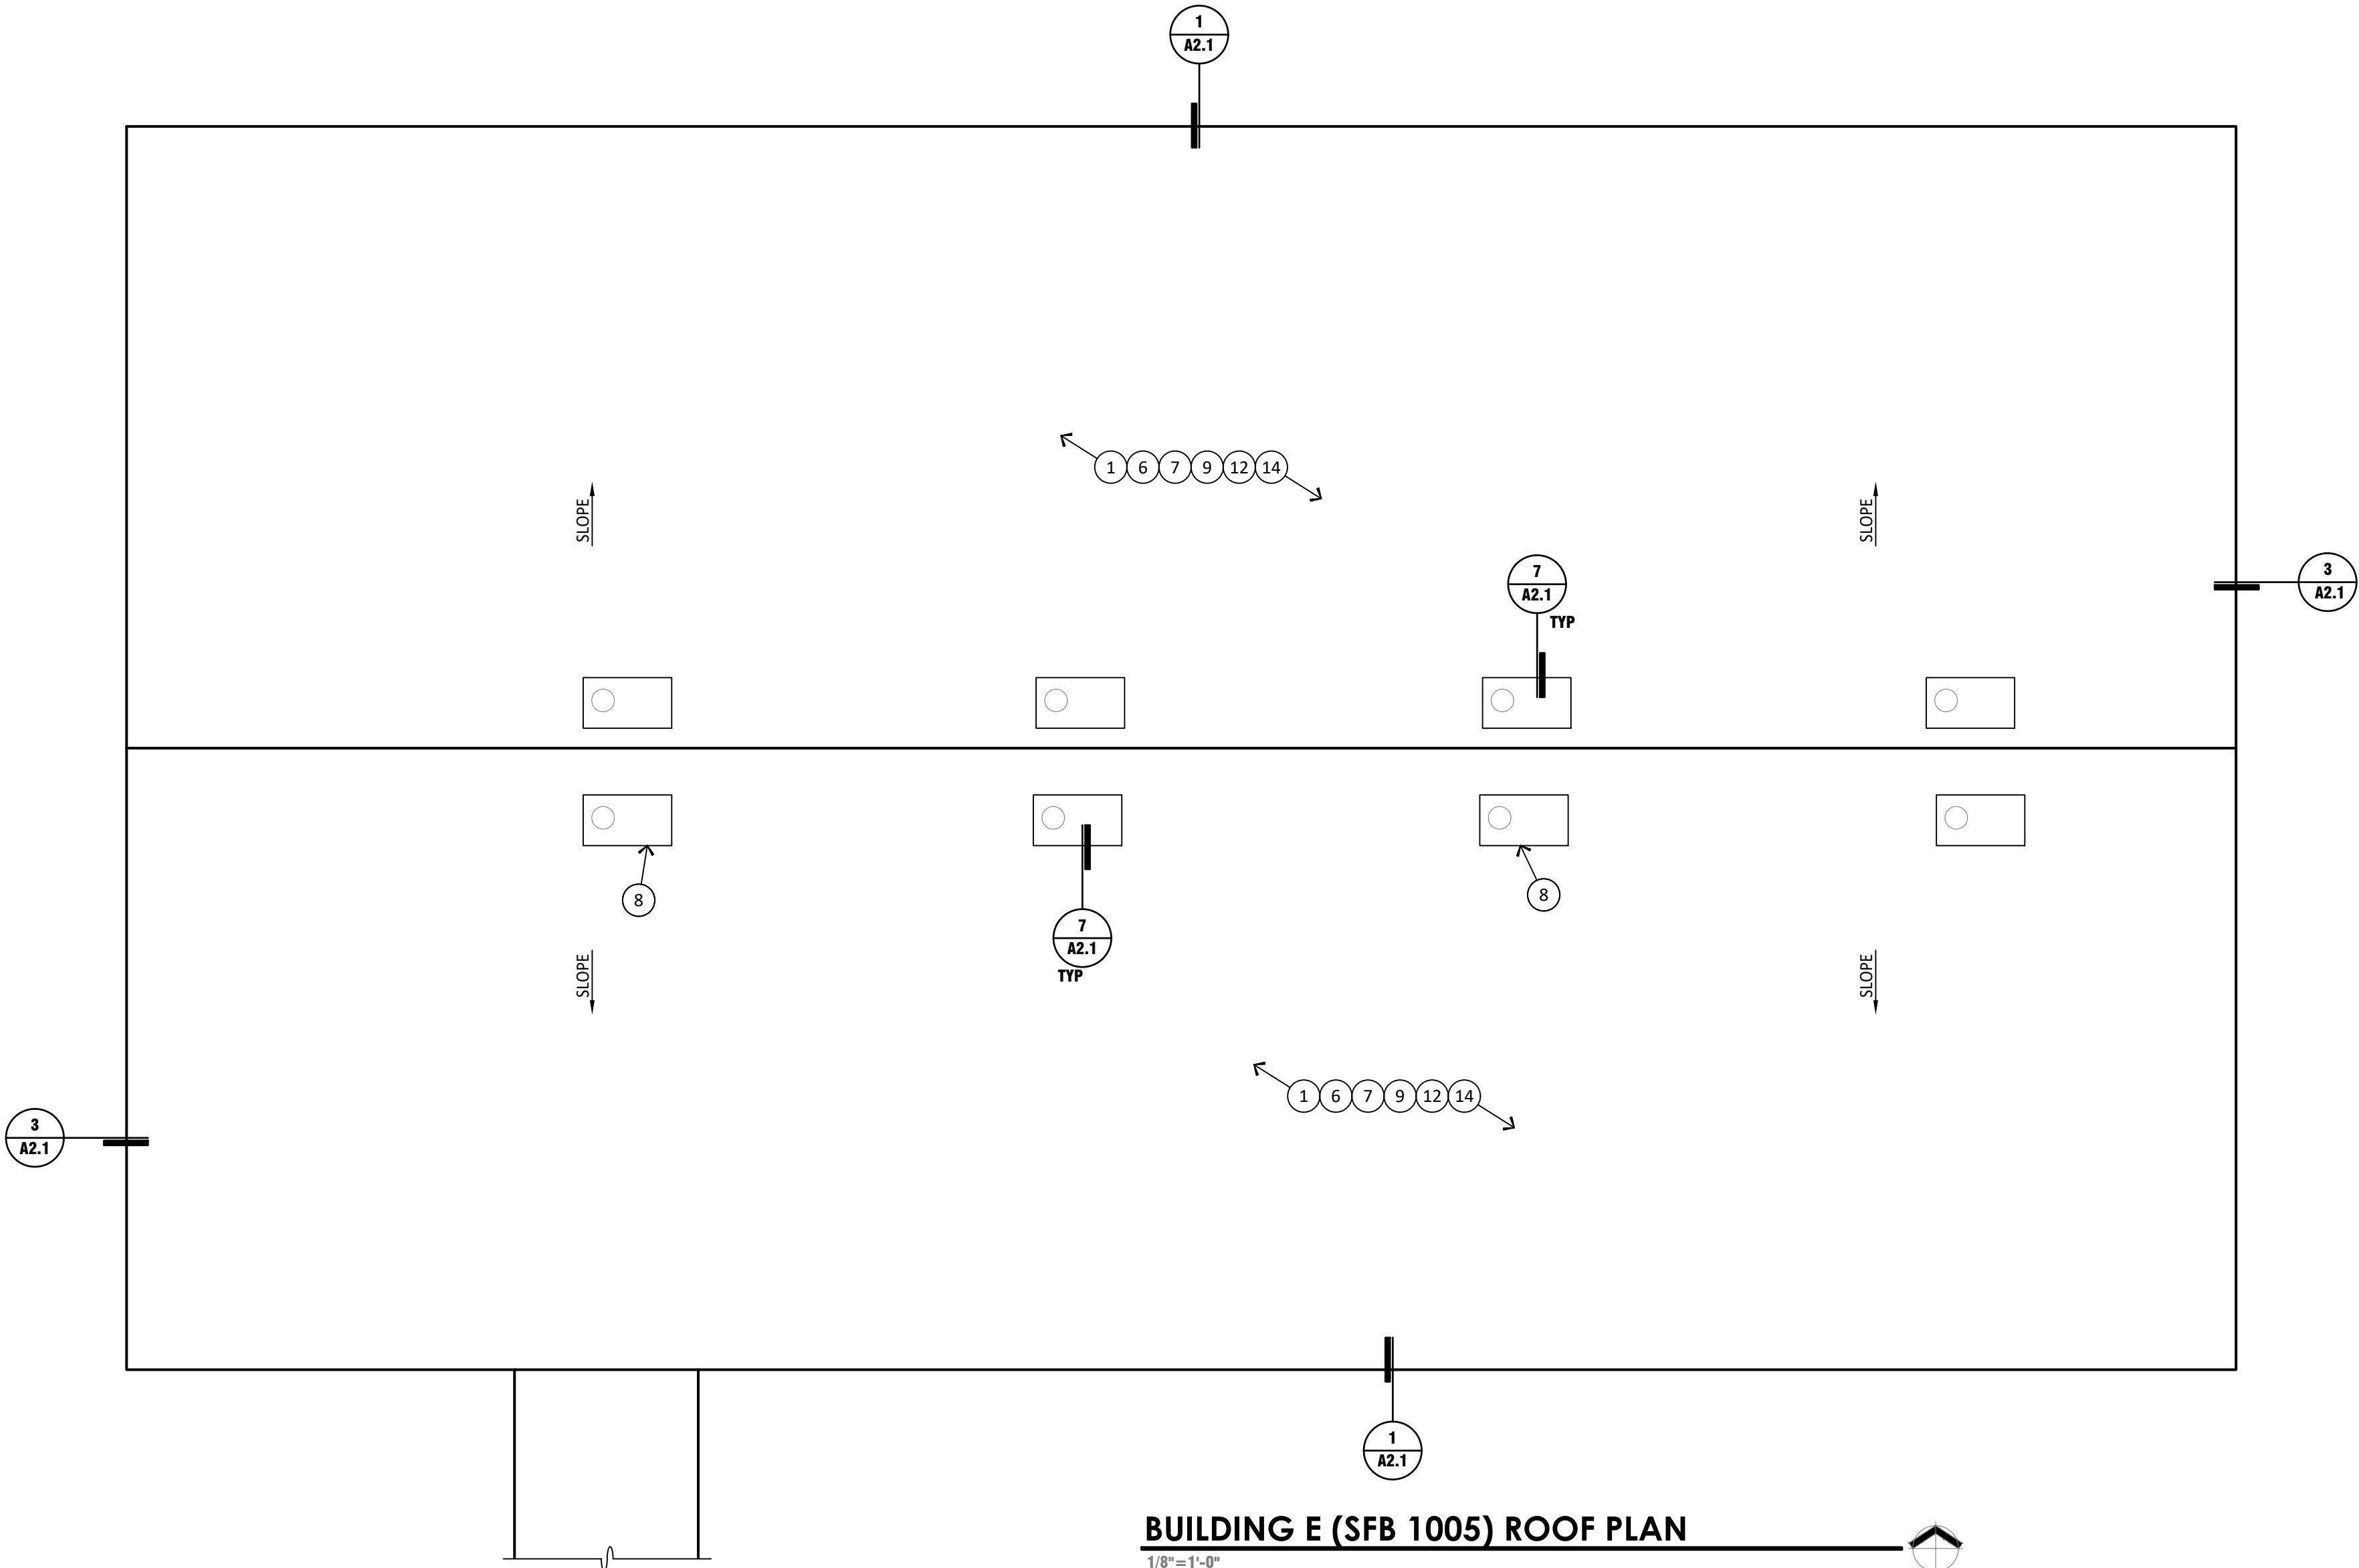



SFB PROJECT NO.: BRG-DSGN-00415

1. EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON SPLYWOOD OR TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
2. EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON METAL DECK. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
3. EXISTING ROOF CONSISTS OF TWO SYSTEMS. TPO ROOF OVER BUILT UP ROOF OVER STRUCTURAL DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
4. EXISTING ROOF CONSISTS OF TWO SYSTEMS. MODIFIED BUILT UP ROOF OVER BUILT UP ROOF OVER STRUCTURAL DECK. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
5. GRIND EXISTING FOAM TO DECK SO THAT THE SURFACE IS CLEAN AND LEVEL FOR NEW ROOF INSULATION
6. INSTALL NEW ROOFING ON COVER BOARD OVER RIGID INSULATION. TYPICAL - SEE SPECIFICATIONS.
7. REMOVE AND REPLACE ALL METAL FLASHINGS, REGLETS, AND COUNTER FLASHINGS - TYPICAL - SEE SPECIFICATIONS.
8. PROVIDE NEW FLASHING AT MECHANICAL CURBS. RAISE CURBS AS REQUIRED FOR MINIMUM 8" DRAIN CHIMING. ENSURE CONDENSATE LINES ARE PROPERLY SUPPORTED. REMOVE AND REPLACE DUCT SEALANTS. - SEE SPECIFICATIONS - TYPICAL
9. REMOVE EXISTING SLEEPERS UNDER CONDUIT AND PROVIDE NEW SLEEPERS UNDER CONDUIT ACTIVITIES. PROVIDE NEW DURA-BLOK SUPPORTS - TYPICAL
10. CLEAN EXISTING PARAPET WALLS ON ROOF SIDE. WRAP WALLS 4" 0" HIGH AND UNDER WITH KEE MEANING. PATCH CRACKS UP AND OVER NEW TREATED WOOD SLEEPERS
11. PROVIDE BLOCK FILM AND SEAL ROOF SIDE OF PARAPET WALL
12. REMOVE ALL CONSTRUCTION JOINT CAULKING FROM ROOF SIDE OF PARAPET AND REPLACE PER SPECIFICATIONS
13. PROVIDE NEW SUMPS AS REQUIRED AT EXISTING SLEEPERS. PROVIDE DRAIN LEADERS TO EXISTING DRAIN LEADERS AND ENSURE PROPER OPERATION - SEE SPECIFICATIONS - TYPICAL
14. RAISE DUCT AS REQUIRED FOR PROPER FLASHING - TYPICAL
15. PROVIDE NEW TREATED WOOD NAILERS AND METAL COPING CAPS PER SPECIFICATIONS
16. PROVIDE NEW SHEET METAL SCUPPERS
17. PROVIDE REPAIRS TO LAPS, SEAMS, RIVETS, PENETRATIONS AND OTHERS AS REQUIRED ON ROOF. PROVIDE SEALING AS REQUIRED - VERIFY IN SPECIFICATIONS



- A. CONTRACTOR TO REVIEW SPECIFICATIONS PRIOR TO BID. NOTIFY ARCHITECT OF ANY CONFLICTS.
- B. KEYNOTES ARE TYPICAL THROUGHOUT
- C. ANY INCIDENTAL MECHANICAL, PLUMBING OR ELECTRICAL ASSOCIATED WITH ROOFTOP EQUIPMENT SHALL BE PERFORMED BY PROPER LICENSED SUBCONTRACTORS UNDER THIS ROOFING CONTRACT - ALL WORK SHALL BE PERFORMED TO CURRENT CODES
- D. ADJUST EXISTING ELECTRICAL CONDUIT, CONDENSATE AND UTILITY LINES AS REQUIRED FOR NEW ROOF HEIGHT. PROVIDE NEW DURA BLOK SUPPORTS - TYPICAL - SEE SPECIFICATIONS.
- E. REMOVE EXISTING LOW VOLTAGE WIRE AND RESTART AFTER ROOF REPLACEMENT
- F. REMOVE AND PATCH ALL ABANDONED OPENINGS, NOTIFY ARCHITECT IF OPENING IS WIDER THAN 12" X 12"
- G. DEMO ALL ABANDONED PITCH PANS, CAP WATER AND POWER


10 A2.1	ROOF TOP PIPE SUPPORT	14 A2.1	PITCH POCKET
11 A2.1	PRE MANUFACTURED SUPPORT CURB	15 A2.1	PIPE PENETRATION
12 A2.1	PASSIVE VENT / AIR INTAKE	18 A2.1	COPING
13 A2.1	EXPANSION JOINT	19 A2.1	EXHAUST FAN

© 2021 - All designs, details, graphic and written material illustrated herein constitutes the original unpublished work of the Architect and may not be copied, published, reproduced electronically or by any other means, used on other projects for construction or recording without the written consent of the Architect. All rights reserved.

**BUILDING G (SFB 1007) AND
BUILDING H (SFB 1008)
ROOF PLANS**


A1.5



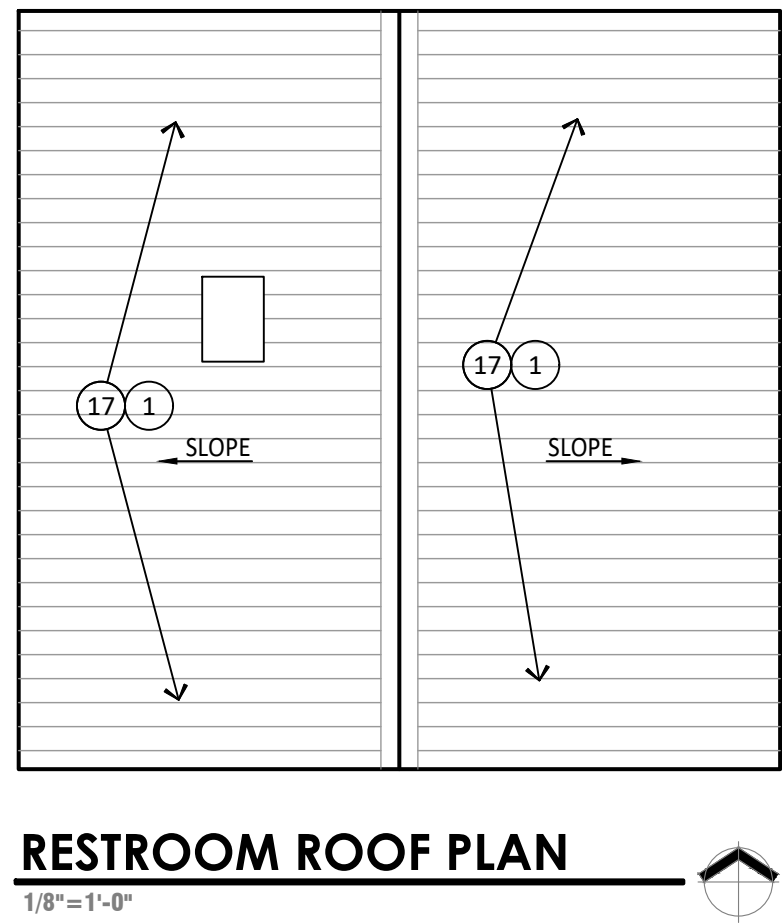


RESTROOM ROOF PLAN

1/8"=1'-0"

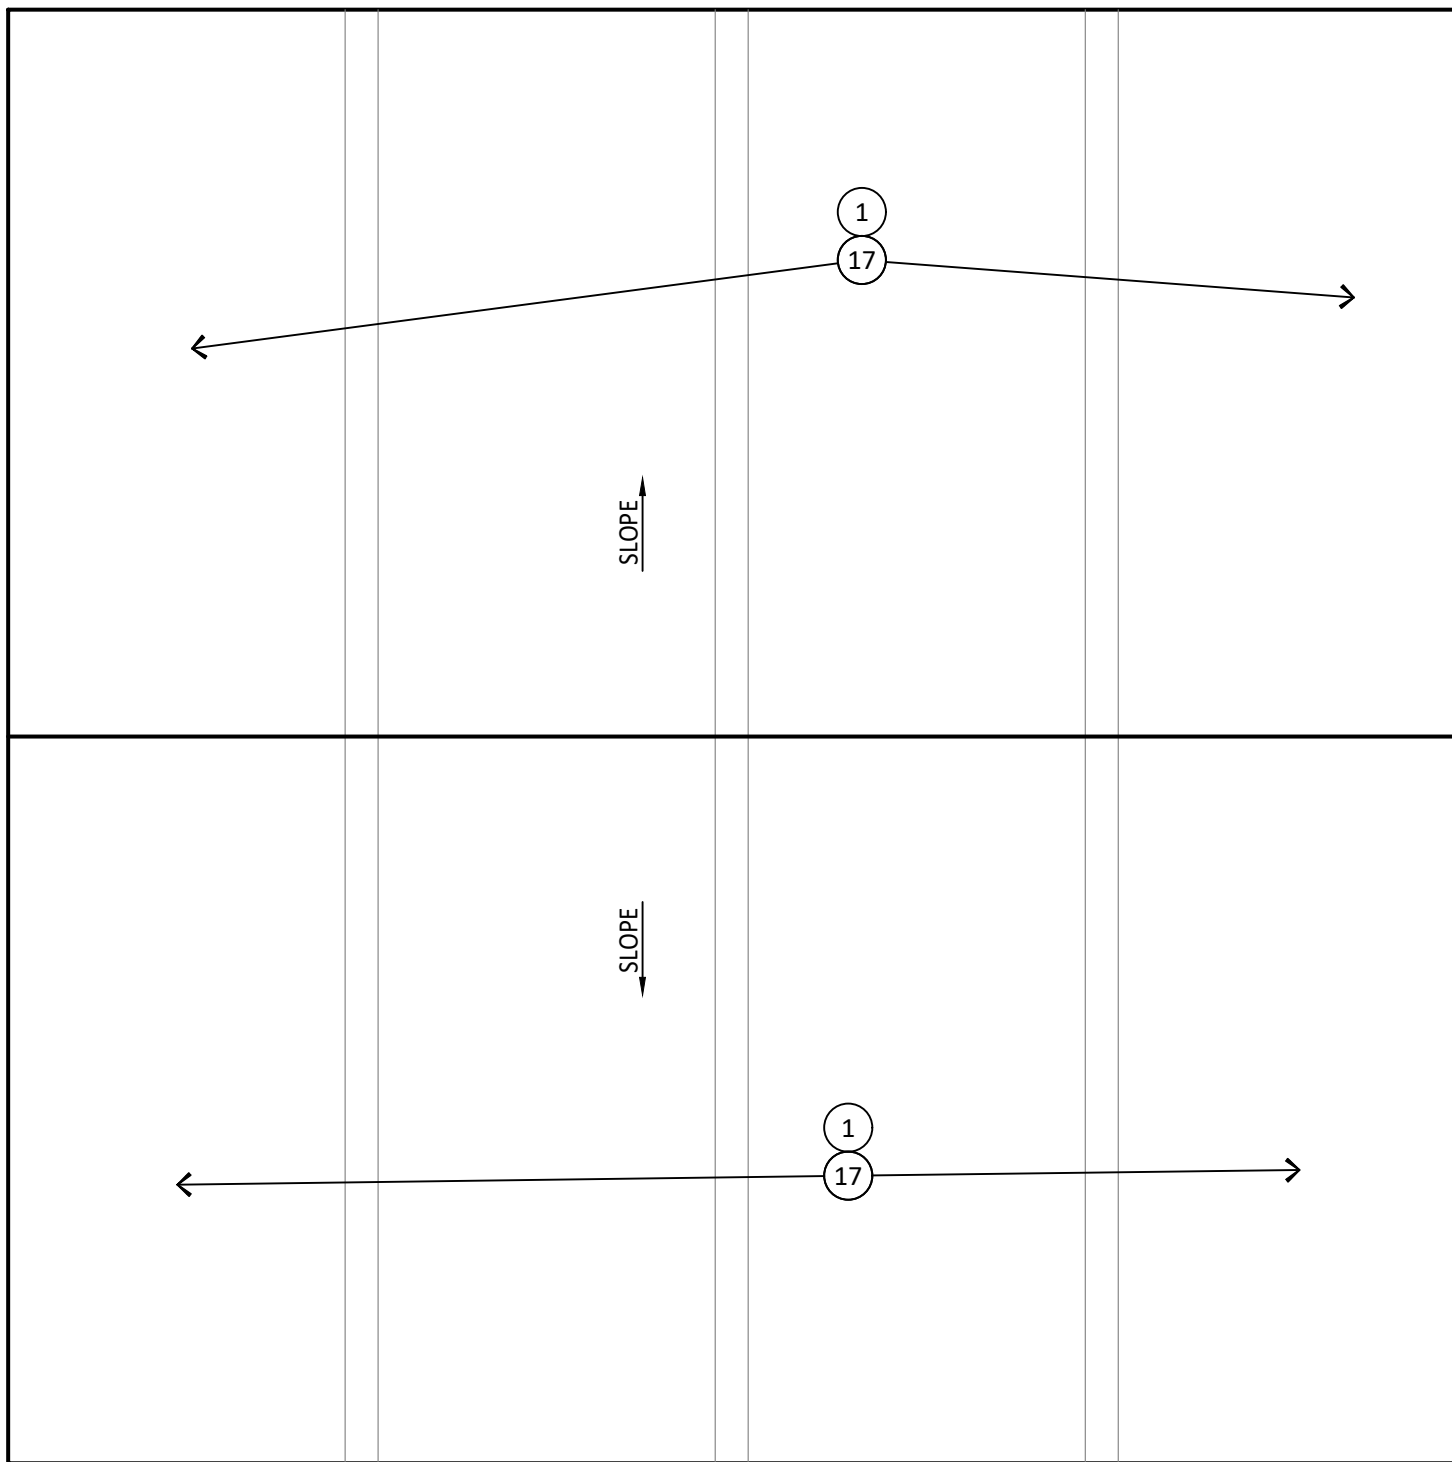


BUILDING A (SFB 1001) ROOF PLAN

1/8"=1'-0"

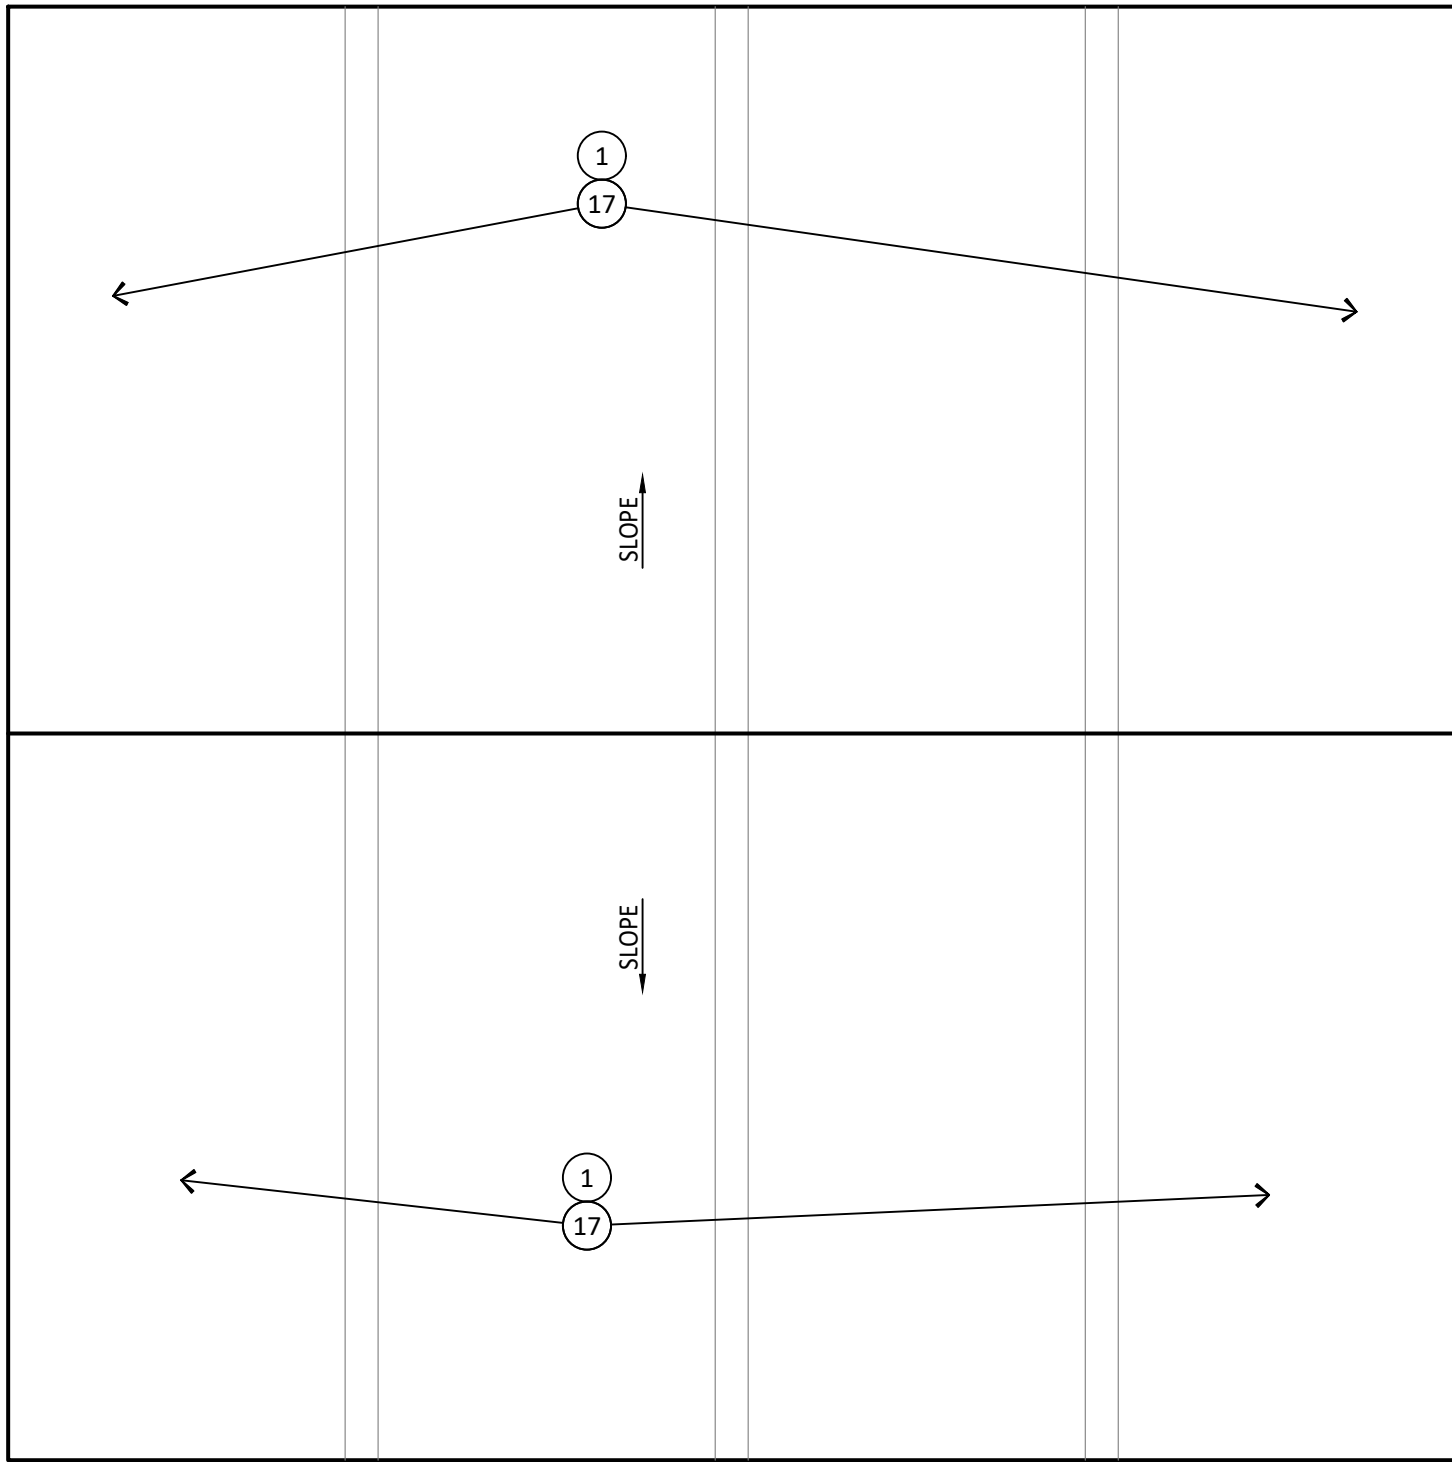

BUILDING A (SFB 1001) ROOF PLAN

1/8"=1'-0"

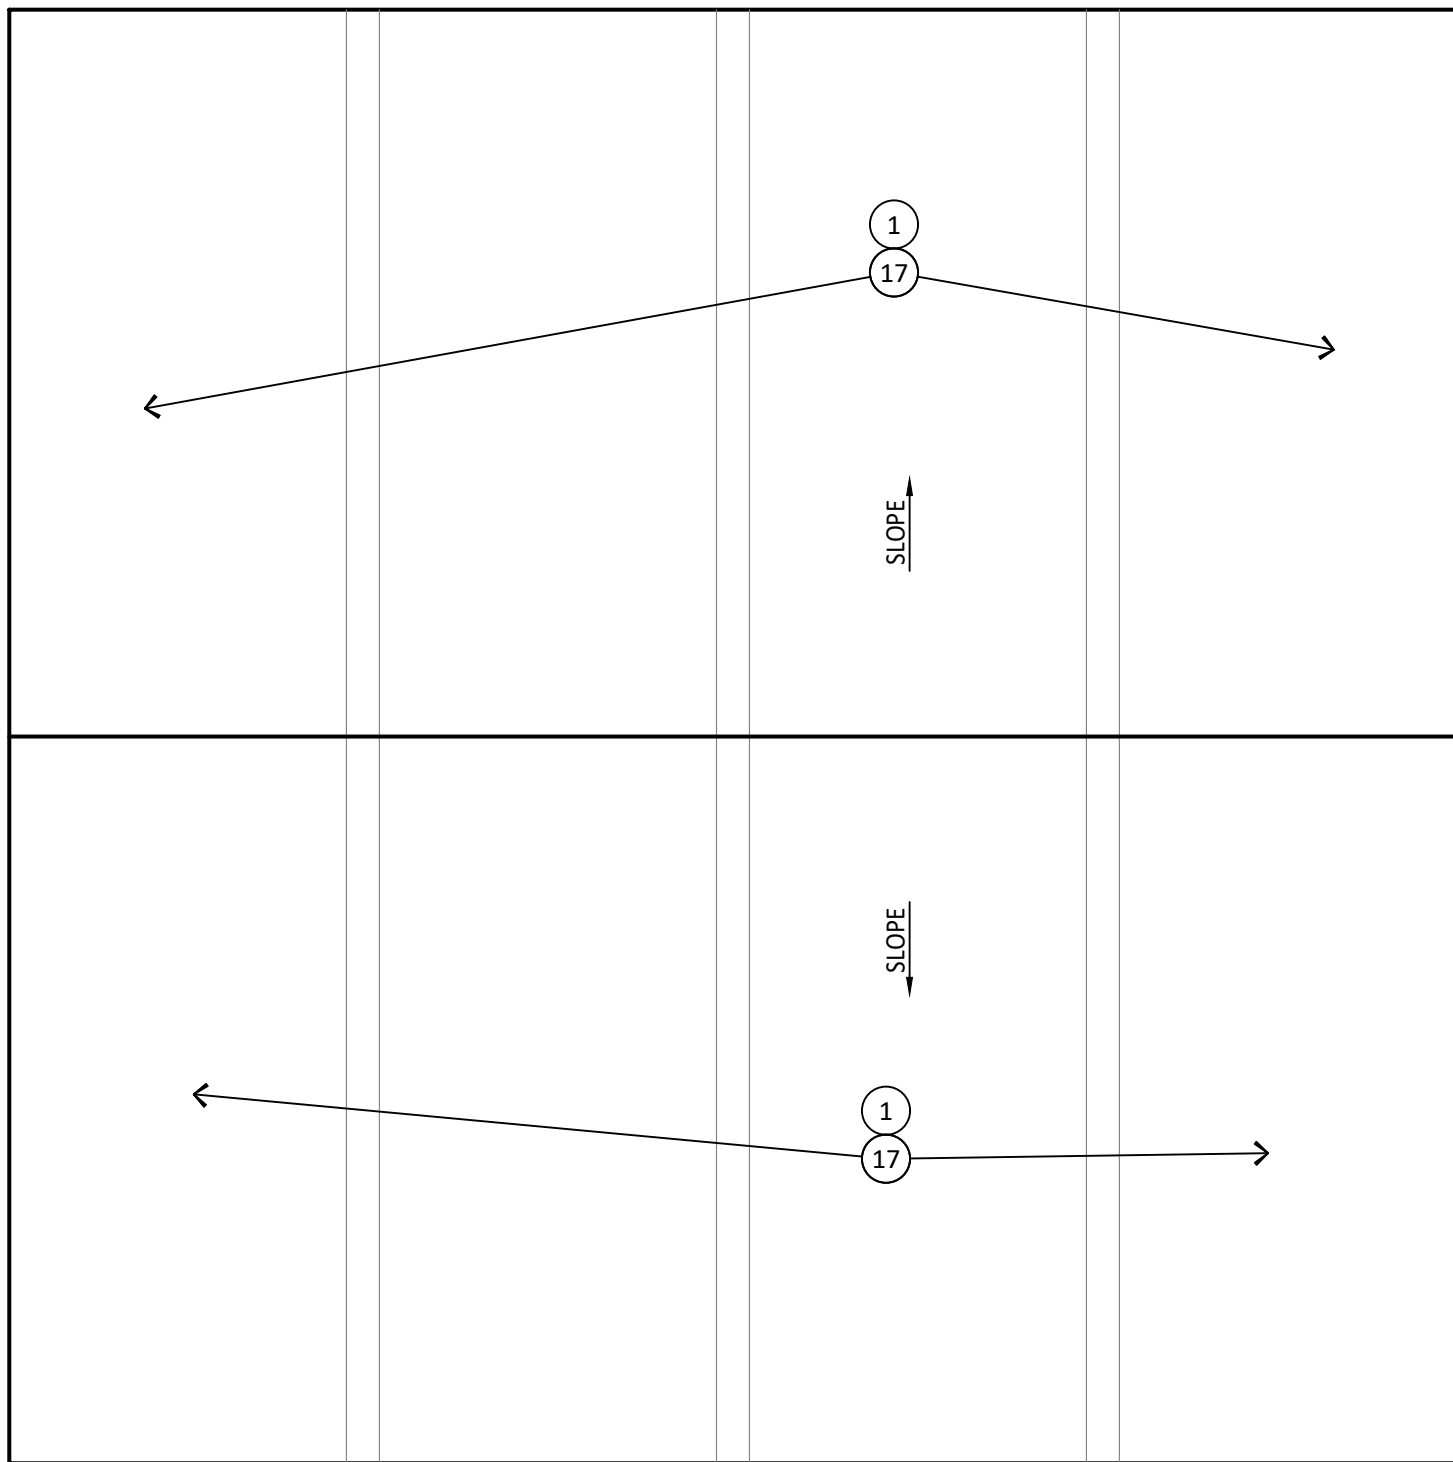

BUILDING A (SFB 1001) ROOF PLAN

1/8"=1'-0"



KEYED NOTES

- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON PLYWOOD OR TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON METAL DECK. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. TPO ROOF OVER BUILT UP ROOF OVER STRUCTURAL DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. MODIFIED BUILT UP ROOF OVER BUILT UP ROOF ON TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- GRIND EXISTING FOAM TO DECK SO THAT THE SURFACE IS CLEAN AND LEVEL FOR NEW ROOF INSTALLATION
- INSTALL NEW ROOFING ON COVER BOARD OVER RIGID INSULATION. TYPICAL - SEE SPECIFICATIONS.
- REMOVE AND REPLACE ALL METAL FLASHINGS, REGLETS, AND COUNTER FLASHINGS - TYPICAL - SEE SPECIFICATIONS.
- PROVIDE NEW FLASHING AT MECHANICAL CURBS. RAISE CURBS AS REQUIRED FOR MINIMUM 8" FLASHING. ENSURE CONDENSATE LINES ARE PROPERLY SUPPORTED. REMOVE AND REPLACE DUCT SEALANTS - SEE SPECIFICATIONS - TYPICAL
- REMOVE EXISTING SLEEPERS UNDER CONDUIT AND PIPE. PROTECT DURING CONSTRUCTION ACTIVITIES. PROVIDE NEW DURA-BLOK SUPPORTS - TYPICAL
- CLEAN EXISTING PARAPET WALLS ON ROOF SIDE. WRAP WALLS 4'-0" HIGH AND UNDER WITH KEE MEMBRANE THAT EXTENDS UP AND OVER NEW TREATED WOOD SLEEPERS.
- PROVIDE BLOCK FILL AND SEAL ROOF SIDE OF PARAPET WALL
- REMOVE ALL CONSTRUCTION JOINT CAULKING FROM ROOF SIDE OF PARAPET AND REPLACE PER SPECIFICATIONS
- PROVIDE NEW SUMPS AS REQUIRED AT EXISTING SCUPPER AND DRAIN LOCATIONS. CLEAR ALL DRAIN LEADERS AND ENSURE PROPER OPERATION - SEE SPECIFICATIONS - TYPICAL
- RAISE DUCT AS REQUIRED FOR PROPER FLASHING - TYPICAL
- PROVIDE NEW TREATED WOOD NAILERS AND METAL COPING CAPS PER SPECIFICATIONS
- PROVIDE NEW SHEET METAL SCUPPERS
- PROVIDE REPAIRS TO LAPS, SEAMS, RIVETS, PENETRATIONS AND OTHERS AS REQUIRED ON METAL ROOFS. SEAL AS REQUIRED - VERIFY IN FIELD. SEE SPECIFICATIONS


GENERAL NOTES

- CONTRACTOR TO REVIEW SPECIFICATIONS PRIOR TO BID. NOTIFY ARCHITECT OF ANY CONFLICTS.
- KEYNOTES ARE TYPICAL THROUGHOUT
- ANY INCIDENTAL MECHANICAL, PLUMBING OR ELECTRICAL ASSOCIATED WITH ROOFTOP EQUIPMENT SHALL BE PERFORMED BY PROPER LICENSED SUBCONTRACTORS UNDER THIS ROOFING CONTRACT - ALL WORK SHALL BE PERFORMED TO CURRENT CODES
- ADJUST EXISTING ELECTRICAL CONDUIT, CONDENSATE AND UTILITY LINES AS REQUIRED FOR NEW ROOF HEIGHT. PROVIDE NEW DURA BLOK SUPPORTS - TYPICAL - SEE SPECIFICATIONS.
- REMOVE EXISTING LOW VOLTAGE WIRE AND REINSTALL AFTER ROOF REPLACEMENT
- REMOVE AND PATCH ALL ABANDONED OPENINGS. NOTIFY ARCHITECT IF OPENING IS WIDER THAN 12" X 12"
- DEMO ALL ABANDONED PITCH PANS. CAP WATER AND POWER

TYPICAL DETAILS THROUGHOUT

10 A2.1	ROOF TOP PIPE SUPPORT	14 A2.1	PITCH POCKET
11 A2.1	PRE MANUFACTURED SUPPORT CURB	15 A2.1	PIPE PENETRATION
12 A2.1	PASSIVE VENT / AIR INTAKE	16 A2.1	COPING
13 A2.1	EXPANSION JOINT	17 A2.1	EXHAUST FAN

REFERENCE PLAN

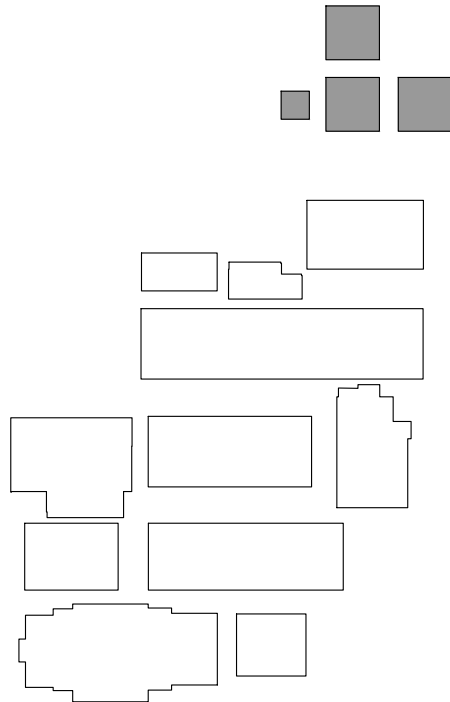

ROOFING IMPROVEMENTS
WASHINGTON ELEMENTARY SCHOOL DISTRICT
PALO VERDE MIDDLE SCHOOL
7502 NORTH 39th AVENUE
PHOENIX, ARIZONA 85051
SFB PROJECT NO.: BRG-DSGN-00415

PROJECT NO.: 21163
DRAWN BY: B. TUTTLE
CHECKED BY: L. LIND
DATE: 12/16/21


NO.	DATE	COMMENT	REVISIONS

COPYRIGHT
© 2021 - All designs, details, graphic and written material illustrated herein constitutes the original unpublished work of the Architect and may not be copied, published, reproduced electronically or by any other means, used on other projects for construction or recording without the written consent of the Architect. All rights reserved.

DRAWING TITLE
BUILDING A (SFB 1014) AND RESTROOM BUILDING ROOF PLANS

DRAWING NUMBER

A1.6

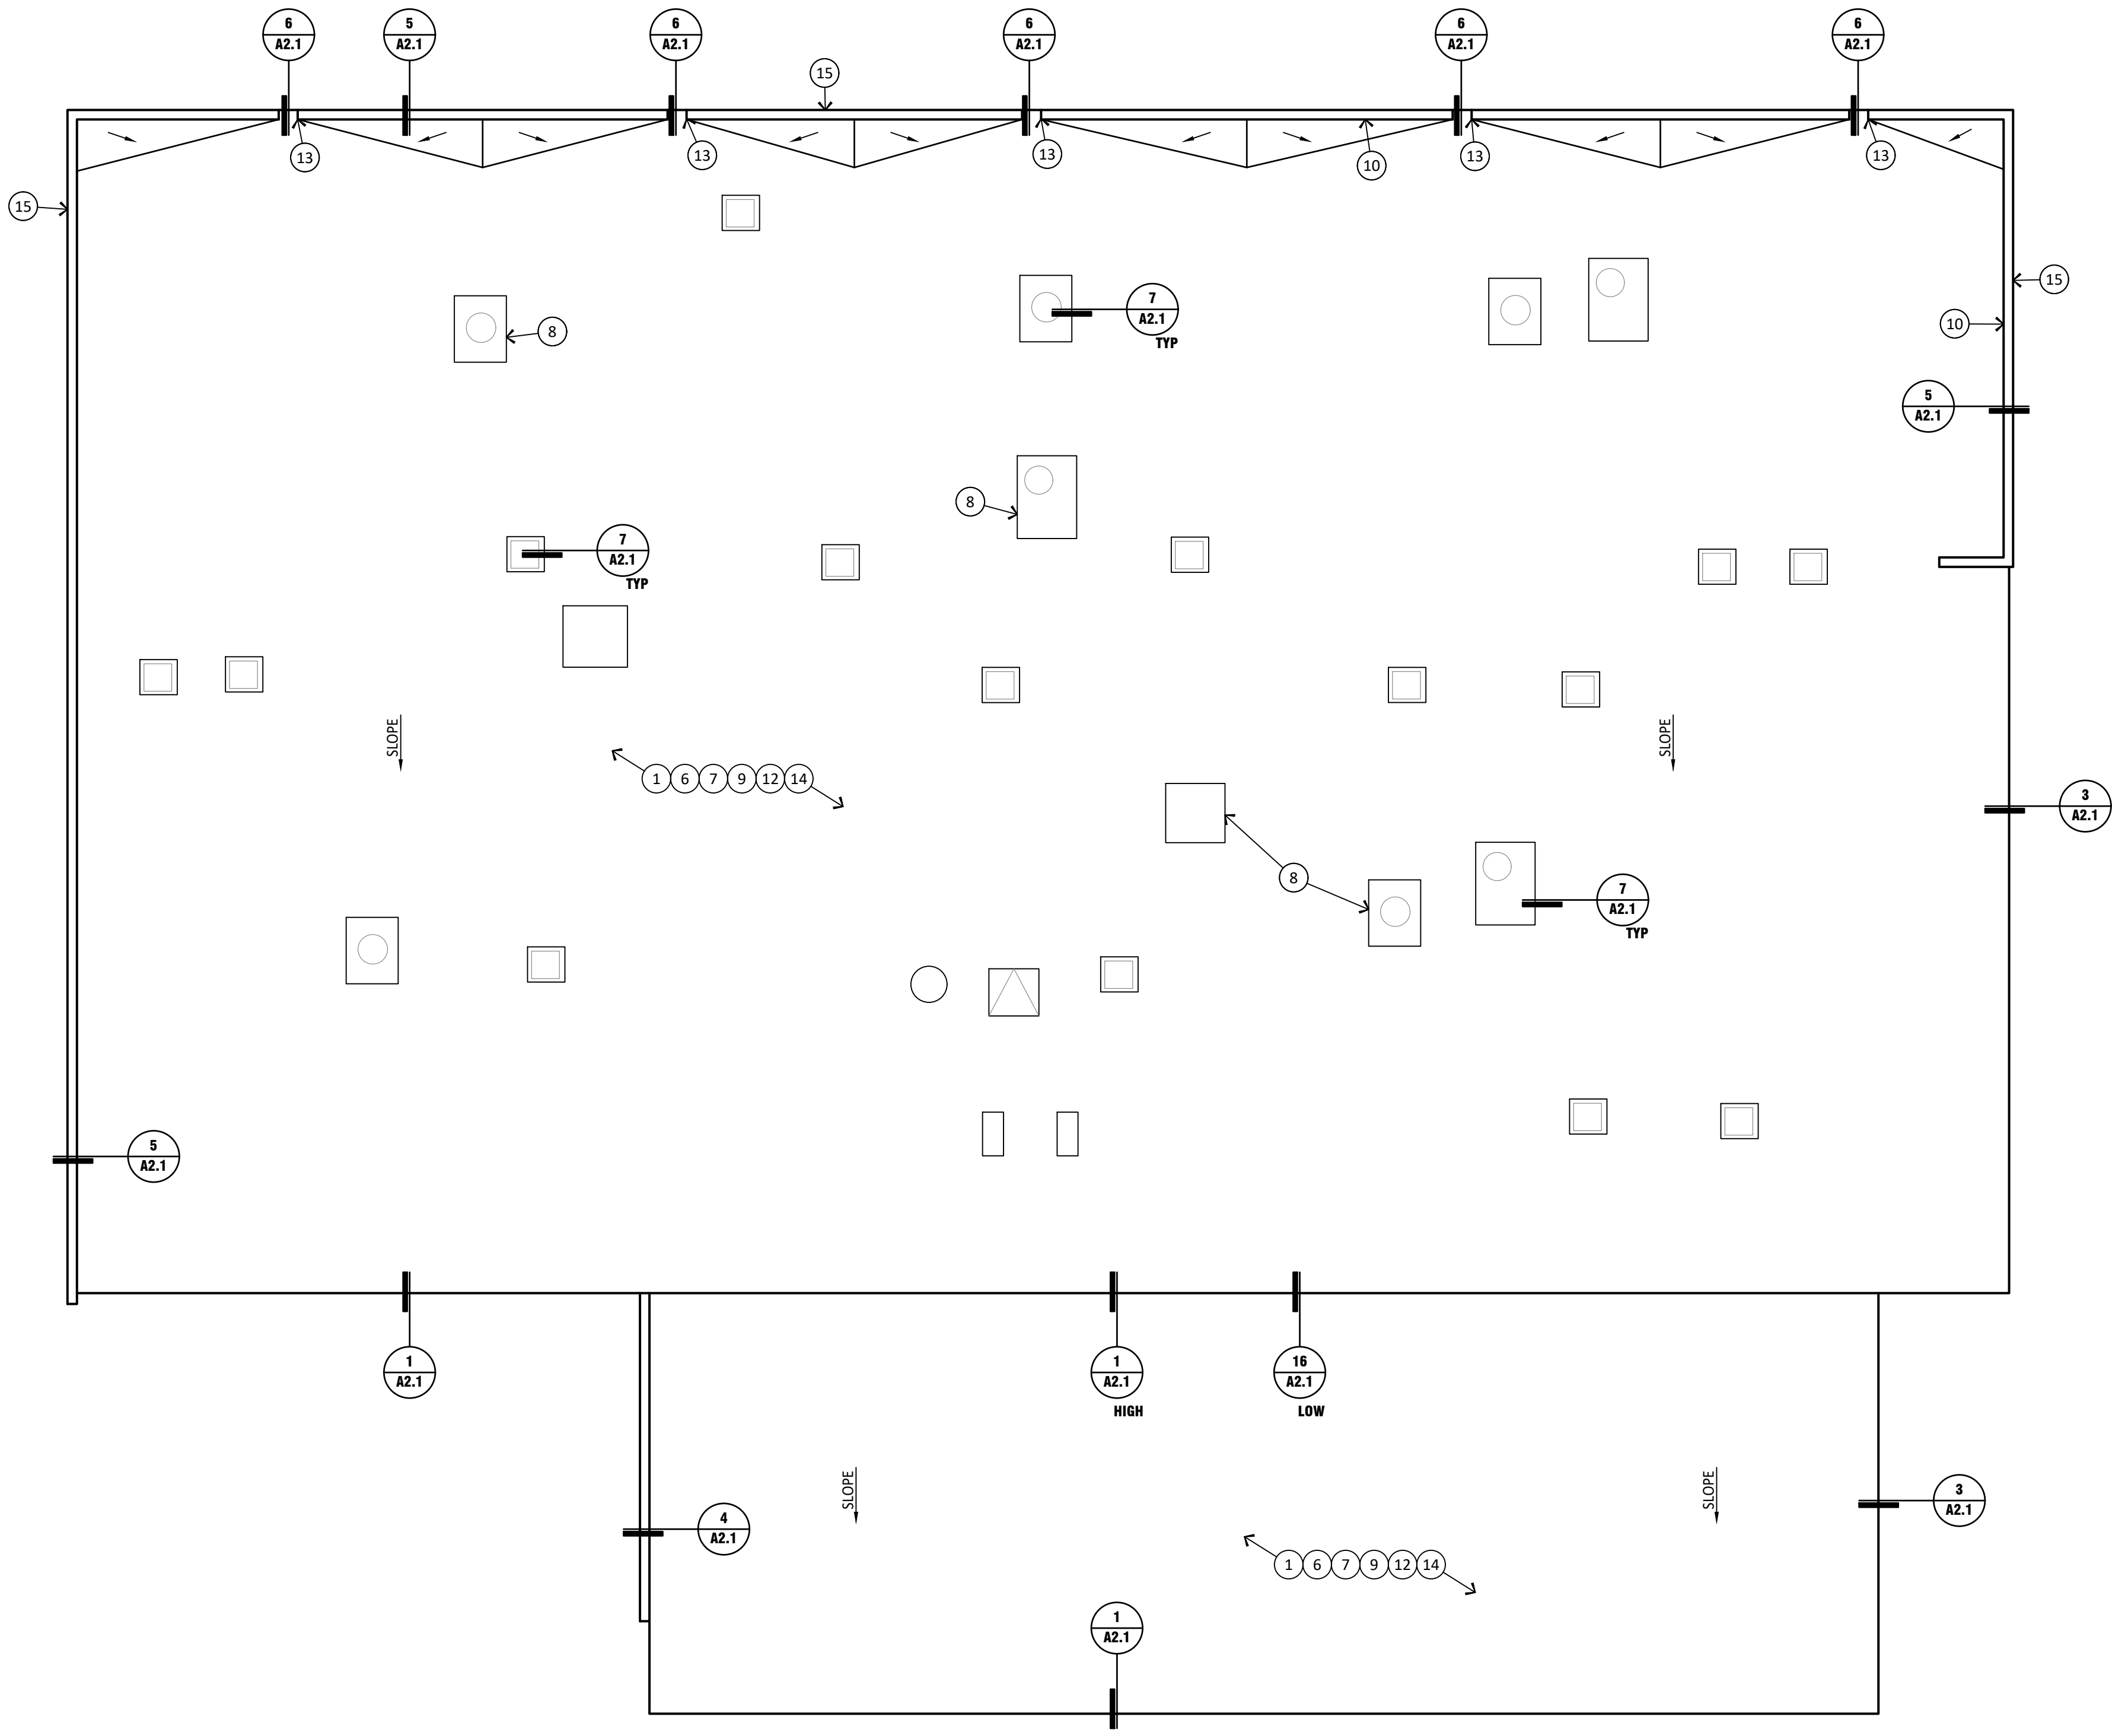

BUILDING L (SFB 1018) ROOF PLAN
1/8"=1'-0"

KEYED NOTES

- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON PLYWOOD OR TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON METAL DECK. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. TPO ROOF OVER BUILT UP ROOF OVER STRUCTURAL DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. MODIFIED BUILT UP ROOF OVER BUILT UP ROOF ON TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- GRIND EXISTING FOAM TO DECK SO THAT THE SURFACE IS CLEAN AND LEVEL FOR NEW ROOF INSTALLATION
- INSTALL NEW ROOFING ON COVER BOARD OVER RIGID INSULATION. TYPICAL - SEE SPECIFICATIONS.
- REMOVE AND REPLACE ALL METAL FLASHINGS, REGLETS, AND COUNTER FLASHINGS - TYPICAL - SEE SPECIFICATIONS.
- PROVIDE NEW FLASHING AT MECHANICAL CURBS. RAISE CURBS AS REQUIRED FOR MINIMUM 8" FLASHING. ENSURE CONDENSATE LINES ARE PROPERLY SUPPORTED. REMOVE AND REPLACE DUCT SEALANTS. - SEE SPECIFICATIONS - TYPICAL
- REMOVE EXISTING SLEEPERS UNDER CONDUIT AND PIPE. PROTECT DURING CONSTRUCTION ACTIVITIES. PROVIDE NEW DURA-BLOK SUPPORTS - TYPICAL
- CLEAN EXISTING PARAPET WALLS ON ROOF SIDE. WRAP WALLS 4'-0" HIGH AND UNDER WITH KEE MEMBRANE THAT EXTENDS UP AND OVER NEW TREATED WOOD SLEEPERS.
- PROVIDE BLOCK FILL AND SEAL ROOF SIDE OF PARAPET WALL
- REMOVE ALL CONSTRUCTION JOINT CAULKING FROM ROOF SIDE OF PARAPET AND REPLACE PER SPECIFICATIONS
- PROVIDE NEW SUMPS AS REQUIRED AT EXISTING SCUPPER AND DRAIN LOCATIONS. CLEAR ALL DRAIN LEADERS AND ENSURE PROPER OPERATION - SEE SPECIFICATIONS - TYPICAL
- RAISE DUCT AS REQUIRED FOR PROPER FLASHING - TYPICAL
- PROVIDE NEW TREATED WOOD NAILERS AND METAL COPING CAPS PER SPECIFICATIONS
- PROVIDE NEW SHEET METAL SCUPPERS
- PROVIDE REPAIRS TO LAPS, SEAMS, RIVETS, PENETRATIONS AND OTHERS AS REQUIRED ON METAL ROOFS. SEAL AS REQUIRED - VERIFY IN FIELD. SEE SPECIFICATIONS


GENERAL NOTES

- CONTRACTOR TO REVIEW SPECIFICATIONS PRIOR TO BID. NOTIFY ARCHITECT OF ANY CONFLICTS.
- KEYNOTES ARE TYPICAL THROUGHOUT
- ANY INCIDENTAL MECHANICAL, PLUMBING OR ELECTRICAL ASSOCIATED WITH ROOFTOP EQUIPMENT SHALL BE PERFORMED BY PROPER LICENSED SUBCONTRACTORS UNDER THIS ROOFING CONTRACT - ALL WORK SHALL BE PERFORMED TO CURRENT CODES
- ADJUST EXISTING ELECTRICAL CONDUIT, CONDENSATE AND UTILITY LINES AS REQUIRED FOR NEW ROOF HEIGHT. PROVIDE NEW DURA BLOK SUPPORTS - TYPICAL - SEE SPECIFICATIONS.
- REMOVE EXISTING LOW VOLTAGE WIRE AND REINSTALL AFTER ROOF REPLACEMENT
- REMOVE AND PATCH ALL ABANDONED OPENINGS. NOTIFY ARCHITECT IF OPENING IS WIDER THAN 12" X 12"
- DEMO ALL ABANDONED PITCH PANS. CAP WATER AND POWER

TYPICAL DETAILS THROUGHOUT

10 A2.1	ROOF TOP PIPE SUPPORT	14 A2.1	PITCH POCKET
11 A2.1	PRE MANUFACTURED SUPPORT CURB	15 A2.1	PIPE PENETRATION
12 A2.1	PASSIVE VENT / AIR INTAKE	18 A2.1	COPING
13 A2.1	EXPANSION JOINT	19 A2.1	EXHAUST FAN

REFERENCE PLAN

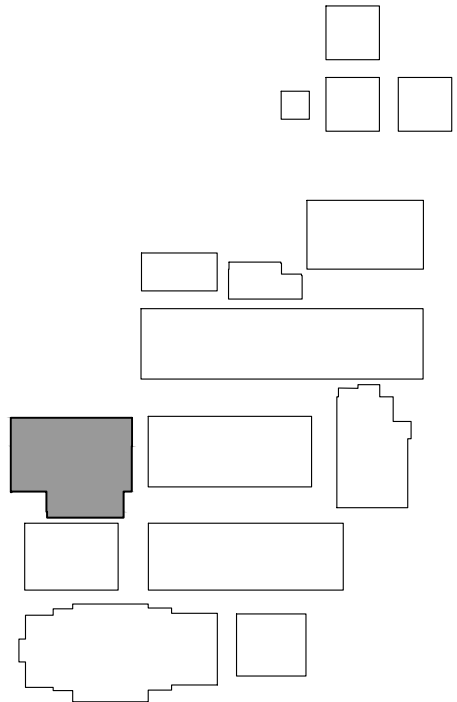

ARCHITECTURE - FACILITIES - C.M.
5229 N. 7th AVE. #101
PHOENIX, ARIZONA 85013
602.347.5226

WASHINGTON ELEMENTARY
SCHOOL DISTRICT

ROOFING IMPROVEMENTS

WASHINGTON ELEMENTARY SCHOOL DISTRICT

PALO VERDE MIDDLE SCHOOL

7502 NORTH 39th AVENUE
PHOENIX, ARIZONA 85051

SFB PROJECT NO.: BRG-DSGN-00415

PROJECT NO.: 21163

DRAWN BY: B. TUTTLE

CHECKED BY: L. LIND

DATE: 12/16/21

NO.	DATE	COMMENT	REVISIONS

COPYRIGHT

© 2021 - All designs, details, graphic and written material illustrated herein constitutes the original unpublished work of the Architect and may not be copied, published, reproduced electronically or by any other means, used on other projects for construction or recording without the written consent of the Architect. All rights reserved.


DRAWING TITLE

BUILDING L (SFB 1018)

ROOF PLAN

DRAWING NUMBER

A1.7

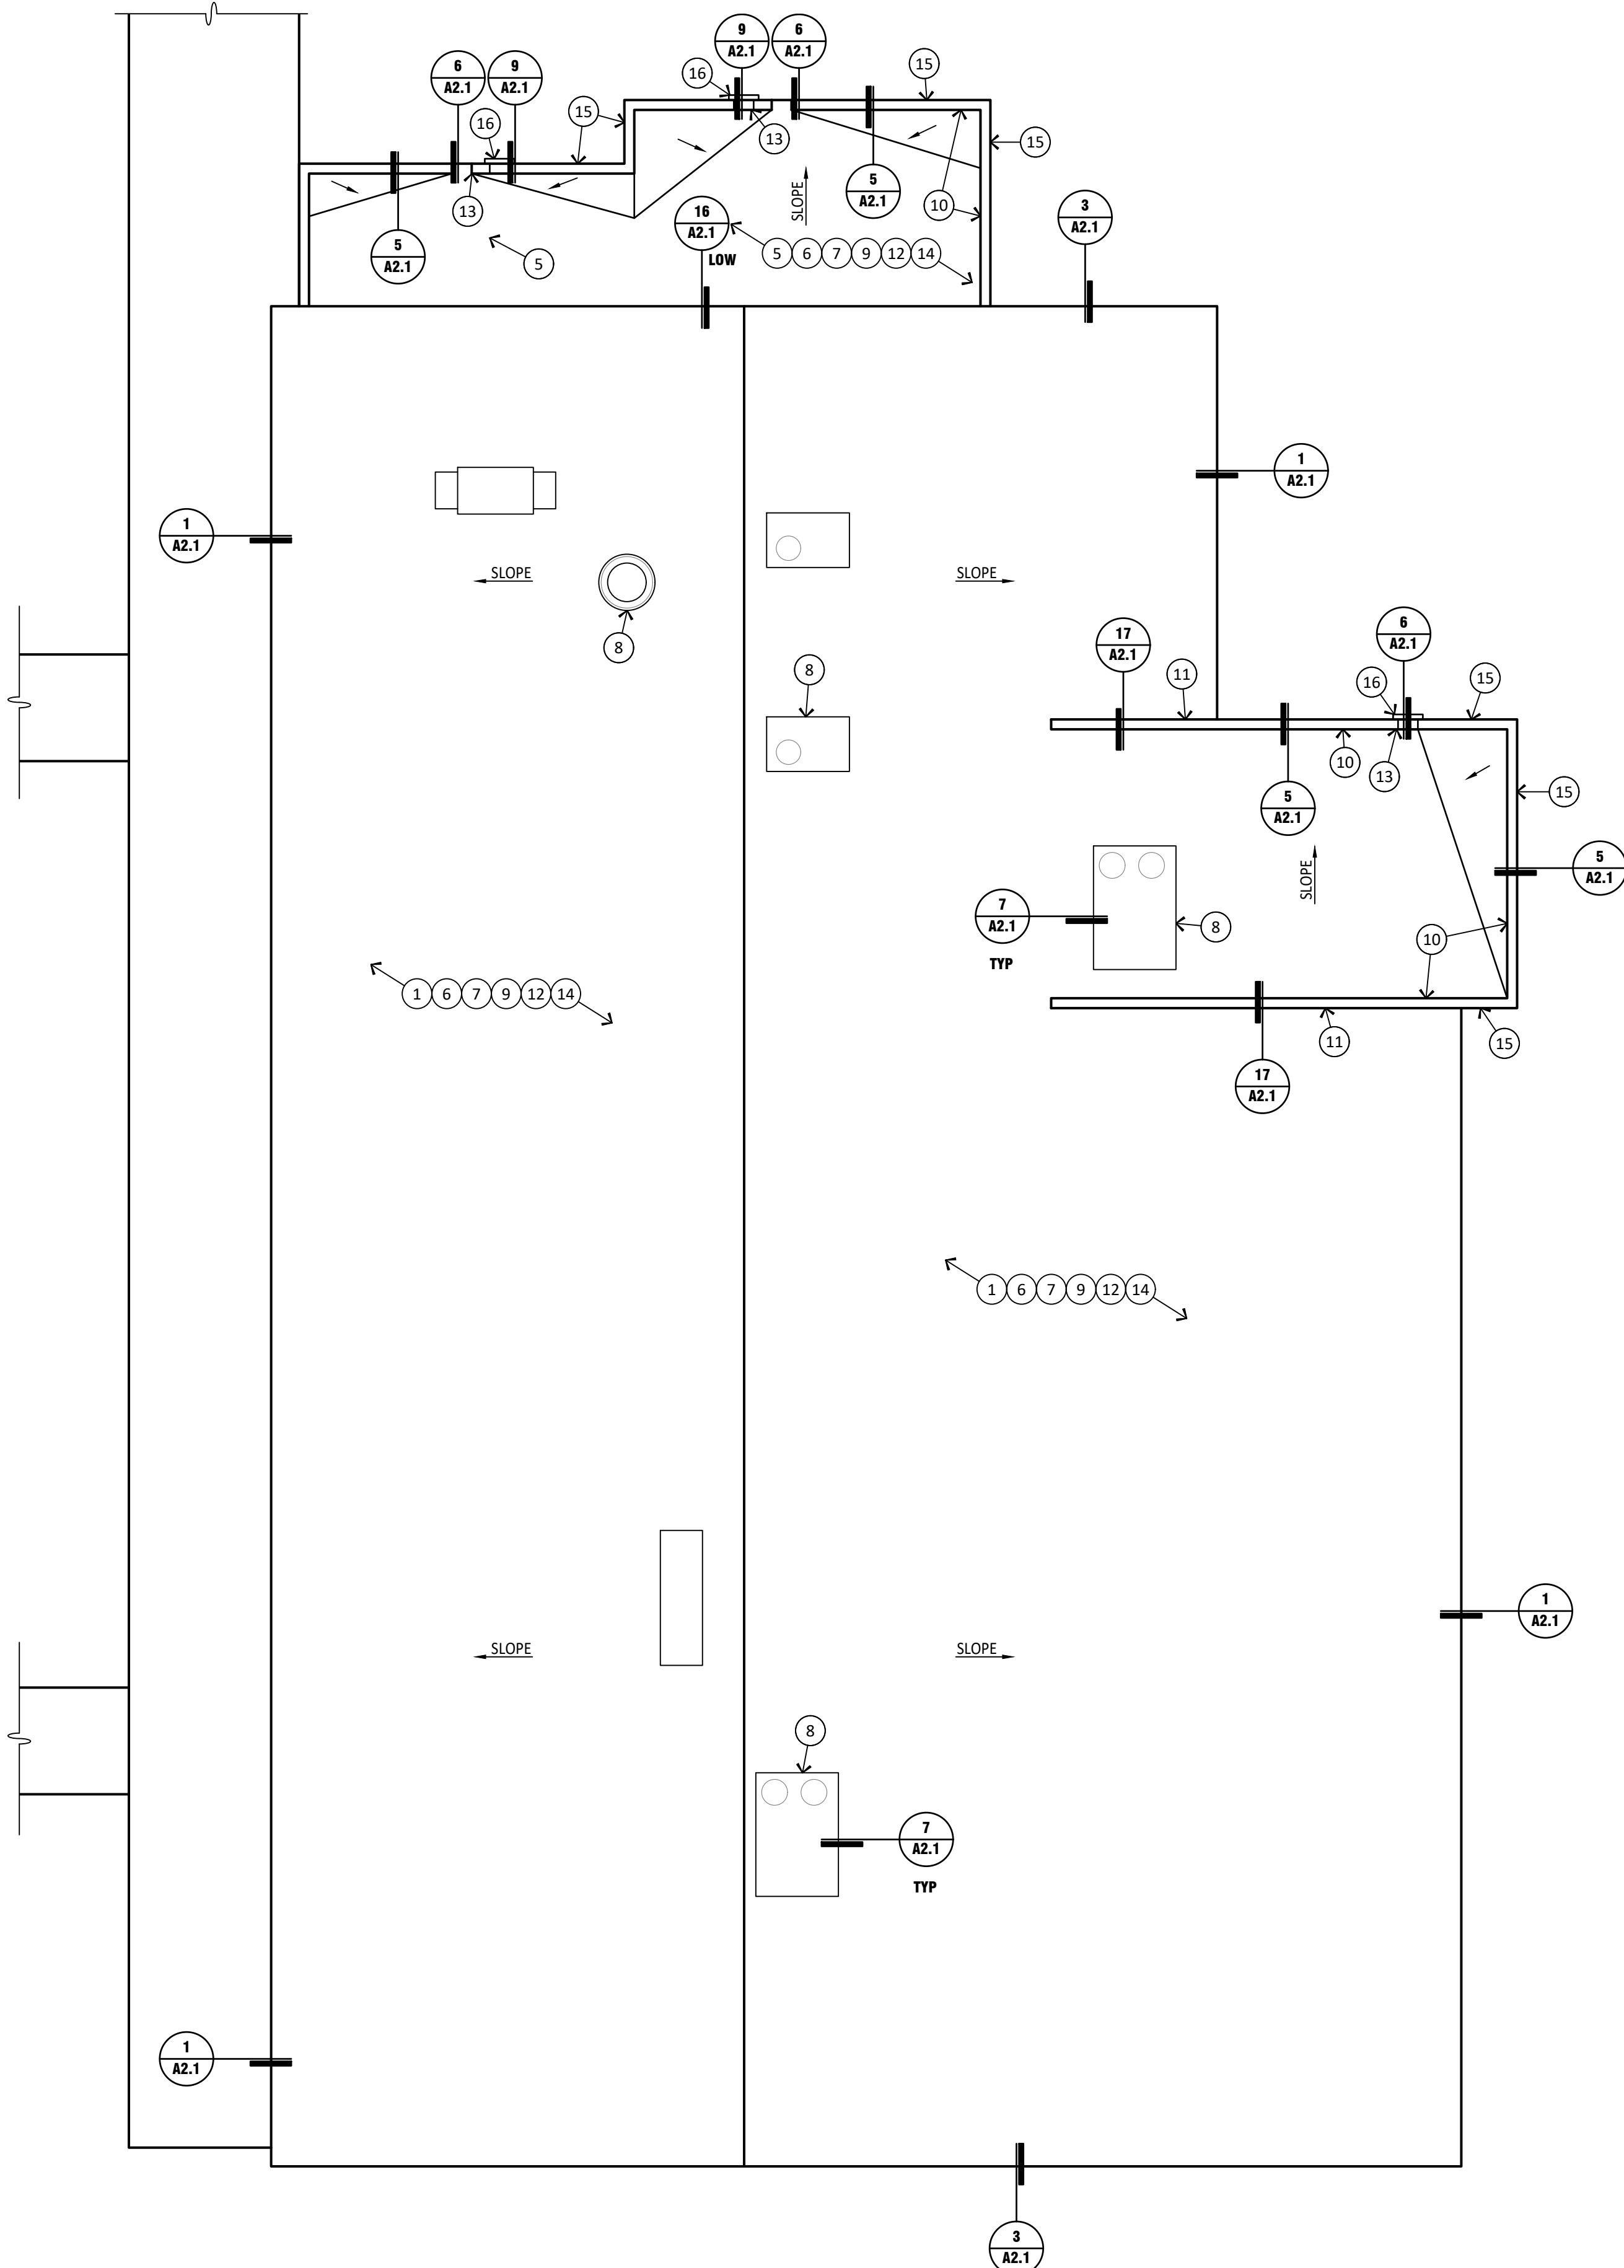

BUILDING I (SFB 10019) AND BUILDING M (SFB 1019) ROOF PLANS

1/8"=1'-0"

KEYED NOTES

- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON PLYWOOD OR TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON METAL DECK. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. TPO ROOF OVER BUILT UP ROOF OVER STRUCTURAL DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. MODIFIED BUILT UP ROOF OVER BUILT UP ROOF ON TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- GRIND EXISTING FOAM TO DECK SO THAT THE SURFACE IS CLEAN AND LEVEL FOR NEW ROOF INSTALLATION
- INSTALL NEW ROOFING ON COVER BOARD OVER RIGID INSULATION. TYPICAL - SEE SPECIFICATIONS.
- REMOVE AND REPLACE ALL METAL FLASHINGS, REGLETS, AND COUNTER FLASHINGS - TYPICAL - SEE SPECIFICATIONS.
- PROVIDE NEW FLASHING AT MECHANICAL CURBS. RAISE CURBS AS REQUIRED FOR MINIMUM 8" FLASHING. ENSURE CONDENSATE LINES ARE PROPERLY SUPPORTED. REMOVE AND REPLACE DUCT SEALANTS - SEE SPECIFICATIONS - TYPICAL
- REMOVE EXISTING SLEEPERS UNDER CONDUIT AND PIPE. PROTECT DURING CONSTRUCTION ACTIVITIES. PROVIDE NEW DURA-BLOK SUPPORTS - TYPICAL
- CLEAN EXISTING PARAPET WALLS ON ROOF SIDE. WRAP WALLS 4'-0" HIGH AND UNDER WITH KEE MEMBRANE THAT EXTENDS UP AND OVER NEW TREATED WOOD SLEEPERS.
- PROVIDE BLOCK FILL AND SEAL ROOF SIDE OF PARAPET WALL
- REMOVE ALL CONSTRUCTION JOINT CAULKING FROM ROOF SIDE OF PARAPET AND REPLACE PER SPECIFICATIONS
- PROVIDE NEW SUMPS AS REQUIRED AT EXISTING SCUPPER AND DRAIN LOCATIONS. CLEAR ALL DRAIN LEADERS AND ENSURE PROPER OPERATION - SEE SPECIFICATIONS - TYPICAL
- RAISE DUCT AS REQUIRED FOR PROPER FLASHING - TYPICAL
- PROVIDE NEW TREATED WOOD NAILERS AND METAL COPING CAPS PER SPECIFICATIONS
- PROVIDE NEW SHEET METAL SCUPPERS
- PROVIDE REPAIRS TO LAPS, SEAMS, RIVETS, PENETRATIONS AND OTHERS AS REQUIRED ON METAL ROOFS. SEAL AS REQUIRED - VERIFY IN FIELD. SEE SPECIFICATIONS


GENERAL NOTES

- CONTRACTOR TO REVIEW SPECIFICATIONS PRIOR TO BID. NOTIFY ARCHITECT OF ANY CONFLICTS.
- KEYNOTES ARE TYPICAL THROUGHOUT
- ANY INCIDENTAL MECHANICAL, PLUMBING OR ELECTRICAL ASSOCIATED WITH ROOFTOP EQUIPMENT SHALL BE PERFORMED BY PROPER LICENSED SUBCONTRACTORS UNDER THIS ROOFING CONTRACT - ALL WORK SHALL BE PERFORMED TO CURRENT CODES
- ADJUST EXISTING ELECTRICAL CONDUIT, CONDENSATE AND UTILITY LINES AS REQUIRED FOR NEW ROOF HEIGHT. PROVIDE NEW DURA BLOK SUPPORTS - TYPICAL - SEE SPECIFICATIONS.
- REMOVE EXISTING LOW VOLTAGE WIRE AND REINSTALL AFTER ROOF REPLACEMENT
- REMOVE AND PATCH ALL ABANDONED OPENINGS. NOTIFY ARCHITECT IF OPENING IS WIDER THAN 12" X 12"
- DEMO ALL ABANDONED PITCH PANS. CAP WATER AND POWER

TYPICAL DETAILS THROUGHOUT

10 A2.1	ROOF TOP PIPE SUPPORT	14 A2.1	PITCH POCKET
11 A2.1	PRE MANUFACTURED SUPPORT CURB	15 A2.1	PIPE PENETRATION
12 A2.1	PASSIVE VENT / AIR INTAKE	16 A2.1	COPING
13 A2.1	EXPANSION JOINT	17 A2.1	EXHAUST FAN

REFERENCE PLAN

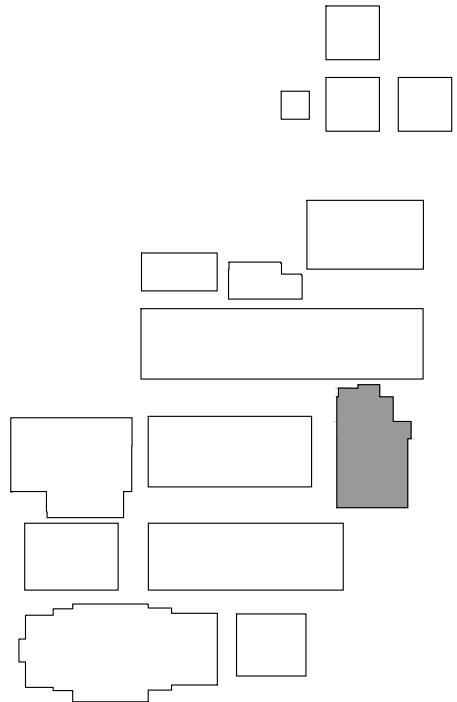

ROOFING IMPROVEMENTS
WASHINGTON ELEMENTARY SCHOOL DISTRICT
PALO VERDE MIDDLE SCHOOL
7502 NORTH 39th AVENUE
PHOENIX, ARIZONA 85051
SFB PROJECT NO.: BRG-DSGN-00415

PROJECT NO.: 21163
DRAWN BY: B. TUTTLE
CHECKED BY: L. LIND
DATE: 12/16/21

NO.	DATE	COMMENT	REVISIONS

COPYRIGHT
© 2021 - All designs, details, graphic and written material illustrated herein constitutes the original unpublished work of the Architect and may not be copied, published, reproduced electronically or by any other means, used on other projects for construction or recording without the written consent of the Architect. All rights reserved.

DRAWING TITLE
BUILDING I (SFB 1009) AND BUILDING M (SFB 1019) ROOF PLANS

DRAWING NUMBER

A1.8

TYPICAL DETAILS THROUGHOUT

10 A2.1	ROOF TOP PIPE SUPPORT	14 A2.1	PITCH POCKET
11 A2.1	PRE MANUFACTURED SUPPORT CURB	15 A2.1	PIPE PENETRATION
12 A2.1	PASSIVE VENT / AIR INTAKE	18 A2.1	COPING
13 A2.1	EXPANSION JOINT	19 A2.1	EXHAUST FAN




GENERAL NOTES

- CONTRACTOR TO REVIEW SPECIFICATIONS PRIOR TO BID. NOTIFY ARCHITECT OF ANY CONFLICTS.
- KEYNOTES ARE TYPICAL THROUGHOUT
- ANY INCIDENTAL MECHANICAL, PLUMBING OR ELECTRICAL ASSOCIATED WITH ROOFTOP EQUIPMENT SHALL BE PERFORMED BY PROPER LICENSED SUBCONTRACTORS UNDER THIS ROOFING CONTRACT - ALL WORK SHALL BE PERFORMED TO CURRENT CODES
- ADJUST EXISTING ELECTRICAL CONDUIT, CONDENSATE AND UTILITY LINES AS REQUIRED FOR NEW ROOF HEIGHT. PROVIDE NEW DURA BLOK SUPPORTS - TYPICAL - SEE SPECIFICATIONS.
- REMOVE EXISTING LOW VOLTAGE WIRE AND REINSTALL AFTER ROOF REPLACEMENT
- REMOVE AND PATCH ALL ABANDONED OPENINGS. NOTIFY ARCHITECT IF OPENING IS WIDER THAN 12" X 12"
- DEMO ALL ABANDONED PITCH PANS, CAP WATER AND POWER

KEYED NOTES

- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON PLYWOOD OR TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. FOAM ROOF WITH COATING OVER BUILT UP ROOF OVER 1/2" COVER BOARD OVER 3" ISO ON METAL DECK. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. TPO ROOF OVER BUILT UP ROOF OVER STRUCTURAL DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- EXISTING ROOF CONSISTS OF TWO SYSTEMS. MODIFIED BUILT UP ROOF OVER BUILT UP ROOF ON TECTUM. REMOVE EXISTING ROOFING SYSTEM TO DECK. CLEAN AND PREP DECK AS REQUIRED FOR NEW ROOF - SEE SPECIFICATIONS
- GRIND EXISTING FOAM TO DECK SO THAT THE SURFACE IS CLEAN AND LEVEL FOR NEW ROOF INSTALLATION.
- INSTALL NEW ROOFING ON COVER BOARD OVER RIGID INSULATION. TYPICAL - SEE SPECIFICATIONS.
- REMOVE AND REPLACE ALL METAL FLASHINGS, REGLETS, AND COUNTER FLASHINGS- TYPICAL - SEE SPECIFICATIONS.
- PROVIDE NEW FLASHING AT MECHANICAL CURBS. RAISE CURBS AS REQUIRED FOR MINIMUM 8" FLASHING. ENSURE CONDENSATE LINES ARE PROPERLY SUPPORTED. REMOVE AND REPLACE DUCT SEALANTS. - SEE SPECIFICATIONS - TYPICAL
- REMOVE EXISTING SLEEPERS UNDER CONDUIT AND PIPE. PROTECT DURING CONSTRUCTION ACTIVITIES. PROVIDE NEW DURA-BLOK SUPPORTS - TYPICAL
- CLEAN EXISTING PARAPET WALLS ON ROOF SIDE. WRAP WALLS 4'-0" HIGH AND UNDER WITH KEE MEMBRANE THAT EXTENDS UP AND OVER NEW TREATED WOOD SLEEPERS.
- PROVIDE BLOCK FILL AND SEAL ROOF SIDE OF PARAPET WALL
- REMOVE ALL CONSTRUCTION JOINT CAULKING FROM ROOF SIDE OF PARAPET AND REPLACE PER SPECIFICATIONS
- PROVIDE NEW SUMPS AS REQUIRED AT EXISTING SCUPPER AND DRAIN LOCATIONS. CLEAR ALL DRAIN LEADERS AND ENSURE PROPER OPERATION - SEE SPECIFICATIONS - TYPICAL
- RAISE DUCT AS REQUIRED FOR PROPER FLASHING - TYPICAL
- PROVIDE NEW TREATED WOOD NAILERS AND METAL COPING CAPS PER SPECIFICATIONS
- PROVIDE NEW SHEET METAL SCUPPERS
- PROVIDE REPAIRS TO LAPS, SEAMS, RIVETS, PENETRATIONS AND OTHERS AS REQUIRED ON METAL ROOFS. SEAL AS REQUIRED - VERIFY IN FIELD. SEE SPECIFICATIONS

REFERENCE PLAN

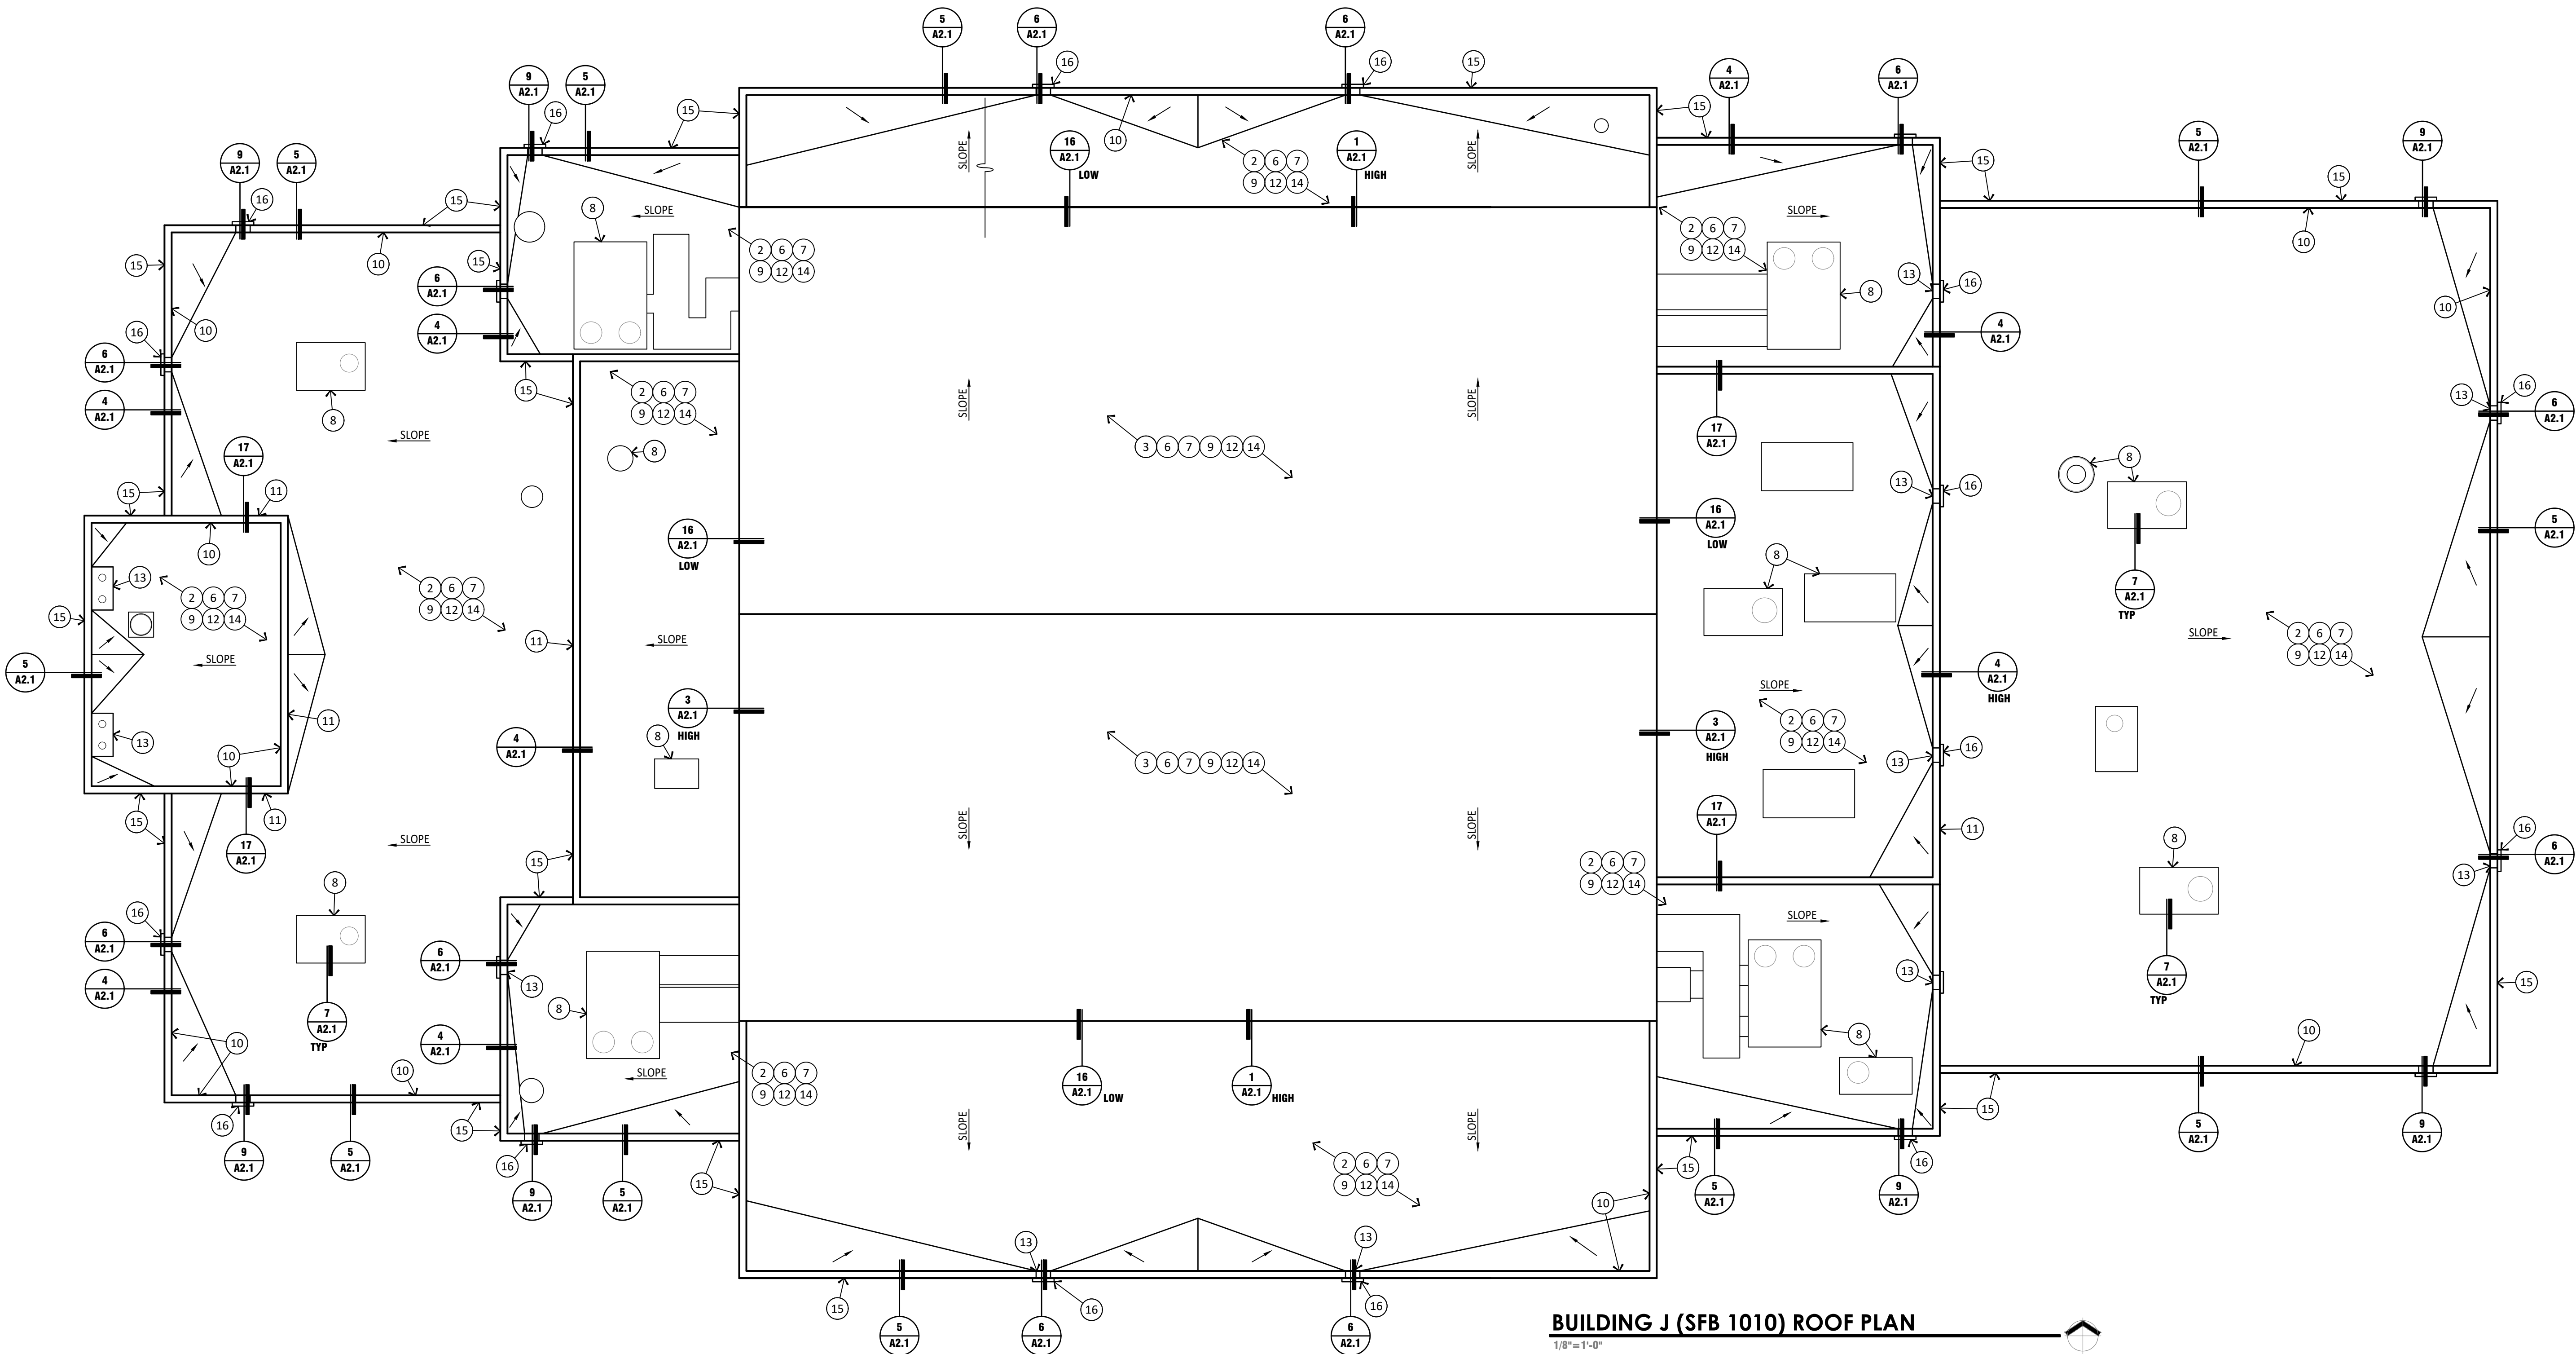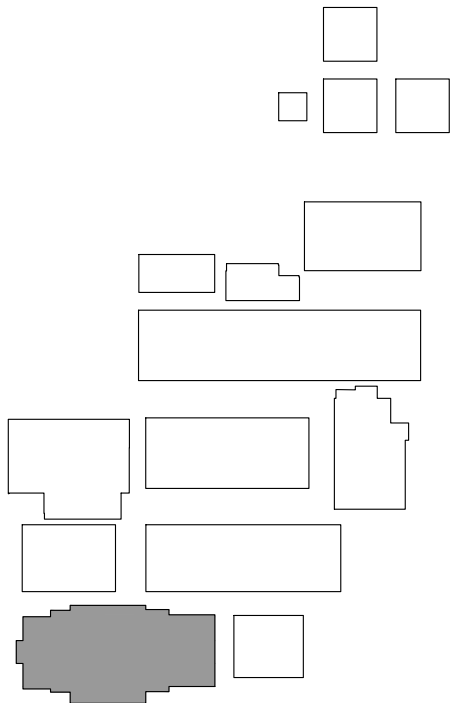

ARCHITECTURE - FACILITIES - C.M.
5229 N. 7th AVE. #101
PHOENIX, ARIZONA 85013
602.347.5226



WASHINGTON ELEMENTARY
SCHOOL DISTRICT



ROOFING IMPROVEMENTS
WASHINGTON ELEMENTARY SCHOOL DISTRICT
PALO VERDE MIDDLE SCHOOL
7502 NORTH 39th AVENUE
PHOENIX, ARIZONA 85051
SFB PROJECT NO.: BRG-DSGN-00415

PROJECT NO.: 21163
DRAWN BY: B. TUTTLE
CHECKED BY: L. LIND
DATE: 12/16/21

REVISIONS		
NO.	DATE	COMMENT






















COPYRIGHT
© 2021 - All designs, details, graphic and written material illustrated herein constitutes the original unpublished work of the Architect and may not be copied, published, reproduced electronically or by any other means, used on other projects for construction or recording without the written consent of the Architect. All rights reserved.

DRAWING TITLE

BUILDING J (SFB 1010)
ROOF PLAN

DRAWING NUMBER

A1.8

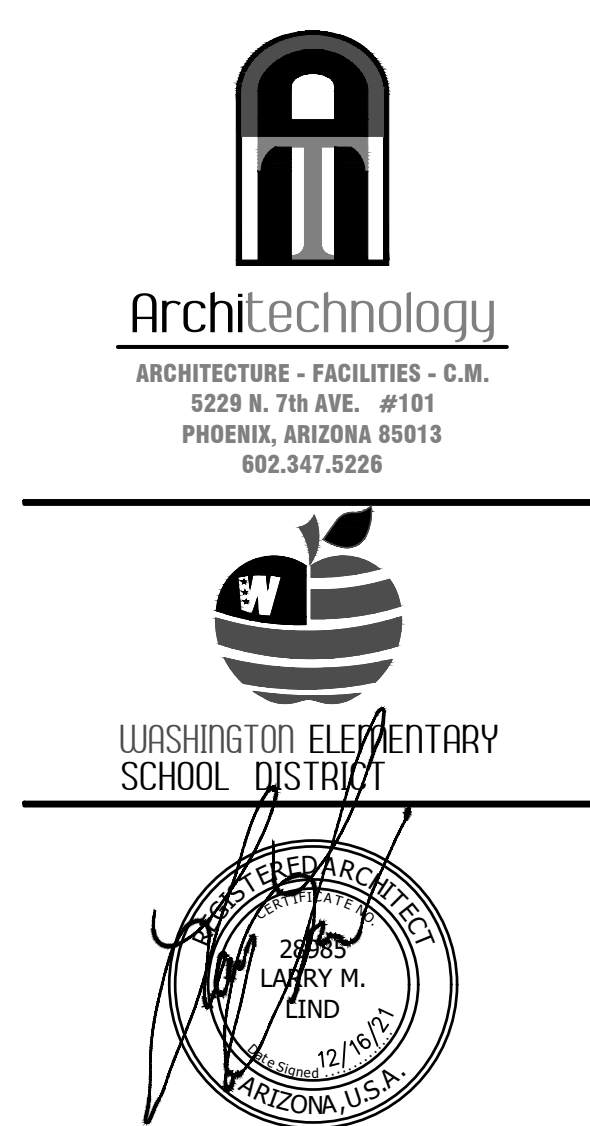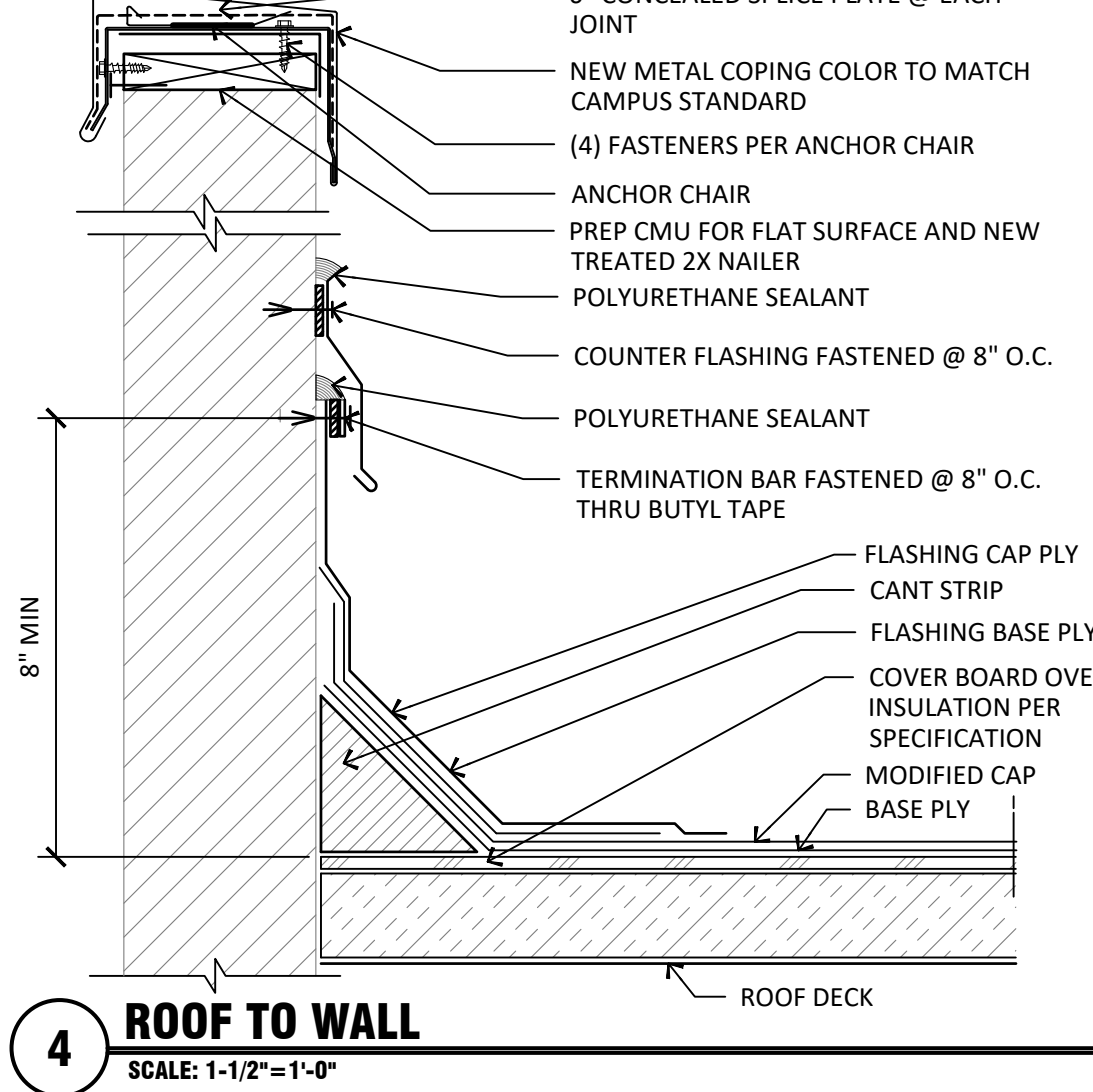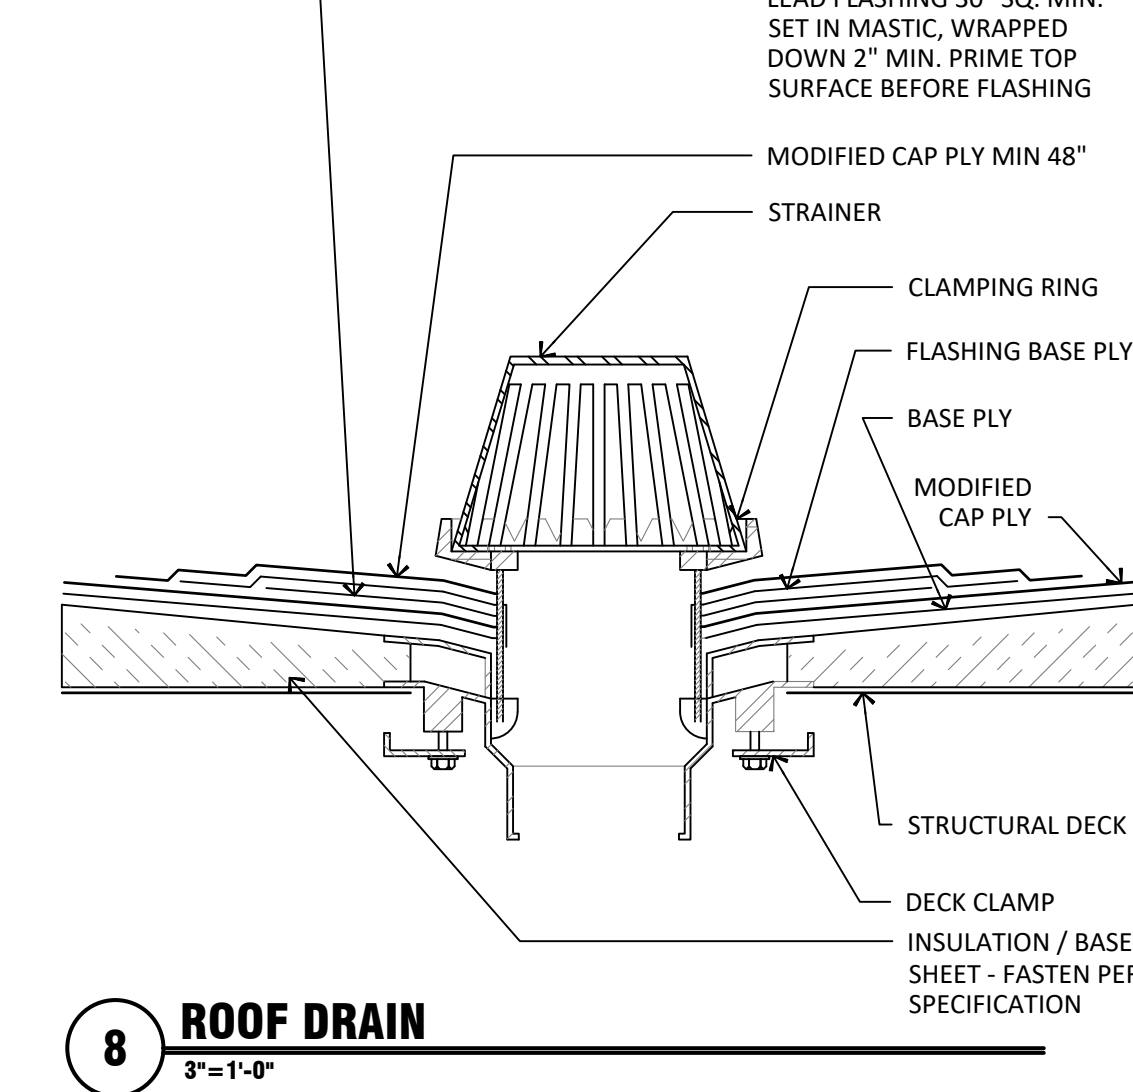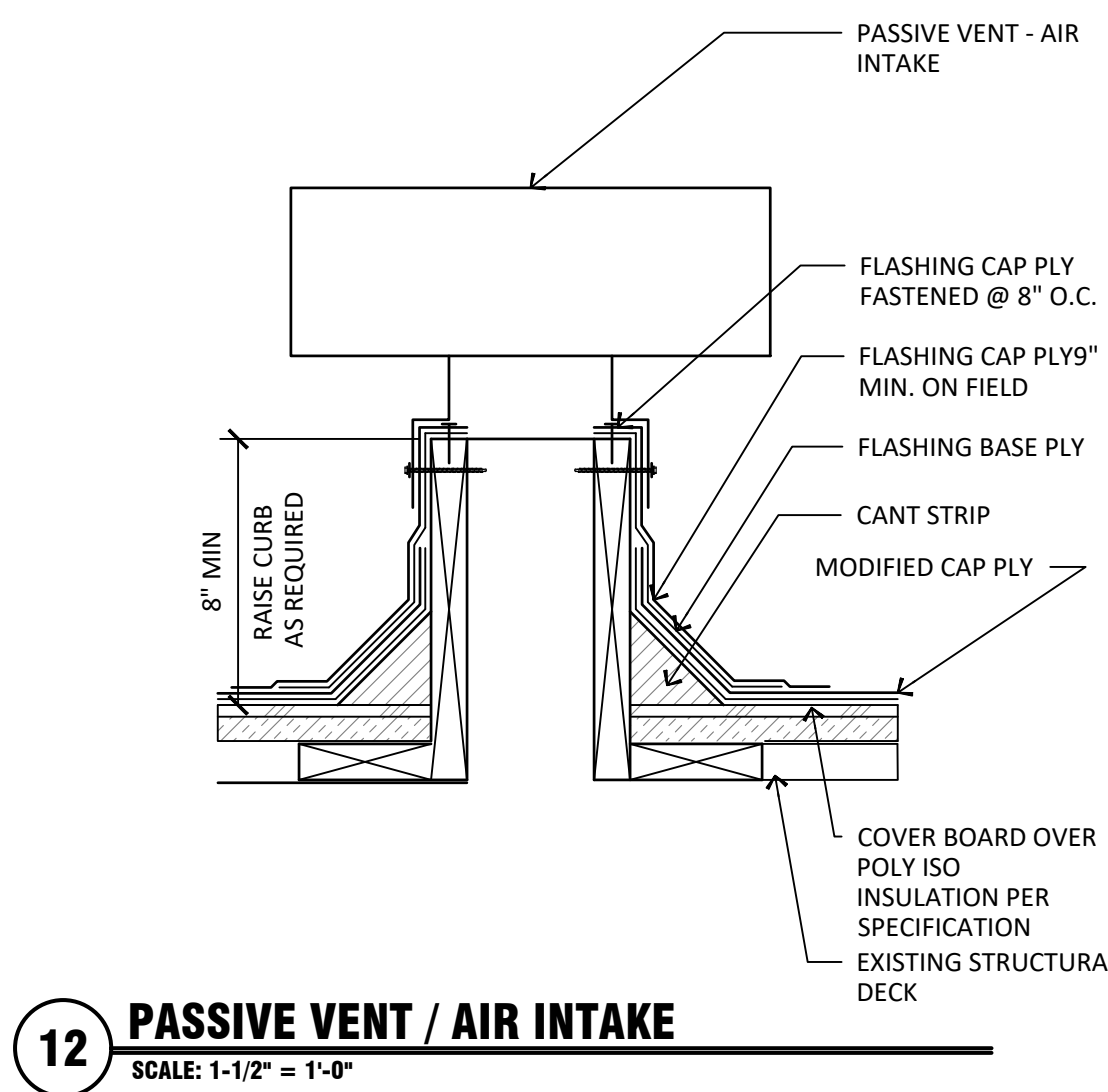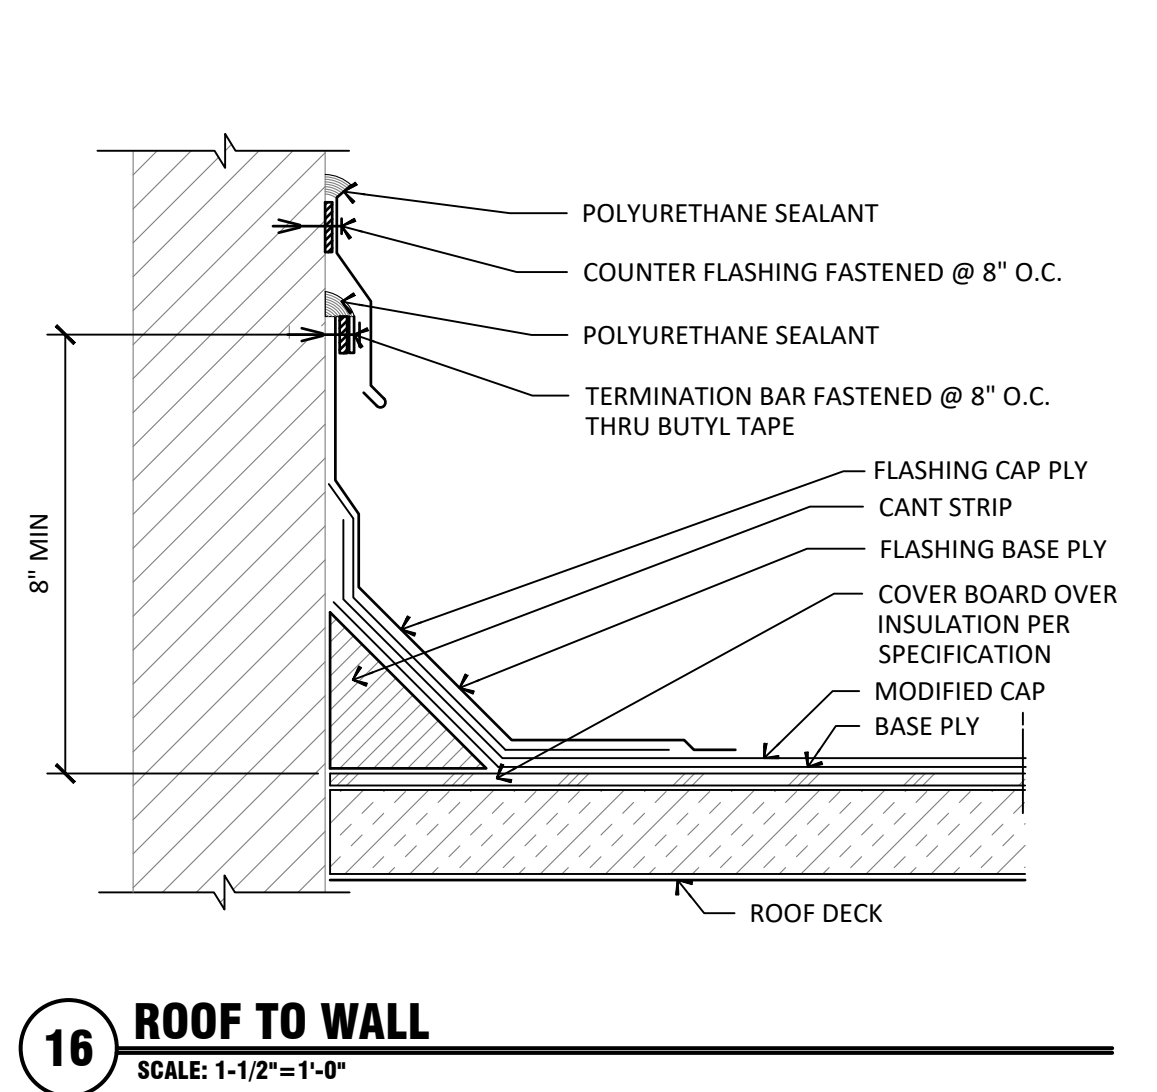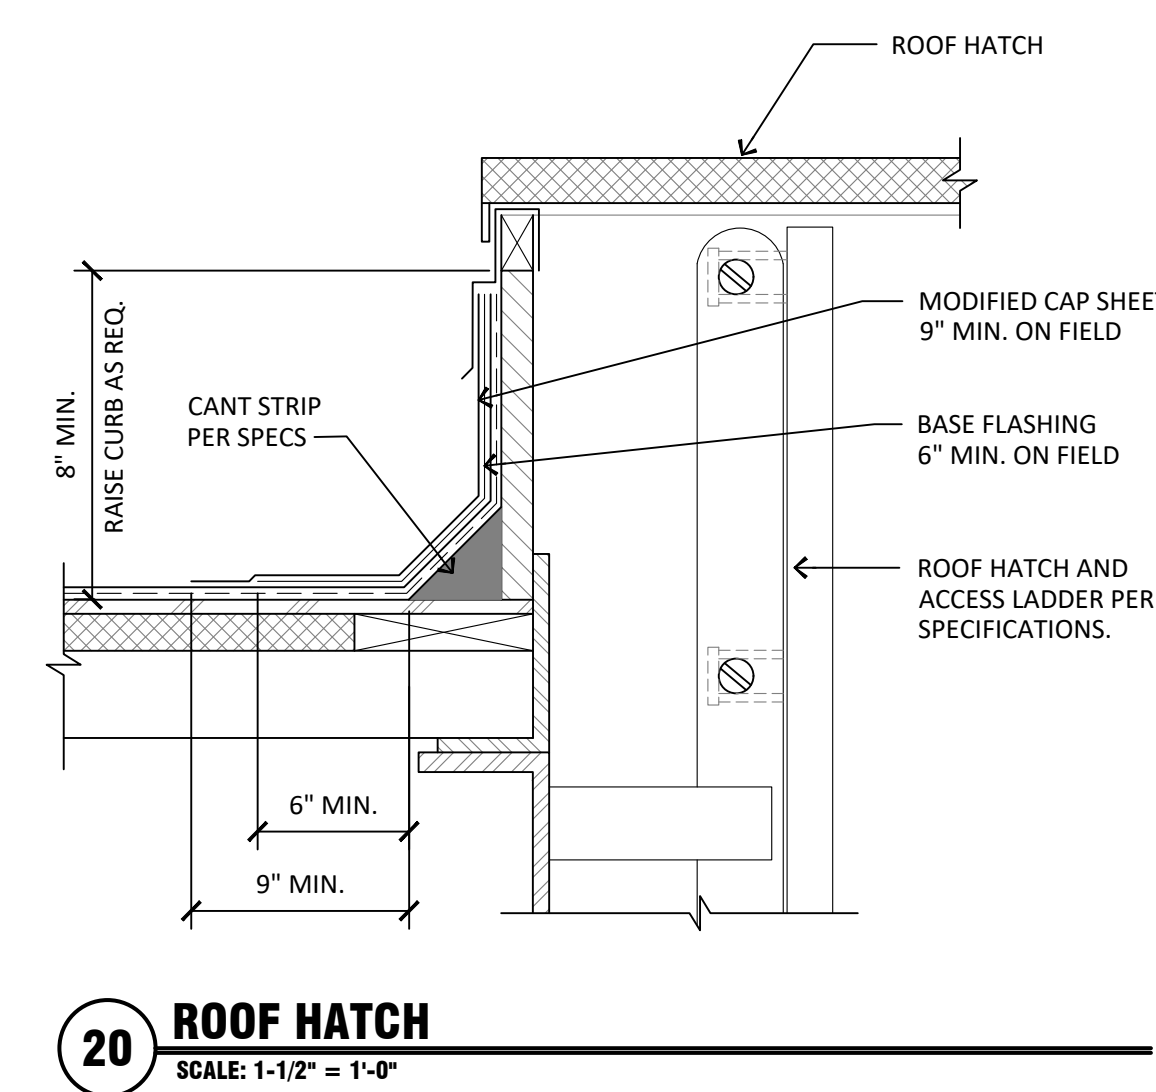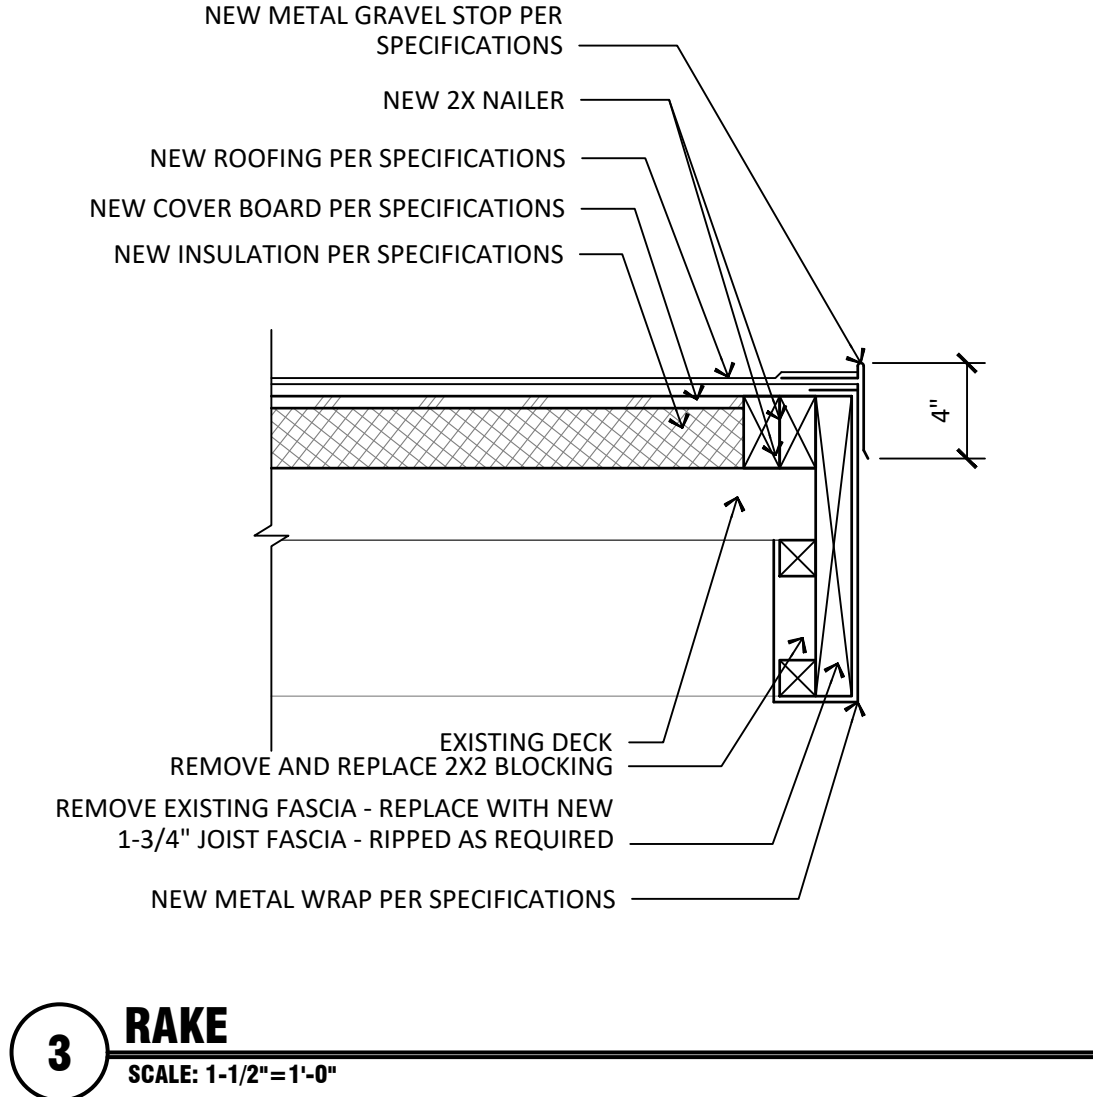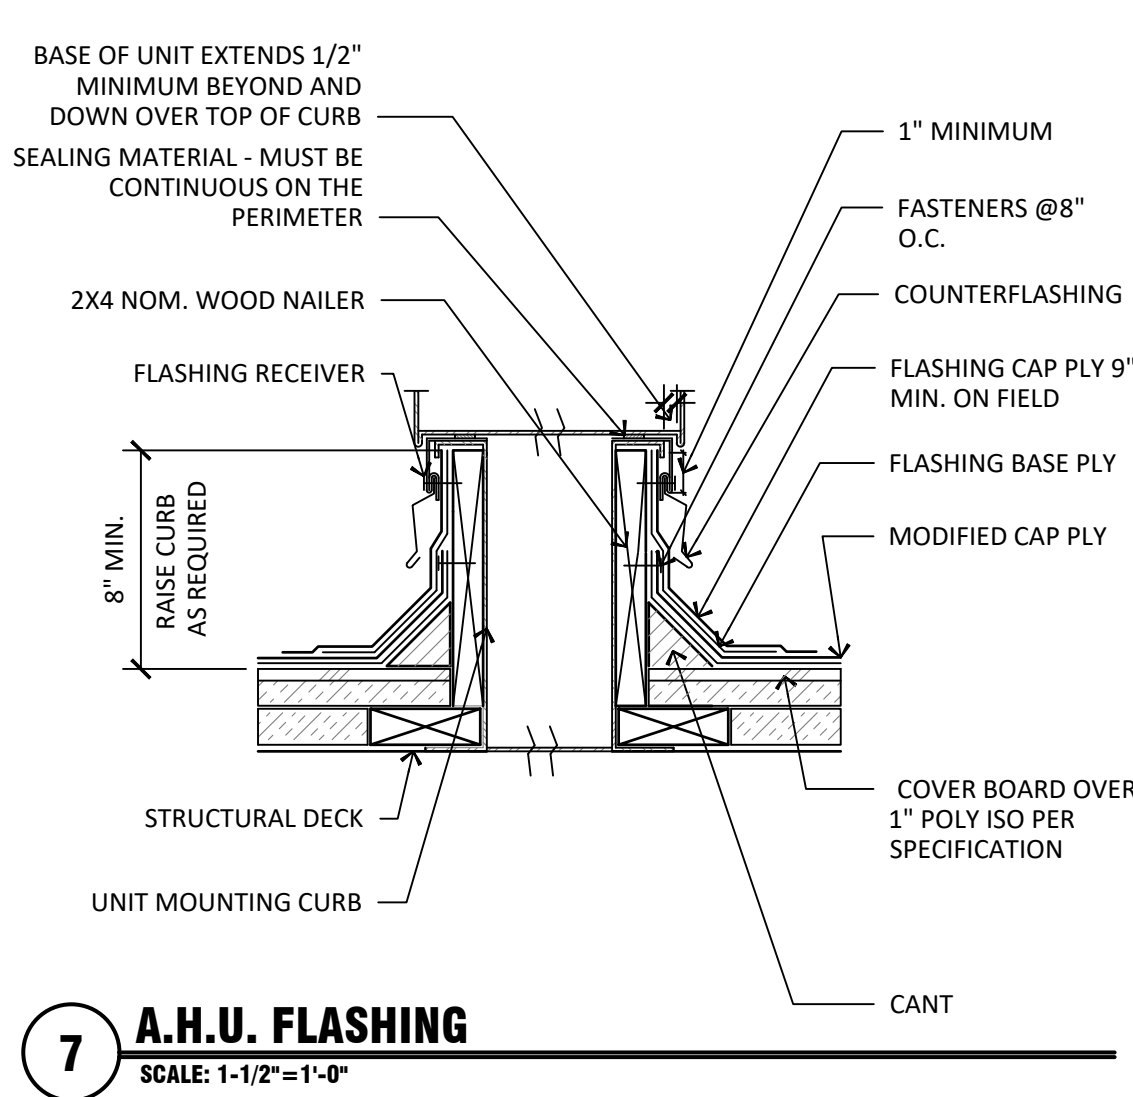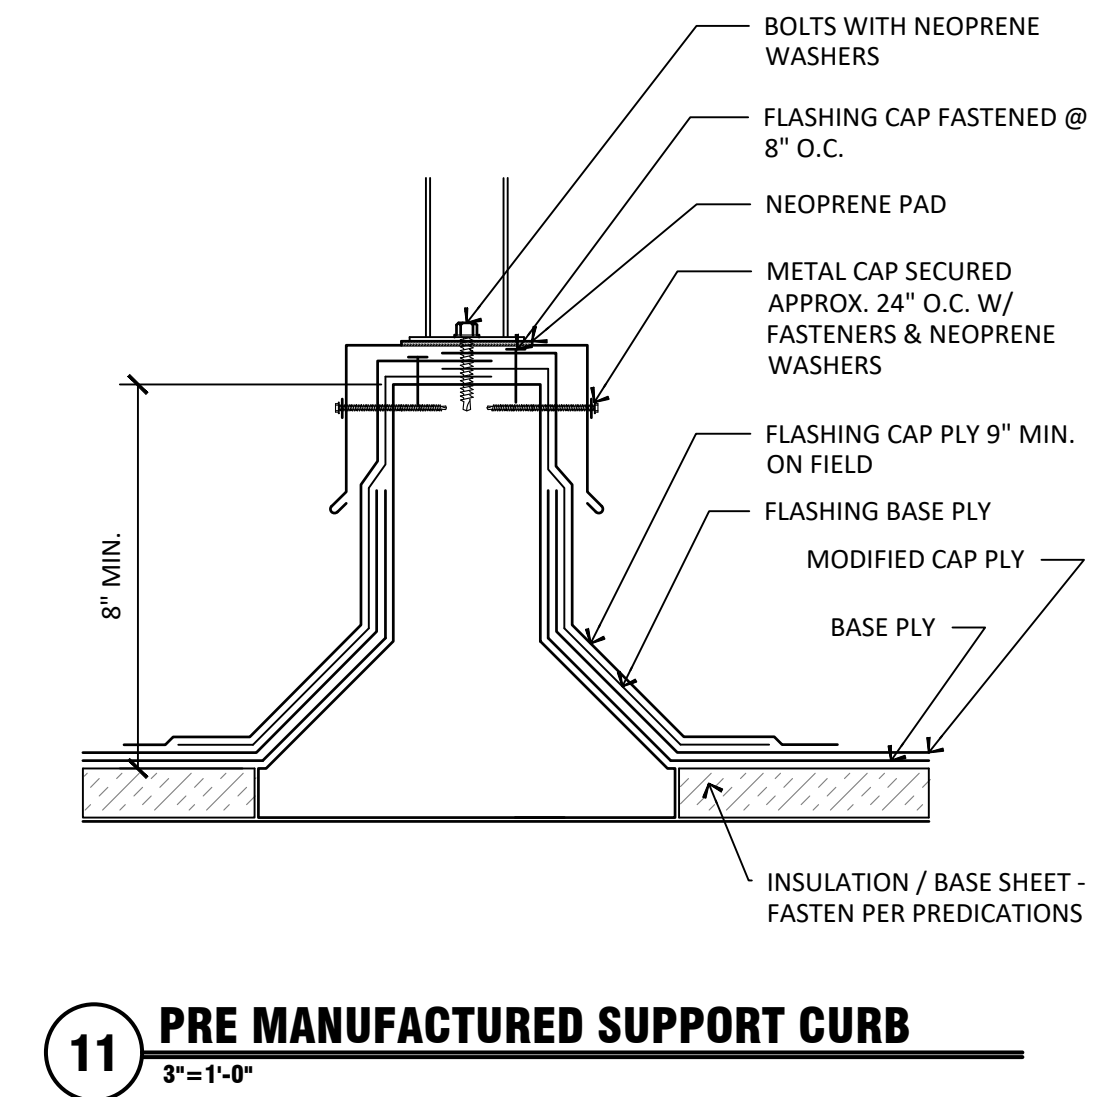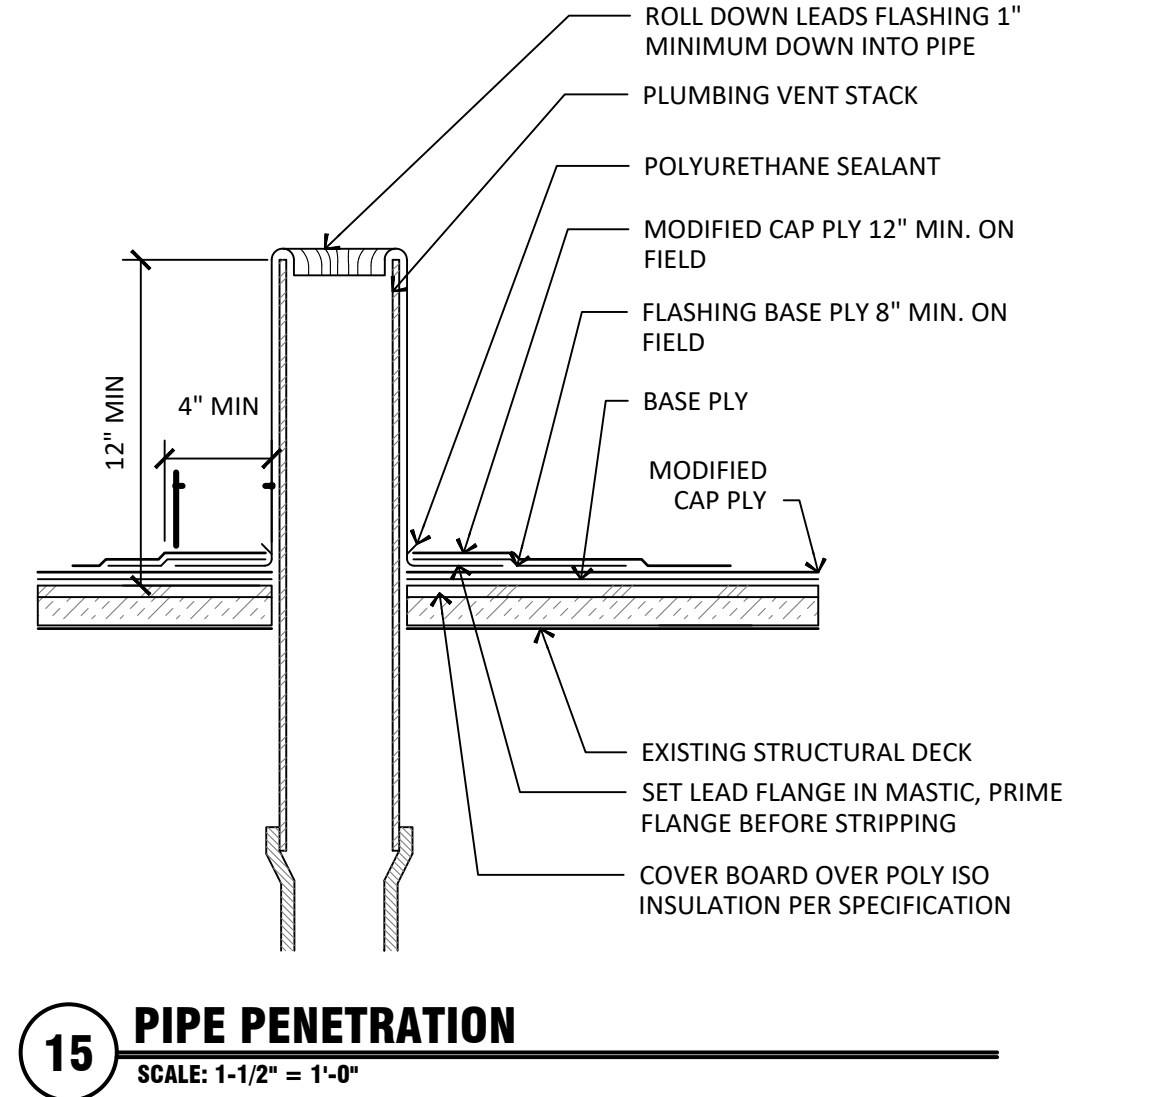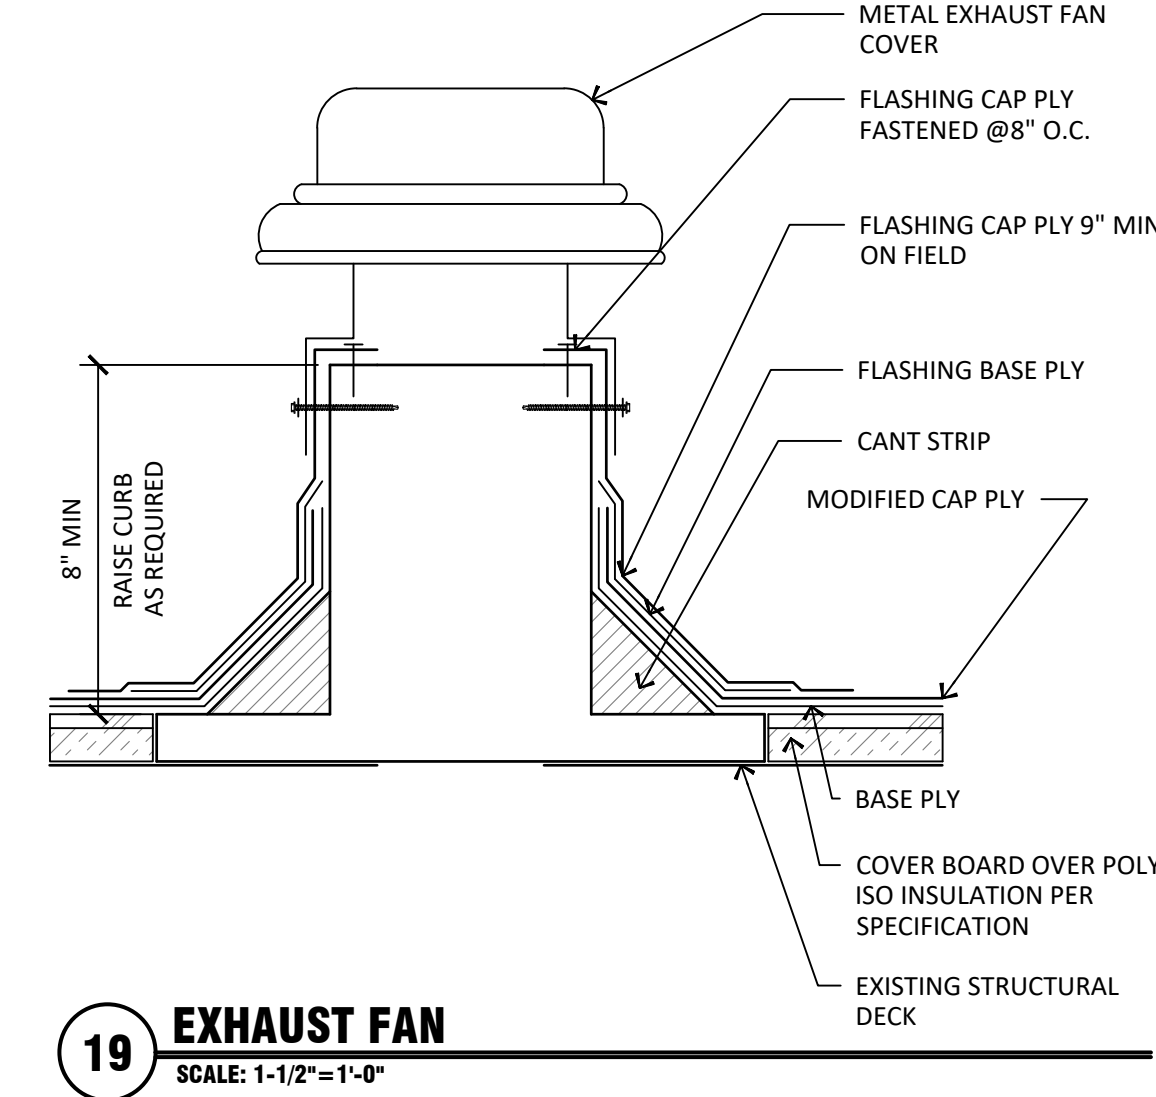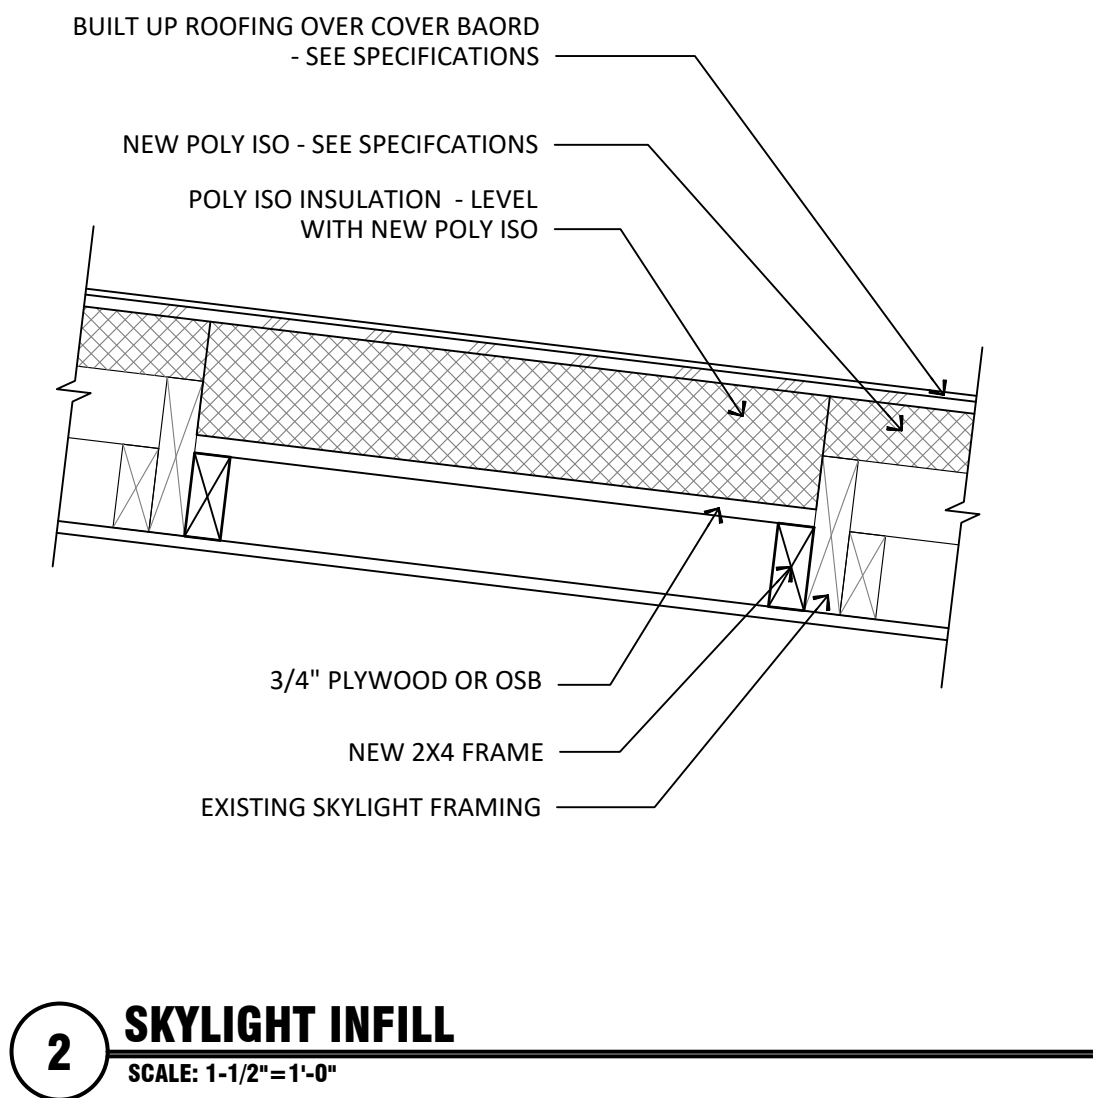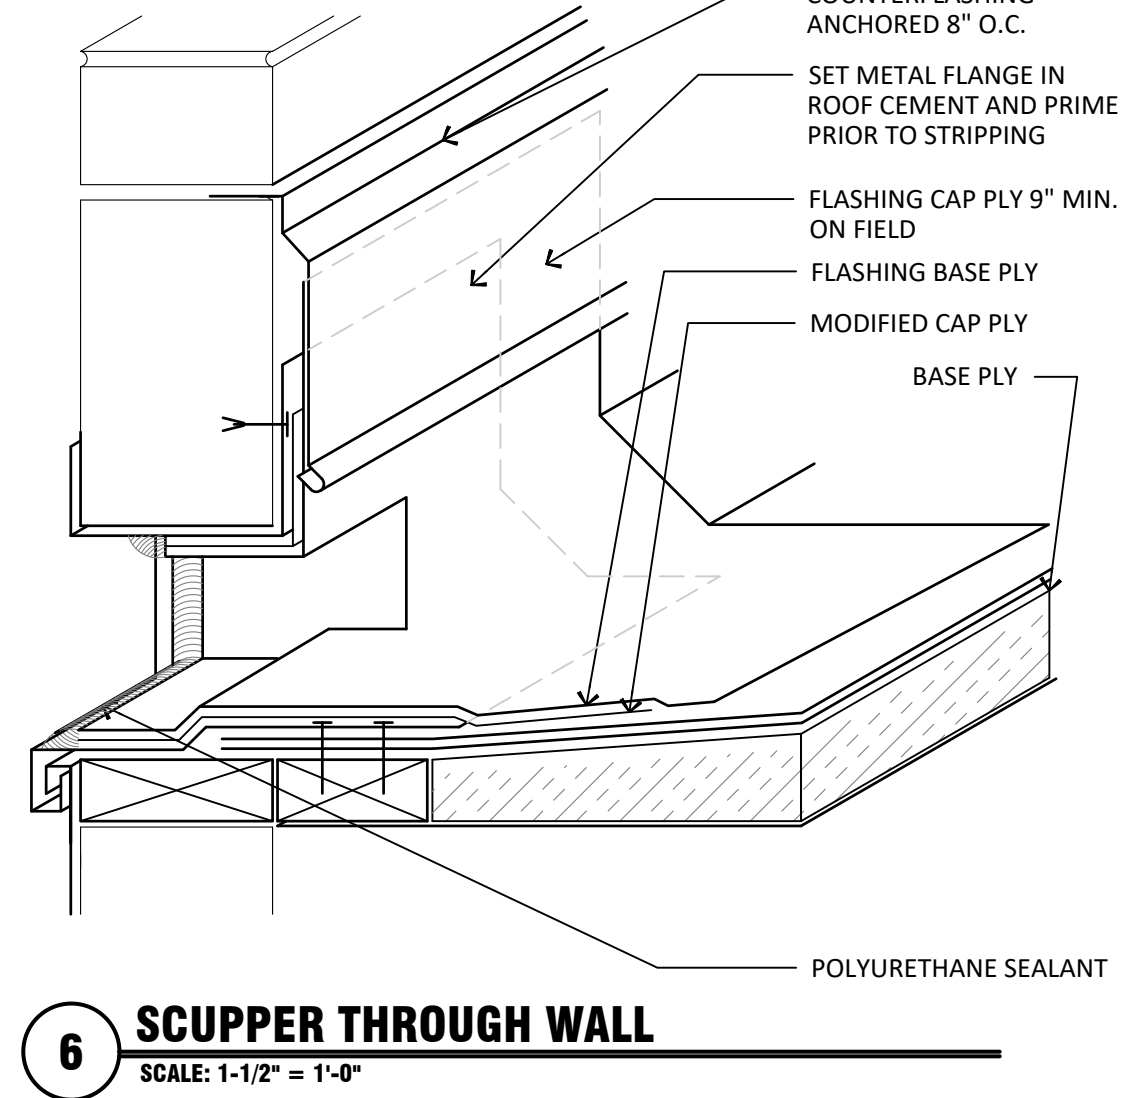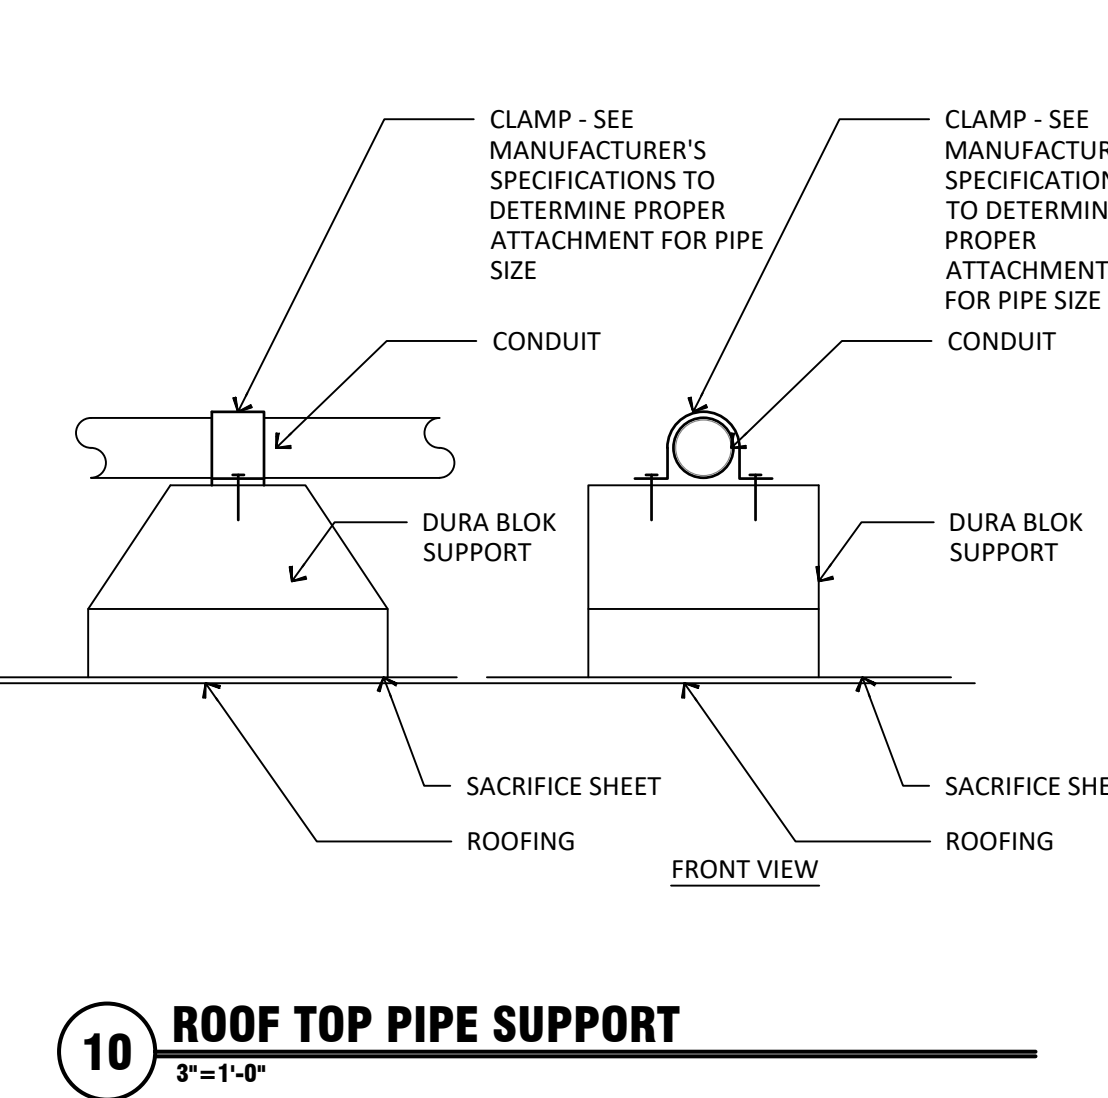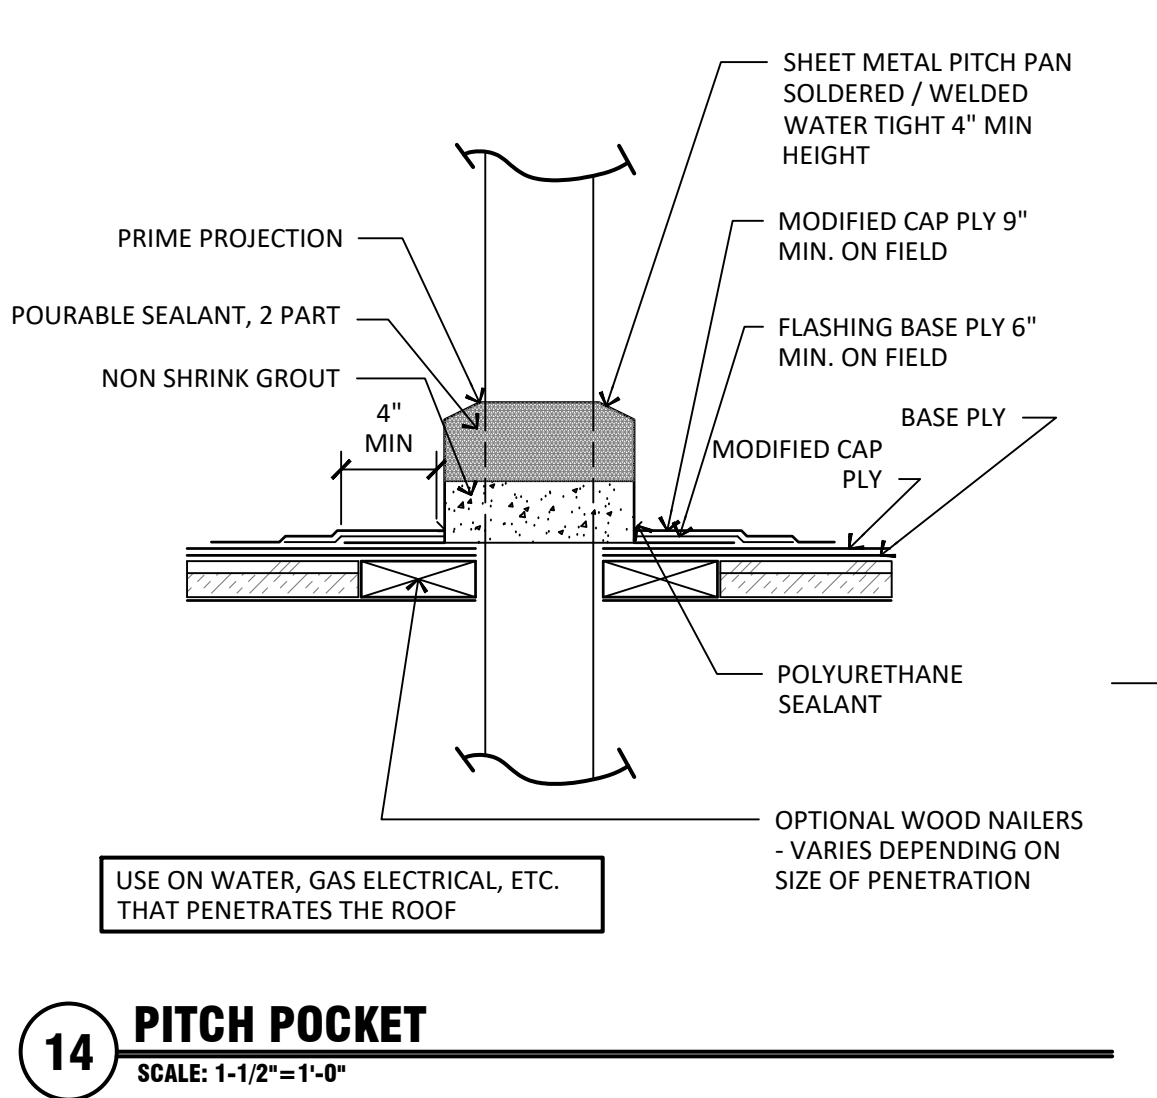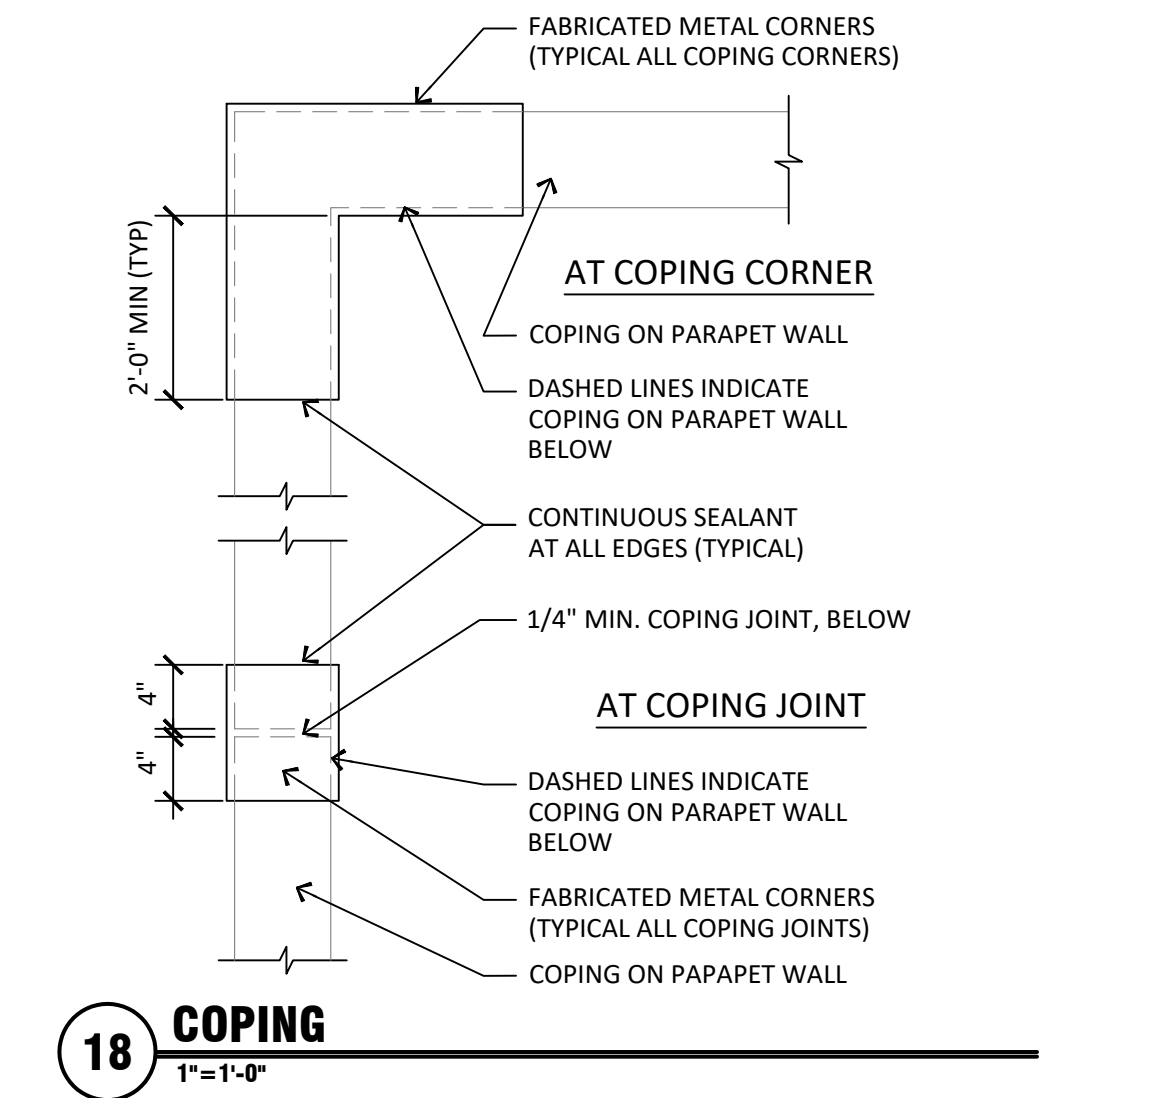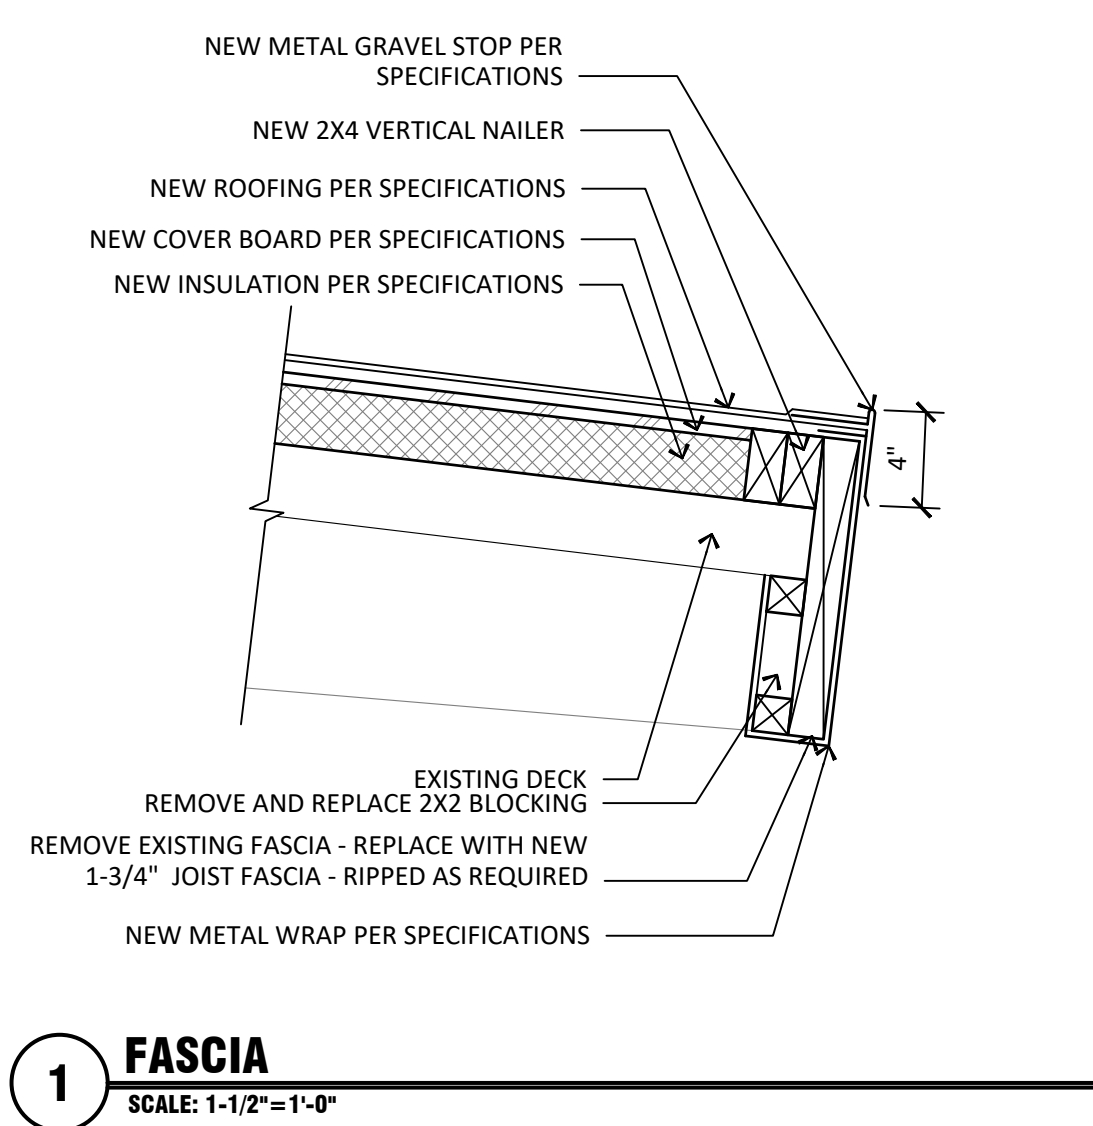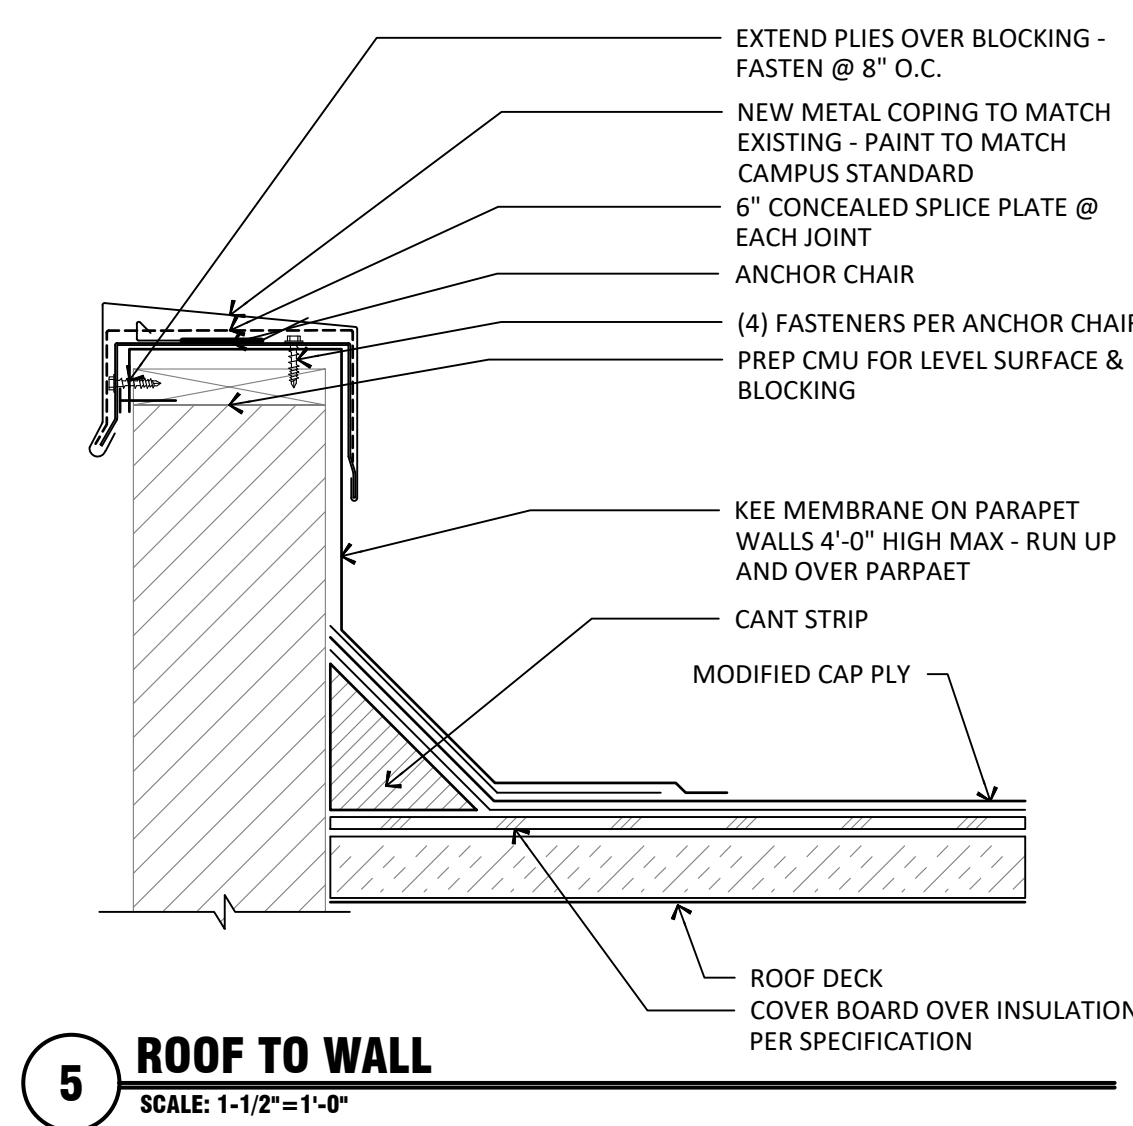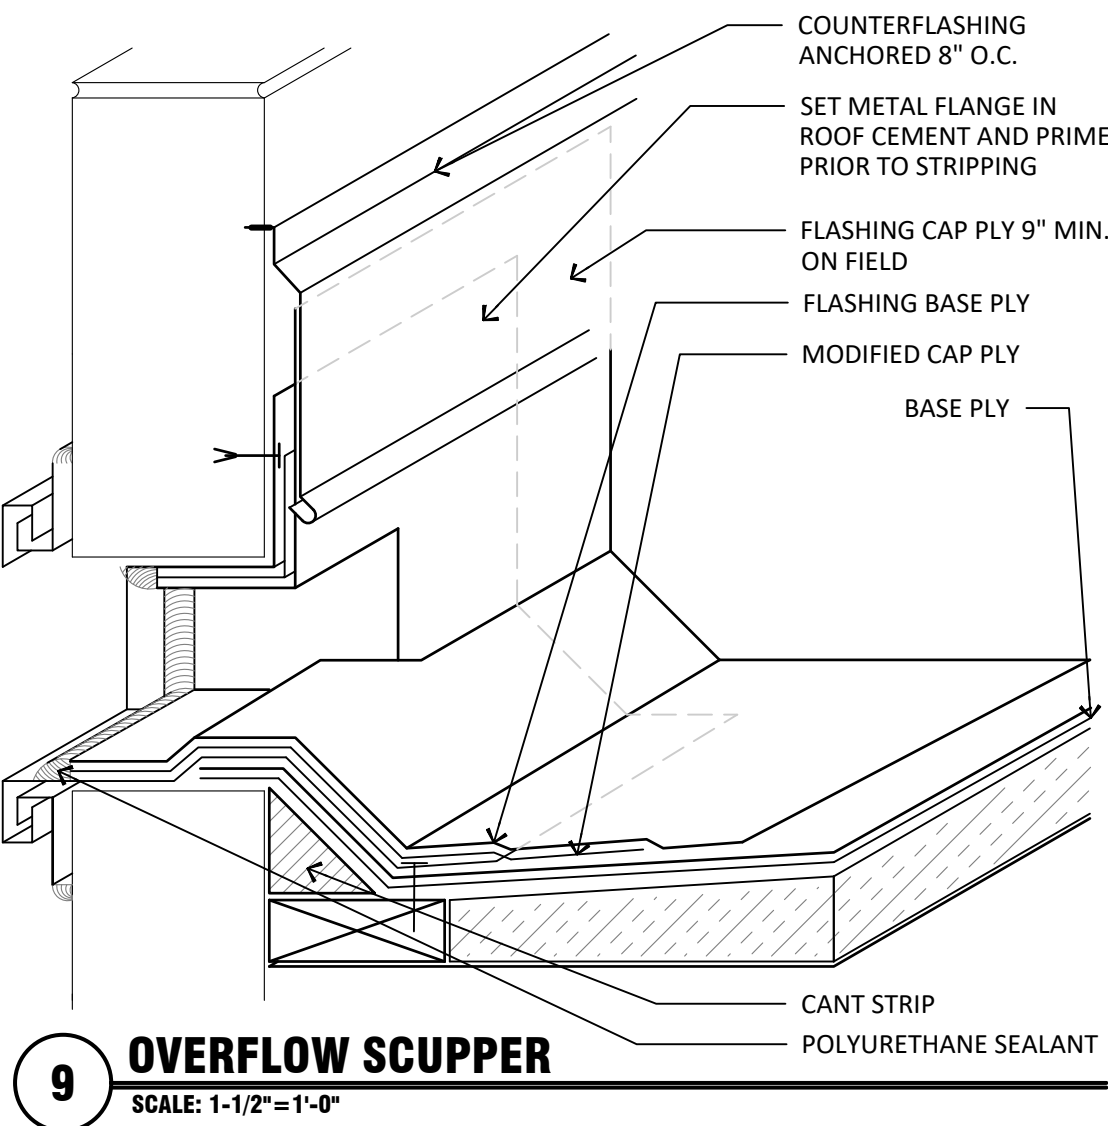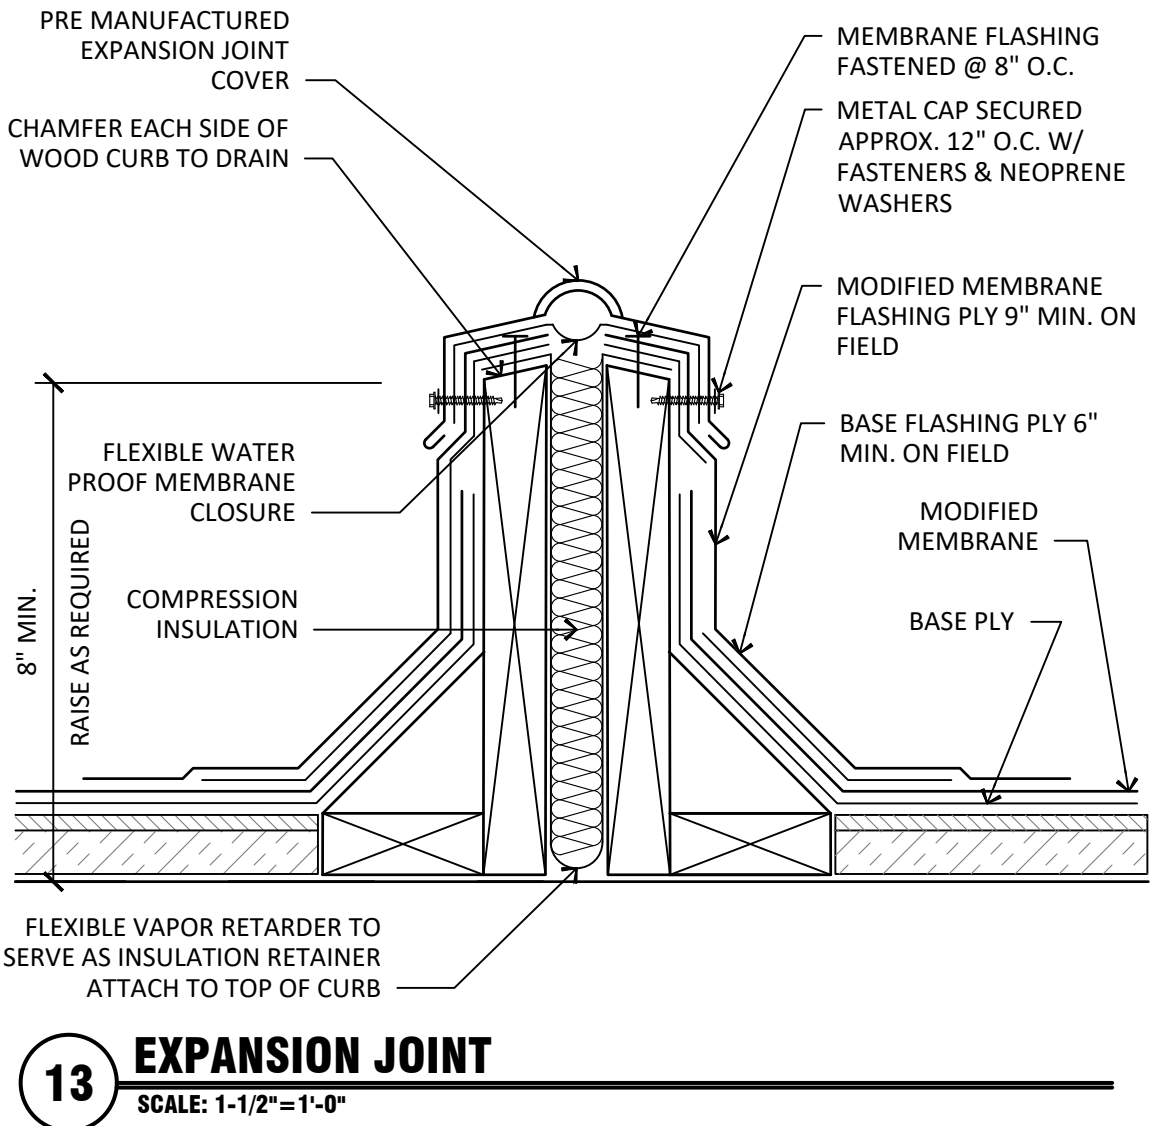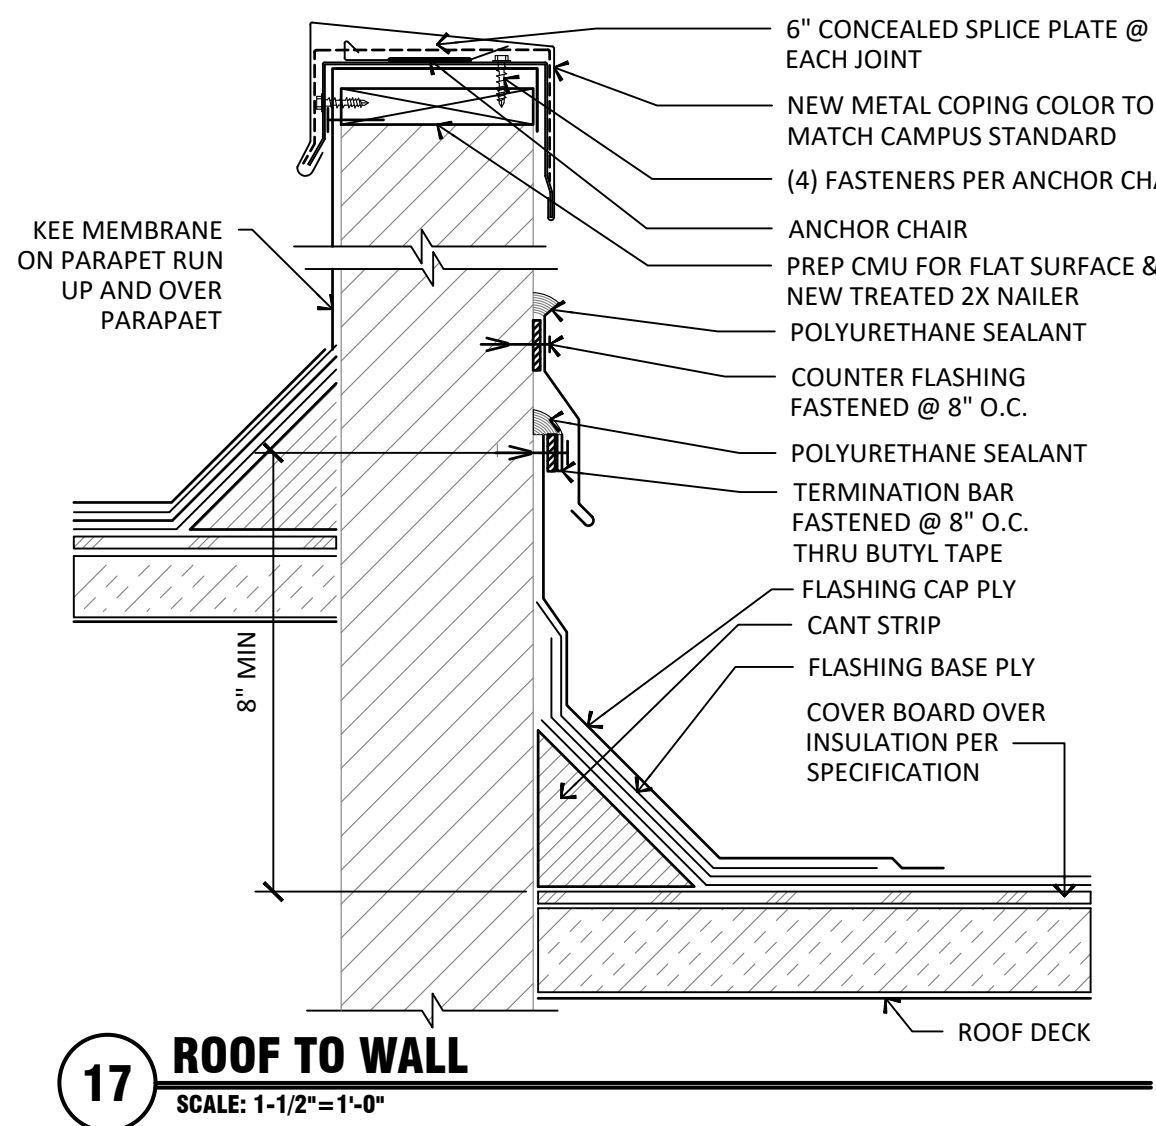

ROOFING IMPROVEMENTS
WASHINGTON ELEMENTARY SCHOOL DISTRICT
PALO VERDE MIDDLE SCHOOL
7502 NORTH 39th AVENUE
PHOENIX, ARIZONA 85051
SFB PROJECT NO.: BRG-DSGN-00415

PROJECT NO.: 21163
DRAWN BY: B. TUTTLE
CHECKED BY: L. LIND
DATE: 12/16/21

REVISIONS			
NO.	DATE	COMMENT	

COPYRIGHT
© 2021 - All designs, details, graphic and written material illustrated herein constitutes the original unpublished work of the Architect and may not be copied, published, reproduced electronically or by any other means, used on other projects for construction or recording without the written consent of the Architect. All rights reserved.

DRAWING TITLE

DETAILS

DRAWING NUMBER

A2.1

Washington Elementary School District




Project Manual

For

Palo Verde Middle School SFB Buildings 1001 – 1010, 1013, 1014, and 1017 Roofing Improvements

December 16, 2021

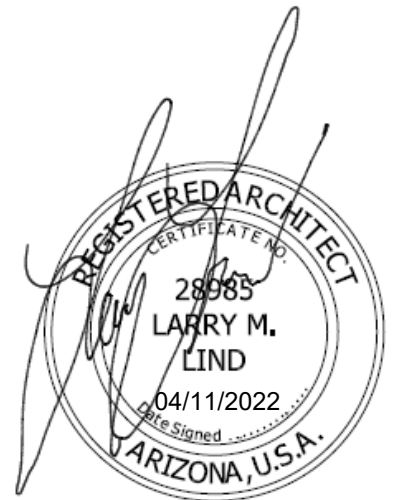

**5229 North 7th Avenue, Suite 101
Phoenix, Arizona 85013**

SECTION 00 01 10

TABLE OF CONTENTS

PROCUREMENT AND CONTRACTING REQUIREMENTS GROUP

Division 00 -- Procurement and Contracting Requirements

00 01 01 - Project Title Page

00 01 10 - Table of Contents

SPECIFICATIONS GROUP

GENERAL REQUIREMENTS SUBGROUP

Division 01 -- General Requirements

01 10 00 - Summary

01 20 00 - Price and Payment Procedures

01 30 00 - Administrative Requirements

01 40 00 - Quality Requirements

01 50 00 - Temporary Facilities and Controls

01 60 00 - Product Requirements

01 70 00 - Execution and Closeout Requirements

01 78 00 - Closeout Submittals

FACILITY CONSTRUCTION SUBGROUP

Division 02 -- Existing Conditions

02 22 50 - Interior and Partial Demolition

Division 06 -- Wood, Plastics and Composites

06 10 00 - Rough Carpentry

Division 07 -- Thermal and Moisture Protection

07 55 00 - Modified Bitumen Roofing

07 62 00 - Sheet Metal Flashing and Trim

07 71 00 - Roof Specialties

07 90 05 - Joint Sealers

Division 09 -- Finishes

09 90 00 - Painting and coating

END OF TABLE OF CONTENTS



SECTION 01 10 00

SUMMARY

PART 1 GENERAL

1.01 PROJECT

- A. Project Name: Palo Verde Middle School
- B. Owner's Name: Washington Elementary School District
- C. The Project consists of the complete removal and replacement of the existing roof systems at Palo Verde Elementary School SFB Buildings 1001 – 1010, 1013, 1014, and 1017 as designated on the drawings.

1.02 CONTRACT DESCRIPTION

- A. Contract Type: A single prime contract.

1.03 DESCRIPTION OF ALTERATIONS WORK

- A. Scope of demolition and removal work is shown on drawings and specified in Section 02 25 50.

1.04 OWNER OCCUPANCY

- A. Owner intends to occupy the Project upon Substantial Completion.
- B. Cooperate with Owner to minimize conflict and to facilitate Owner's operations.
- C. Schedule the Work to accommodate Owner occupancy.

1.05 CONTRACTOR USE OF SITE AND PREMISES

- A. Provide access to and from site as required by law and by Owner:
 - 1. Emergency Building Exits During Construction: Keep all exits required by code open during construction period; provide temporary exit signs if exit routes are temporarily altered.
 - 2. Do not obstruct roadways, sidewalks, or other public ways without permit.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01 20 00

PRICE AND PAYMENT PROCEDURES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Procedures for preparation and submittal of applications for progress payments.

1.02 SCHEDULE OF VALUES

- A. Submit a printed schedule on AIA Form G703 - Application and Certificate for Payment Continuation Sheet. Contractor's standard form or electronic media printout will be considered.
- B. Submit Schedule of Values in duplicate within 15 days after date of Owner-Contractor Agreement, but must be approved before submission of first pay application.
- C. Revise schedule to list approved Change Orders, with each Application For Payment.

1.03 APPLICATIONS FOR PROGRESS PAYMENTS

- A. Payment Period: Submit at intervals stipulated in the Agreement.
- B. Present required information in typewritten form.
- C. Form: AIA G702 Application and Certificate for Payment and AIA G703 - Continuation Sheet including continuation sheets when required.
- D. Execute certification by signature of authorized officer.
- E. Use data from approved Schedule of Values. Provide dollar value in each column for each line item for portion of work performed and for stored Products.
- F. List each authorized Change Order as a separate line item, listing Change Order number and dollar amount as for an original item of Work.
- G. Submit three copies of each Application for Payment.
- H. Include the following with the application:
 - 1. Any documents required by Owner as stipulated in the Conditions of the Contract.

1.04 MODIFICATION PROCEDURES

- A. Architect will advise of minor changes in the Work not involving an adjustment to Contract Sum or Contract Time as authorized by the Conditions of the Contract by issuing supplemental instructions on AIA Form G710.
- B. Construction Change Directive: Architect may issue a document, signed by Owner, instructing Contractor to proceed with a change in the Work, for subsequent inclusion in a Change Order.
 - 1. The document will describe changes in the Work, and will designate method of determining any change in Contract Sum or Contract Time.
 - 2. Promptly execute the change in Work.
- C. Proposal Request: Architect may issue a document which includes a detailed description of a proposed change with supplementary or revised Drawings and specifications, a change in Contract Time for executing the change with a stipulation of any overtime work required and the period of time during which the requested price will be considered valid. Contractor shall prepare and submit a fixed price quotation within 14 days.
- D. Contractor may propose a change by submitting a request for change to Architect, describing the proposed change and its full effect on the Work, with a statement describing the reason for the change, and the effect on the Contract Sum and Contract Time with full documentation and

a statement describing the effect on Work by separate or other contractors. Document any requested substitutions in accordance with Section 01 60 00.

- E. Computation of Change in Contract Amount:
 - 1. For change requested by Architect for work falling under a fixed price contract, the amount will be based on Contractor's price quotation.
 - 2. For change requested by Contractor, the amount will be based on the Contractor's request for a Change Order as approved by Architect.
- F. Execution of Change Orders: Architect will issue Change Orders for signatures of parties as provided in the Conditions of the Contract on AIA G701.
- G. After execution of Change Order, promptly revise Schedule of Values and Application for Payment forms to record each authorized Change Order as a separate line item and adjust the Contract Sum.
- H. Promptly revise progress schedules to reflect any change in Contract Time, revise sub-schedules to adjust times for other items of work affected by the change, and resubmit.
- I. Promptly enter changes in Project Record Documents.

1.05 APPLICATION FOR FINAL PAYMENT

- A. Prepare Application for Final Payment as specified for progress payments, identifying total adjusted Contract Sum, previous payments, and sum remaining due.
- B. Application for Final Payment will not be considered until the following have been accomplished:
 - 1. All closeout procedures specified in Section 01 70 00.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01 30 00

ADMINISTRATIVE REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Preconstruction meeting.
- B. Progress meetings.
- C. Construction progress schedule.
- D. Submittals for review, information, and project closeout.
- E. Number of copies of submittals.
- F. Submittal procedures.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 PRECONSTRUCTION MEETING

- A. Owner will schedule a meeting after Notice of Award.
- B. Attendance Required:
 - 1. Owner.
 - 2. Architect.
 - 3. Contractor.
- C. Agenda:
 - 1. Execution of Owner-Contractor Agreement.
 - 2. Submission of executed bonds and insurance certificates.
 - 3. Distribution of Contract Documents.
 - 4. Submission of list of Subcontractors, list of Products, schedule of values, and progress schedule.
 - 5. Designation of personnel representing the parties to Contract, Owner and Architect.
 - 6. Procedures and processing of field decisions, submittals, substitutions, applications for payments, proposal request, Change Orders, and Contract closeout procedures.
 - 7. Scheduling.
- D. Record minutes and distribute copies within two days after meeting to participants, with two copies to Architect, Owner, participants, and those affected by decisions made.

3.02 PROGRESS MEETINGS

- A. Schedule and administer meetings throughout progress of the Work at maximum weekly intervals.
- B. Make arrangements for meetings, prepare agenda with copies for participants, preside at meetings.
- C. Attendance Required: Job superintendent, major Subcontractors and suppliers, Owner, Architect, as appropriate to agenda topics for each meeting.
- D. Agenda:
 - 1. Review minutes of previous meetings.
 - 2. Review of Work progress.

3. Field observations, problems, and decisions.
 4. Identification of problems which impede planned progress.
 5. Review of submittals schedule and status of submittals.
 6. Maintenance of progress schedule.
 7. Corrective measures to regain projected schedules.
 8. Planned progress during succeeding work period.
 9. Maintenance of quality and work standards.
 10. Effect of proposed changes on progress schedule and coordination.
 11. Other business relating to Work.
- E. Record minutes and distribute copies within two days after meeting to participants, with two copies to Architect, Owner, participants, and those affected by decisions made.

3.03 CONSTRUCTION PROGRESS SCHEDULE

- A. Within 1 day after date of the Agreement, submit preliminary schedule defining planned operations for the first 60 days of Work, with a general outline for remainder of Work.
- B. If preliminary schedule requires revision after review, submit revised schedule within 5 days.
- C. Within 5 days after review of preliminary schedule, submit draft of proposed complete schedule for review.
 1. Include written certification that major contractors have reviewed and accepted proposed schedule.
- D. Within 5 days after joint review, submit complete schedule.
- E. Submit updated schedule every 30 days.

3.04 SUBMITTALS FOR REVIEW

- A. When the following are specified in individual sections, submit them for review:
 1. Product data.
 2. Shop drawings.
 3. Samples for selection.
 4. Samples for verification.
- B. Submit to Architect for review for the limited purpose of checking for conformance with information given and the design concept expressed in the contract documents.
- C. Samples will be reviewed only for aesthetic, color, or finish selection.
- D. After review, provide copies and distribute in accordance with SUBMITTAL PROCEDURES article below and for record documents purposes described in Section 01 78 00 - CLOSEOUT SUBMITTALS.

3.05 SUBMITTALS FOR INFORMATION

- A. When the following are specified in individual sections, submit them for information:
 1. Design data.
 2. Certificates.
 3. Test reports.
 4. Inspection reports.
 5. Manufacturer's instructions.
 6. Manufacturer's field reports.
 7. Other types indicated.
- B. Submit for Architect's knowledge as contract administrator or for Owner. No action will be taken.

3.06 SUBMITTALS FOR PROJECT CLOSEOUT

- A. When the following are specified in individual sections, submit them at project closeout:
 1. Project record documents.

2. Operation and maintenance data.
3. Warranties.
4. Bonds.
5. Other types as indicated.

B. Submit for Owner's benefit during and after project completion.

3.07 NUMBER OF COPIES OF SUBMITTALS

- A. Documents for Review:
 1. Small Size Sheets, Not Larger Than 8-1/2 x 11 inches: Submit the number of copies which the Contractor requires, plus two copies which will be retained by the Architect.
 2. Larger Sheets, Not Larger Than 36 x 48 inches: Submit the number of opaque reproductions which Contractor requires, plus two copies which will be retained by Architect.
- B. Documents for Information: Submit two copies.
- C. Documents for Project Closeout: Make one reproduction of submittal originally reviewed. Submit one extra of submittals for information.
- D. Samples: Submit the number specified in individual specification sections; one of which will be retained by Architect.
 1. After review, produce duplicates.
 2. Retained samples will not be returned to Contractor unless specifically so stated.

3.08 SUBMITTAL PROCEDURES

- A. Transmit each submittal with approved form.
- B. Sequentially number the transmittal form. Revise submittals with original number and a sequential alphabetic suffix.
- C. Identify Project, Contractor, Subcontractor or supplier; pertinent drawing and detail number, and specification section number, as appropriate on each copy.
- D. Apply Contractor's stamp, signed or initialed certifying that review, approval, verification of Products required, field dimensions, adjacent construction Work, and coordination of information is in accordance with the requirements of the Work and Contract Documents.
- E. Deliver submittals to Architect at business address.
- F. Schedule submittals to expedite the Project, and coordinate submission of related items.
- G. For each submittal for review, allow 15 days excluding delivery time to and from the Contractor.
- H. Identify variations from Contract Documents and Product or system limitations which may be detrimental to successful performance of the completed Work.
- I. Provide space for Contractor and Architect review stamps.
- J. When revised for resubmission, identify all changes made since previous submission.
- K. Distribute copies of reviewed submittals as appropriate. Instruct parties to promptly report any inability to comply with requirements.
- L. Submittals not requested will not be recognized or processed.

END OF SECTION

SECTION 01 40 00

QUALITY REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. References and standards.
- B. Quality assurance submittals.
- C. Mock-ups.
- D. Control of installation.
- E. Tolerances.
- F. Testing and inspection services.
- G. Manufacturers' field services.

1.02 SUBMITTALS

- A. Test Reports: After each test/inspection, promptly submit two copies of report to Architect and to Contractor.
 - 1. Test reports are submitted for Architect's knowledge as contract administrator or for the Owner, for information for the limited purpose of assessing conformance with information given and the design concept expressed in the contract documents.
- B. Certificates: When specified in individual specification sections, submit certification by the manufacturer and Contractor or installation/application subcontractor to Architect, in quantities specified for Product Data.
 - 1. Indicate material or product conforms to or exceeds specified requirements. Submit supporting reference data, affidavits, and certifications as appropriate.
 - 2. Certificates may be recent or previous test results on material or product, but must be acceptable to Architect.
- C. Manufacturer's Instructions: When specified in individual specification sections, submit printed instructions for delivery, storage, assembly, installation, start-up, adjusting, and finishing, for the Owner's information. Indicate special procedures, perimeter conditions requiring special attention, and special environmental criteria required for application or installation.
- D. Manufacturer's Field Reports: Submit reports for Architect's benefit as contract administrator or for Owner.
 - 1. Submit for information for the limited purpose of assessing conformance with information given and the design concept expressed in the contract documents.

1.03 REFERENCES AND STANDARDS

- A. For products and workmanship specified by reference to a document or documents not included in the Project Manual, also referred to as reference standards, comply with requirements of the standard, except when more rigid requirements are specified or are required by applicable codes.
- B. Conform to reference standard of date of issue current on date of Contract Documents, except where a specific date is established by applicable code.
- C. Obtain copies of standards where required by product specification sections.
- D. Maintain copy at project site during submittals, planning, and progress of the specific work, until Substantial Completion.

- E. Should specified reference standards conflict with Contract Documents, request clarification from Architect before proceeding.
- F. Neither the contractual relationships, duties, or responsibilities of the parties in Contract nor those of Architect shall be altered from the Contract Documents by mention or inference otherwise in any reference document.

1.04 TESTING AND INSPECTION AGENCIES

- A. Contractor shall employ and pay for services of an independent testing agency to perform other specified testing.
- B. Employment of agency in no way relieves Contractor of obligation to perform Work in accordance with requirements of Contract Documents.
- C. Contractor Employed Agency:
 - 1. Testing agency: Comply with requirements of ASTM E 329, ASTM E 543, and ASTM C 1077.
 - 2. Laboratory: Authorized to operate in Phoenix, Arizona.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 CONTROL OF INSTALLATION

- A. Monitor quality control over suppliers, manufacturers, products, services, site conditions, and workmanship, to produce Work of specified quality.
- B. Comply with manufacturers' instructions, including each step in sequence.
- C. Should manufacturers' instructions conflict with Contract Documents, request clarification from Architect before proceeding.
- D. Comply with specified standards as minimum quality for the Work except where more stringent tolerances, codes, or specified requirements indicate higher standards or more precise workmanship.
- E. Have Work performed by persons qualified to produce required and specified quality.
- F. Verify that field measurements are as indicated on shop drawings or as instructed by the manufacturer.
- G. Secure products in place with positive anchorage devices designed and sized to withstand stresses, vibration, physical distortion, and disfigurement.

3.02 MOCK-UPS

- A. Tests will be performed under provisions identified in this section and identified in the respective product specification sections.
- B. Assemble and erect specified items with specified attachment and anchorage devices, flashings, seals, and finishes.
- C. Accepted mock-ups shall be a comparison standard for the remaining Work.
- D. Where mock-up has been accepted by Architect and is specified in product specification sections to be removed, remove mock-up and clear area when directed to do so.

3.03 TOLERANCES

- A. Monitor fabrication and installation tolerance control of products to produce acceptable Work. Do not permit tolerances to accumulate.

- B. Comply with manufacturers' tolerances. Should manufacturers' tolerances conflict with Contract Documents, request clarification from Architect before proceeding.
- C. Adjust products to appropriate dimensions; position before securing products in place.

3.04 TESTING AND INSPECTION

- A. See individual specification sections for testing required.
- B. Testing Agency Duties:
 - 1. Provide qualified personnel at site. Cooperate with Architect and Contractor in performance of services.
 - 2. Perform specified sampling and testing of products in accordance with specified standards.
 - 3. Ascertain compliance of materials and mixes with requirements of Contract Documents.
 - 4. Promptly notify Architect and Contractor of observed irregularities or non-conformance of Work or products.
 - 5. Perform additional tests and inspections required by Architect.
 - 6. Submit reports of all tests/inspections specified.
- C. Limits on Testing/Inspection Agency Authority:
 - 1. Agency may not release, revoke, alter, or enlarge on requirements of Contract Documents.
 - 2. Agency may not approve or accept any portion of the Work.
 - 3. Agency may not assume any duties of Contractor.
 - 4. Agency has no authority to stop the Work.
- D. Contractor Responsibilities:
 - 1. Deliver to agency at designated location, adequate samples of materials proposed to be used which require testing, along with proposed mix designs.
 - 2. Cooperate with laboratory personnel, and provide access to the Work and to manufacturers' facilities.
 - 3. Provide incidental labor and facilities:
 - a. To provide access to Work to be tested/inspected.
 - b. To obtain and handle samples at the site or at source of Products to be tested/inspected.
 - c. To facilitate tests/inspections.
 - d. To provide storage and curing of test samples.
 - 4. Notify Architect and laboratory 24 hours prior to expected time for operations requiring testing/inspection services.
 - 5. Employ services of an independent qualified testing laboratory and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.
 - 6. Arrange with Owner's agency and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.
- E. Re-testing required because of non-conformance to specified requirements shall be performed by the same agency on instructions by Architect. Payment for re testing will be charged to the Contractor by deducting testing charges from the Contract Price.

3.05 MANUFACTURERS' FIELD SERVICES

- A. When specified in individual specification sections, require material or product suppliers or manufacturers to provide qualified staff personnel to observe site conditions, conditions of surfaces and installation, quality of workmanship, start-up of equipment, test, adjust and balance of equipment as applicable, and to initiate instructions when necessary.
- B. Report observations and site decisions or instructions given to applicators or installers that are supplemental or contrary to manufacturers' written instructions.

3.06 DEFECT ASSESSMENT

- A. Replace Work or portions of the Work not conforming to specified requirements.

- B. If, in the opinion of Architect, it is not practical to remove and replace the Work, Architect will direct an appropriate remedy or adjust payment.

END OF SECTION

SECTION 01 50 00

TEMPORARY FACILITIES AND CONTROLS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Temporary utilities.
- B. Temporary telephone service.
- C. Temporary sanitary facilities.
- D. Temporary Controls: Barriers, enclosures, and fencing.
- E. Security requirements.
- F. Vehicular access and parking.
- G. Waste removal facilities and services.
- H. Project identification sign.
- I. Field offices.

1.02 TEMPORARY UTILITIES

- A. Provide and pay for all electrical power, lighting, water, heating and cooling, and ventilation required for construction purposes beyond those made available by Owner.
- B. Existing facilities may be used.
- C. Use trigger-operated nozzles for water hoses, to avoid waste of water.

1.03 TELEPHONE SERVICE

- A. Provide, maintain, and pay for telephone service to field office if required at time of project mobilization.
- B. Telephone service may be provided through a mobile phone service.

1.04 TEMPORARY SANITARY FACILITIES

- A. Provide and maintain required facilities and enclosures. Provide at time of project mobilization.
- B. New permanent facilities may not be used during construction operations.
- C. Maintain daily in clean and sanitary condition.
- D. At end of construction, return facilities to same or better condition as originally found.

1.05 BARRIERS

- A. Provide barriers to prevent unauthorized entry to construction areas and to protect existing facilities and adjacent properties from damage from construction operations and demolition.
- B. Protect non-owned vehicular traffic, stored materials, site, and structures from damage.

1.06 FENCING

- A. Provide 8-foot-high fence around construction site; equip with vehicular and pedestrian gates with locks.

1.07 EXTERIOR ENCLOSURES

- A. Provide temporary weather tight closure of exterior openings to accommodate acceptable working conditions and protection for Products, to allow for temporary heating and maintenance

of required ambient temperatures identified in individual specification sections, and to prevent entry of unauthorized persons. Provide access doors with self-closing hardware and locks.

1.08 SECURITY

- A. Provide security and facilities to protect Work, existing facilities, and Owner's operations from unauthorized entry, vandalism, or theft.
- B. Coordinate with Owner's security program.

1.09 VEHICULAR ACCESS AND PARKING

- A. Coordinate access and haul routes with governing authorities and Owner.
- B. Provide and maintain access to fire hydrants, free of obstructions.
- C. Provide means of removing mud from vehicle wheels before entering streets.
- D. Provide temporary parking areas to accommodate construction personnel. When site space is not adequate, provide additional off-site parking.

1.10 WASTE REMOVAL

- A. Provide waste removal facilities and services as required to maintain the site in clean and orderly condition.
- B. Provide containers with lids. Remove trash from site periodically.
- C. If materials to be recycled or re-used on the project must be stored on-site, provide suitable non-combustible containers; locate containers holding flammable material outside the structure unless otherwise approved by the authorities having jurisdiction.
- D. Open free-fall chutes are not permitted. Terminate closed chutes into appropriate containers with lids.

1.11 PROJECT IDENTIFICATION

- A. Provide project identification sign of design and construction indicated on Drawings.
- B. Erect on site at location indicated.
- C. No other signs are allowed without Owner permission except those required by law.

1.12 FIELD OFFICES

- A. Office: Weathertight, with lighting, electrical outlets, heating, cooling equipment, and equipped with sturdy furniture and drawing display table if required by the Owner.
- B. Provide space for Project meetings, with table and chairs to accommodate 6 persons.
- C. Locate offices a minimum distance of 30 feet from existing structures.
- D. District will provide a classroom space for a temporary field office. Contractor shall return the space to the district in the same or better condition upon completion.

1.13 REMOVAL OF UTILITIES, FACILITIES, AND CONTROLS

- A. Remove temporary utilities, equipment, facilities, materials, prior to Substantial Completion inspection.
- B. Clean and repair damage caused by installation or use of temporary work.
- C. Restore existing facilities used during construction to original condition.
- D. Restore new permanent facilities used during construction to specified condition.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01 60 00

PRODUCT REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. General product requirements.
- B. Re-use of existing products.
- C. Transportation, handling, storage and protection.
- D. Product option requirements.
- E. Substitution limitations and procedures.
- F. Spare parts and maintenance materials.

1.02 SUBMITTALS

- A. Product Data Submittals: Submit manufacturer's standard published data. Mark each copy to identify applicable products, models, options, and other data. Supplement manufacturers' standard data to provide information specific to this Project.
- B. Shop Drawing Submittals: Prepared specifically for this Project; indicate utility and electrical characteristics, utility connection requirements, and location of utility outlets for service for functional equipment and appliances.
- C. Sample Submittals: Illustrate functional and aesthetic characteristics of the product, with integral parts and attachment devices. Coordinate sample submittals for interfacing work.
 - 1. For selection from standard finishes, submit samples of the full range of the manufacturer's standard colors, textures, and patterns.

PART 2 PRODUCTS

2.01 EXISTING PRODUCTS

- A. Do not use materials and equipment removed from existing premises unless specifically required or permitted by the Contract Documents.
- B. Existing materials and equipment indicated to be removed, but not to be re-used, relocated, reinstalled, delivered to the Owner, or otherwise indicated as to remain the property of the Owner, become the property of the Contractor; remove from site.
- C. Reused Products: Reused products include materials and equipment previously used in this or other construction, salvaged and refurbished as specified.

2.02 NEW PRODUCTS

- A. Provide new products unless specifically required or permitted by the Contract Documents.
- B. Do not use products having any of the following characteristics:
 - 1. Made using or containing CFC's or HCFC's.
- C. Adhesives and Joint Sealants:
 - 1. Definition: This provision applies to gunnable, trowelable, and liquid-applied adhesives, sealants, and sealant primers used anywhere on the interior of the building inside the weather barrier, including duct sealers.
 - 2. Specific Product Categories: Comply with limitations specified elsewhere.

2.03 PRODUCT OPTIONS

- A. Products Specified by Reference Standards or by Description Only: Use any product meeting those standards or description.
- B. Products Specified by Naming One or More Manufacturers: Use a product of one of the manufacturers named and meeting specifications, no options or substitutions allowed.
- C. Products Specified by Naming One or More Manufacturers with a Provision for Substitutions: Submit a request for substitution for any manufacturer not named.

2.04 SPARE PARTS AND MAINTENANCE PRODUCTS

- A. Provide spare parts, maintenance, and extra products of types and in quantities specified in individual specification sections.
- B. Deliver to Project site; obtain receipt prior to final payment.

PART 3 EXECUTION

3.01 SUBSTITUTION PROCEDURES

- A. Instructions to Bidders specify time restrictions for submitting requests for substitutions during the bidding period. Comply with requirements specified in this section.
- B. Document each request with complete data substantiating compliance of proposed substitution with Contract Documents.
- C. A request for substitution constitutes a representation that the submitter:
 - 1. Has investigated proposed product and determined that it meets or exceeds the quality level of the specified product.
 - 2. Will provide the same warranty for the substitution as for the specified product.
 - 3. Will coordinate installation and make changes to other Work which may be required for the Work to be complete with no additional cost to Owner.
 - 4. Waives claims for additional costs or time extension which may subsequently become apparent.
- D. Substitutions will not be considered when they are indicated or implied on shop drawing or product data submittals, without separate written request, or when acceptance will require revision to the Contract Documents.
- E. Substitution Submittal Procedure:
 - 1. Submit three copies of request for substitution for consideration. Limit each request to one proposed substitution.
 - 2. Submit shop drawings, product data, and certified test results attesting to the proposed product equivalence. Burden of proof is on proposer.
 - 3. The Architect will notify Contractor in writing of decision to accept or reject request.

3.02 TRANSPORTATION AND HANDLING

- A. Coordinate schedule of product delivery to designated prepared areas in order to minimize site storage time and potential damage to stored materials.
- B. Transport and handle products in accordance with manufacturer's instructions.
- C. Transport materials in covered trucks to prevent contamination of product and littering of surrounding areas.
- D. Promptly inspect shipments to ensure that products comply with requirements, quantities are correct, and products are undamaged.
- E. Provide equipment and personnel to handle products by methods to prevent soiling, disfigurement, or damage.

- F. Arrange for the return of packing materials, such as wood pallets, where economically feasible.

3.03 STORAGE AND PROTECTION

- A. Designate receiving/storage areas for incoming products so that they are delivered according to installation schedule and placed convenient to work area in order to minimize waste due to excessive materials handling and misapplication.
- B. Store and protect products in accordance with manufacturers' instructions.
- C. Store with seals and labels intact and legible.
- D. Store sensitive products in weather tight, climate controlled, enclosures in an environment favorable to product.
- E. For exterior storage of fabricated products, place on sloped supports above ground.
- F. Cover products subject to deterioration with impervious sheet covering. Provide ventilation to prevent condensation and degradation of products.
- G. Prevent contact with material that may cause corrosion, discoloration, or staining.
- H. Provide equipment and personnel to store products by methods to prevent soiling, disfigurement, or damage.
- I. Arrange storage of products to permit access for inspection. Periodically inspect to verify products are undamaged and are maintained in acceptable condition.

END OF SECTION

SECTION 01 70 00

EXECUTION AND CLOSEOUT REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Examination, preparation, and general installation procedures.
- B. Requirements for alterations work, including selective demolition.
- C. Cutting and patching.
- D. Cleaning and protection.
- E. Starting of systems and equipment.
- F. Demonstration and instruction of Owner personnel.
- G. Closeout procedures, except payment procedures.

1.02 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Cutting and Patching: Submit written request in advance of cutting or alteration which affects:
 - 1. Structural integrity of any element of Project.
 - 2. Integrity of weather exposed or moisture resistant element.
 - 3. Efficiency, maintenance, or safety of any operational element.
 - 4. Visual qualities of sight exposed elements.

1.03 PROJECT CONDITIONS

- A. Ventilate enclosed areas to assist cure of materials, to dissipate humidity, and to prevent accumulation of dust, fumes, vapors, or gases.
- B. Dust Control: Execute work by methods to minimize raising dust from construction operations. Provide positive means to prevent air-borne dust from dispersing into atmosphere.
- C. Noise Control: Provide methods, means, and facilities to minimize noise produced by construction operations.
- D. Pollution Control: Provide methods, means, and facilities to prevent contamination of soil, water, and atmosphere from discharge of noxious, toxic substances, and pollutants produced by construction operations.

1.04 COORDINATION

- A. Coordinate scheduling, submittals, and work of the various sections of the Project Manual to ensure efficient and orderly sequence of installation of interdependent construction elements, with provisions for accommodating items installed later.
- B. Notify affected utility companies and comply with their requirements.
- C. Verify that utility requirements and characteristics of new operating equipment are compatible with building utilities. Coordinate work of various sections having interdependent responsibilities for installing, connecting to, and placing in service, such equipment.
- D. Coordinate space requirements, supports, and installation of mechanical and electrical work which are indicated diagrammatically on Drawings. Follow routing shown for pipes, ducts, and conduit, as closely as practicable; place runs parallel with lines of building. Utilize spaces efficiently to maximize accessibility for other installations, for maintenance, and for repairs.

- E. In finished areas except as otherwise indicated, conceal pipes, ducts, and wiring within the construction. Coordinate locations of fixtures and outlets with finish elements.
- F. Coordinate completion and clean-up of work of separate sections.
- G. After Owner occupancy of premises, coordinate access to site for correction of defective work and work not in accordance with Contract Documents, to minimize disruption of Owner's activities.

PART 2 PRODUCTS

2.01 PATCHING MATERIALS

- A. New Materials: As specified in product sections; match existing products and work for patching and extending work.
- B. Type and Quality of Existing Products: Determine by inspecting and testing products where necessary, referring to existing work as a standard.
- C. Product Substitution: For any proposed change in materials, submit request for substitution described in Section 01 60 00.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that existing site conditions and substrate surfaces are acceptable for subsequent work. Start of work means acceptance of existing conditions.
- B. Verify that existing substrate is capable of structural support or attachment of new work being applied or attached.
- C. Examine and verify specific conditions described in individual specification sections.
- D. Take field measurements before confirming product orders or beginning fabrication, to minimize waste due to over-ordering or misfabrication.
- E. Verify that utility services are available, of the correct characteristics, and in the correct locations.
- F. Prior to Cutting: Examine existing conditions prior to commencing work, including elements subject to damage or movement during cutting and patching. After uncovering existing work, assess conditions affecting performance of work. Beginning of cutting or patching means acceptance of existing conditions.

3.02 PREPARATION

- A. Clean substrate surfaces prior to applying next material or substance.
- B. Seal cracks or openings of substrate prior to applying next material or substance.
- C. Apply manufacturer required or recommended substrate primer, sealer, or conditioner prior to applying any new material or substance in contact or bond.

3.03 GENERAL INSTALLATION REQUIREMENTS

- A. Install products as specified in individual sections, in accordance with manufacturer's instructions and recommendations, and so as to avoid waste due to necessity for replacement.
- B. Make vertical elements plumb and horizontal elements level, unless otherwise indicated.
- C. Install equipment and fittings plumb and level, neatly aligned with adjacent vertical and horizontal lines, unless otherwise indicated.

- D. Make consistent texture on surfaces, with seamless transitions, unless otherwise indicated.
- E. Make neat transitions between different surfaces, maintaining texture and appearance.

3.04 ALTERATIONS

- A. Drawings showing existing construction and utilities are based on casual field observation and existing record documents only.
 - 1. Verify that construction and utility arrangements are as shown.
 - 2. Report discrepancies to Architect before disturbing existing installation.
 - 3. Beginning of alterations work constitutes acceptance of existing conditions.
- B. Maintain weatherproof exterior building enclosure except for interruptions required for replacement or modifications; take care to prevent water and humidity damage.
 - 1. Where openings in exterior enclosure exist, provide construction to make exterior enclosure weatherproof.
 - 2. Insulate existing ducts or pipes that are exposed to outdoor ambient temperatures by alterations work.
- C. Remove existing work as indicated and as required to accomplish new work.
 - 1. Remove rotted wood, corroded metals, and deteriorated concrete; replace with new construction specified.
 - 2. Remove items indicated on drawings.
 - 3. Where new surface finishes are to be applied to existing work, perform removals, patch, and prepare existing surfaces as required to receive new finish; remove existing finish if necessary for successful application of new finish.
 - 4. Where new surface finishes are not specified or indicated, patch holes and damaged surfaces to match adjacent finished surfaces as closely as possible.
- D. Services (Including but not limited to HVAC, Plumbing, Fire Protection, Electrical, and Telecommunications): Remove, relocate, and extend existing systems to accommodate new construction.
 - 1. Maintain existing active systems that are to remain in operation; maintain access to equipment and operational components; if necessary, modify installation to allow access or provide access panel.
 - 2. Where existing systems or equipment are not active and Contract Documents require reactivation, put back into operational condition; repair supply, distribution, and equipment as required.
 - 3. Where existing active systems serve occupied facilities but are to be replaced with new services, maintain existing systems in service until new systems are complete and ready for service.
 - a. Disable existing systems only to make switchovers and connections; minimize duration of outages.
 - b. Provide temporary connections as required to maintain existing systems in service.
 - 4. Verify that abandoned services serve only abandoned facilities.
 - 5. Remove abandoned pipe, ducts, conduits, and equipment, including those above accessible ceilings; remove back to source of supply where possible, otherwise cap stub and tag with identification; patch holes left by removal using materials specified for new construction.
- E. Protect existing work to remain.
 - 1. Prevent movement of structure; provide shoring and bracing if necessary.
 - 2. Perform cutting to accomplish removals neatly and as specified for cutting new work.
 - 3. Repair adjacent construction and finishes damaged during removal work.
 - 4. Patch as specified for patching new work.
- F. Adapt existing work to fit new work:
 - 1. Where removal of partitions or walls results in adjacent spaces becoming one, rework floors, walls, and ceilings to a smooth plane without breaks, steps, or bulkheads.
 - 2. Where a change of plane of 1/4 inch or more occurs in existing work, submit

recommendation for providing a smooth transition for Architect review and request instructions.

- G. Refinish existing surfaces as indicated:
 - 1. Where materials are indicated to be refinished, refinish all visible existing surfaces to remain to the specified condition for each material, with a neat transition to adjacent finishes.
 - 2. If mechanical or electrical work is exposed accidentally during the work, re-cover and refinish to match.
 - 3. Patch as specified for patching new work.
- H. Clean existing systems and equipment.
- I. Remove demolition debris and abandoned items from alterations areas and dispose of off-site; do not burn or bury.
- J. Do not begin new construction in alterations areas before demolition is complete.
- K. Comply with all other applicable requirements of this section.

3.05 CUTTING AND PATCHING

- A. Execute cutting and patching to complete the work, to uncover work in order to install improperly sequenced work, to remove and replace defective or non-conforming work, to remove samples of installed work for testing when requested, to provide openings in the work for penetration of mechanical and electrical work, to execute patching to complement adjacent work, and to fit products together to integrate with other work.
- B. Execute work by methods to avoid damage to other work, and which will provide appropriate surfaces to receive patching and finishing. In existing work, minimize damage and restore to original condition.
- C. Cut rigid materials using masonry saw or core drill. Pneumatic tools not allowed without prior approval.
- D. Restore work with new products in accordance with requirements of Contract Documents.
- E. Fit work air tight to pipes, sleeves, ducts, conduit, and other penetrations through surfaces.
- F. Refinish surfaces to match adjacent finish. For continuous surfaces, refinish to nearest intersection or natural break. For an assembly, refinish entire unit.
- G. Make neat transitions. Patch work to match adjacent work in texture and appearance. Where new work abuts or aligns with existing, perform a smooth and even transition.

3.06 PROGRESS CLEANING

- A. Maintain areas free of waste materials, debris, and rubbish. Maintain site in a clean and orderly condition.
- B. Remove debris and rubbish from pipe chases, plenums, attics, crawl spaces, and other closed or remote spaces, prior to enclosing the space.
- C. Broom and vacuum clean interior areas if materials fall into space during roofing activities and continue cleaning to eliminate dust.
- D. Collect and remove waste materials, debris, and trash/rubbish from site periodically and dispose off-site; do not burn or bury.

3.07 PROTECTION OF INSTALLED WORK

- A. Protect installed work from damage by construction operations.
- B. Provide special protection where specified in individual specification sections.

- C. Provide temporary and removable protection for installed products. Control activity in immediate work area to prevent damage.
- D. Provide protective coverings at walls, projections and soffits of openings.
- E. Protect finished floors, stairs, and other surfaces from traffic, dirt, wear, damage, or movement of heavy objects, by protecting with durable sheet materials.
- F. Prohibit traffic or storage upon roofed surfaces. If traffic or activity is necessary, obtain recommendations for protection from roofing material manufacturer.
- G. Remove protective coverings when no longer needed; reuse or recycle plastic coverings if possible.

3.08 STARTING SYSTEMS

- A. Coordinate schedule for start-up of various equipment and systems that were disassembled during roofing activities.
- B. Verify that each piece of equipment or system has been checked for proper lubrication, drive rotation, belt tension, control sequence, and for conditions which may cause damage.
- C. Verify tests, meter readings, and specified electrical characteristics agree with those required by the equipment or system manufacturer.
- D. Verify that wiring and support components for equipment are complete and tested.
- E. Execute start-up under supervision of applicable Contractor personnel and manufacturer's representative in accordance with manufacturers' instructions.
- F. Submit a written report that equipment or system has been properly installed and is functioning correctly.

3.09 DEMONSTRATION AND INSTRUCTION

- A. Demonstrate operation and maintenance of products to Owner's personnel two weeks prior to date of Substantial Completion.
- B. Demonstrate start-up, operation, control, adjustment, trouble-shooting, servicing, maintenance, and shutdown of each item of equipment at scheduled time, at equipment location.
- C. For equipment or systems requiring seasonal operation, perform demonstration for other season within six months.
- D. Provide a qualified person who is knowledgeable about the Project to perform demonstration and instruction of owner personnel.

3.10 ADJUSTING

- A. Adjust operating products and equipment to ensure smooth and unhindered operation.

3.11 FINAL CLEANING

- A. Use cleaning materials that are nonhazardous.
- B. Clean interior if required from roofing debris falling into space and exterior glass, surfaces exposed to view and stains and foreign substances, polish transparent and glossy surfaces, vacuum carpeted and soft surfaces.
- C. Clean equipment and fixtures to a sanitary condition with cleaning materials appropriate to the surface and material being cleaned.
- D. Clean filters of operating equipment.
- E. Clean debris from roofs, gutters, downspouts, and drainage systems.
- F. Clean site; sweep paved areas, rake clean landscaped surfaces.

- G. Remove waste, surplus materials, trash/rubbish, and construction facilities from the site; dispose of in legal manner; do not burn or bury.

3.12 CLOSEOUT PROCEDURES

- A. Make submittals that are required by governing or other authorities.
- B. Notify Architect when work is considered ready for Substantial Completion.
- C. Submit written certification that Contract Documents have been reviewed, work has been inspected, and that work is complete in accordance with Contract Documents and ready for Architect's review.
- D. Correct items of work listed in executed Certificates of Substantial Completion and comply with requirements for access to Owner-occupied areas.
- E. Notify Architect when work is considered finally complete.
- F. Complete items of work determined by Architect's final inspection.

END OF SECTION

SECTION 01 78 00

CLOSEOUT SUBMITTALS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Project Record Documents.
- B. Operation and Maintenance Data.
- C. Warranties and Bonds.

1.02 RELATED SECTIONS

- A. Section 01 30 00 - Administrative Requirements: Submittals procedures, shop drawings, product data, and samples.
- B. Individual Product Sections: Specific requirements for operation and maintenance data.
- C. Individual Product Sections: Warranties required for specific products or Work.

1.03 SUBMITTALS

- A. Project Record Documents: Submit documents to Architect with claim for final Application for Payment.
- B. Operation and Maintenance Data:
 - 1. Submit two copies of preliminary draft or proposed formats and outlines of contents before start of Work. Architect will review draft and return one copy with comments.
 - 2. For equipment, or component parts of equipment put into service during construction and operated by Owner, submit completed documents within ten days after acceptance.
 - 3. Submit 1 copy of completed documents 15 days prior to final inspection. This copy will be reviewed and returned after final inspection, with Architect comments. Revise content of all document sets as required prior to final submission.
 - 4. Submit two sets of revised final documents in final form within 10 days after final inspection.
- C. Warranties and Bonds:
 - 1. For equipment or component parts of equipment put into service during construction with Owner's permission, submit documents within ten days after acceptance.
 - 2. Make other submittals within ten days after Date of Substantial Completion, prior to final Application for Payment.
 - 3. For items of Work for which acceptance is delayed beyond Date of Substantial Completion, submit within ten days after acceptance, listing the date of acceptance as the beginning of the warranty period.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 PROJECT RECORD DOCUMENTS

- A. Maintain on site one set of the following record documents; record actual revisions to the Work:
 - 1. Drawings.
 - 2. Addenda.
 - 3. Change Orders and other modifications to the Contract.
 - 4. Reviewed shop drawings, product data, and samples.

- B. Ensure entries are complete and accurate, enabling future reference by Owner.
- C. Store record documents separate from documents used for construction.
- D. Record information concurrent with construction progress.
- E. Record Drawings and Shop Drawings: Legibly mark each item to record actual construction including:
 - 1. Field changes of dimension and detail.
 - 2. Details not on original Contract drawings.

3.02 OPERATION AND MAINTENANCE DATA

- A. For Each Product or System: List names, addresses and telephone numbers of Subcontractors and suppliers, including local source of supplies and replacement parts.
- B. Product Data: Mark each sheet to clearly identify specific products and component parts, and data applicable to installation. Delete inapplicable information.
- C. Drawings: Supplement product data to illustrate relations of component parts of equipment and systems, to show control and flow diagrams. Do not use Project Record Documents as maintenance drawings.
- D. Typed Text: As required to supplement product data. Provide logical sequence of instructions for each procedure, incorporating manufacturer's instructions.

3.03 OPERATION AND MAINTENANCE MANUALS

- A. Prepare instructions and data by personnel experienced in maintenance and operation of described products.
- B. Prepare data in the form of an instructional manual.
- C. Binders: Commercial quality, 8-1/2 x 11 inch three D side ring binders with durable plastic covers; 2 inch maximum ring size. When multiple binders are used, correlate data into related consistent groupings.
- D. Cover: Identify binder with typed or printed title OPERATION AND MAINTENANCE INSTRUCTIONS; identify title of Project; identify subject matter of contents.
- E. Provide tabbed dividers for each separate product and system, with typed description of product and major component parts of equipment.
- F. Text: Manufacturer's printed data, or typewritten data on 24 pound paper.
- G. Drawings: Provide with reinforced punched binder tab. Bind in with text; fold larger drawings to size of text pages.
- H. Arrange content by systems under section numbers and sequence of Table of Contents of this Project Manual.
- I. Contents: Prepare a Table of Contents for each volume, with each product or system description identified, in three parts as follows:
 - 1. Part 1: Directory, listing names, addresses, and telephone numbers of Architect, Contractor, Subcontractors, and major equipment suppliers.
 - 2. Part 2: Operation and maintenance instructions, arranged by system and subdivided by specification section. For each category, identify names, addresses, and telephone numbers of Subcontractors and suppliers. Identify the following:
 - a. Significant design criteria.
 - b. List of equipment.
 - c. Parts list for each component.
 - d. Operating instructions.
 - e. Maintenance instructions for equipment and systems.

3. Part 3: Project documents and certificates, including the following:
 - a. Shop drawings and product data.
 - b. Certificates.
 - c. Photocopies of warranties and bonds.

3.04 WARRANTIES AND BONDS

- A. Obtain warranties and bonds, executed in duplicate by responsible Subcontractors, suppliers, and manufacturers, within ten days after completion of the applicable item of work. Except for items put into use with Owner's permission, leave date of beginning of time of warranty until the Date of Substantial completion is determined.
- B. Verify that documents are in proper form, contain full information, and are notarized.
- C. Co-execute submittals when required.
- D. Retain warranties and bonds until time specified for submittal.
- E. Include originals of each in operation and maintenance manuals, indexed separately on Table of Contents.

END OF SECTION

SECTION 02 22 50

PARTIAL DEMOLITION FOR REMODELING

PART 1 GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Demolishing designated building equipment and fixtures.
 - 2. Demolishing designated construction.
 - 3. Cutting and alterations for completion of the Work.
 - 4. Removing designated items for reuse and Owner's retention.
 - 5. Protecting items designated to remain.
 - 6. Removing demolished materials.
- B. Related Sections:
 - 1. None.

1.2 SUBMITTALS

- A. Requirements for submittals.
- B. Describe demolition removal procedures and schedule.
- C. Shop Drawings:
 - 1. Indicate demolition and removal sequence.
 - 2. Indicate location of items designated for reuse and Owner's retention.
 - 3. Indicate location and construction of temporary work.

1.3 CLOSEOUT SUBMITTALS

- A. Requirements for submittals.
- B. Project Record Documents: Accurately record actual locations of capped utilities and subsurface obstructions.
- C. Operation and Maintenance Data: Submit description of system, inspection data, and parts lists.

1.4 QUALITY ASSURANCE

- A. Conform to applicable local code for demolition work, dust control, products requiring electrical disconnection and re-connection.
- B. Conform to applicable codes for procedures when hazardous or contaminated materials are discovered.

- C. Obtain required permits from authorities having jurisdiction.
- D. Perform Work in accordance with local building codes.

1.5 SCHEDULING

- A. Schedule Work to coincide with new construction.
- B. Perform noisy, malodorous and dusty work:
 - 1. Between hours of 3:00pm and 5:30am on school days.
 - OR
 - 2. On following days: Saturdays or as approved by the district.
 - 3. Monday through Friday if School is closed for Summer, Spring Break or Winter Break.

PART 2 PRODUCTS

Not Used

PART 3 EXECUTION

3.1 PREPARATION

- A. Notify affected utility companies before starting work and comply with their requirements.
- B. Mark location and termination of utilities.
- C. Erect, and maintain temporary barriers and security devices as required including warning signs and lights, and similar measures, for protection of the public, Owner, and existing improvements indicated to remain.
- D. Erect and maintain weatherproof closures for exterior openings.
- E. Erect and maintain temporary partitions to prevent spread of dust, odors, and noise to permit continued Owner occupancy.
- F. Prevent movement of structure; provide temporary bracing and shoring required to ensure safety of existing structure.
- G. Provide appropriate temporary signage including signage for exit or building egress.
- H. Do not close or obstruct building egress path.
- I. Do not disable or disrupt building fire or life safety systems without 3 days prior written notice to Owner.

3.2 SALVAGE REQUIREMENTS

- A. Coordinate with Owner to identify building components and equipment required to be removed and delivered to Owner.
- B. Tag components and equipment Owner designates for salvage.
- C. Protect designated salvage items from demolition operations until items can be removed.
- D. Carefully remove building components and equipment indicated to be salvaged.
- E. Disassemble as required to permit removal from building.
- F. Package small and loose parts to avoid loss.
- G. Mark equipment and packaged parts to permit identification and consolidation of components of each salvaged item.
- H. Prepare assembly instructions consistent with disassembled parts. Package assembly instructions in protective envelope and securely attach to each disassembled salvaged item.
- I. Deliver salvaged items to Owner. Obtain signed receipt from Owner.

3.3 DEMOLITION

- A. Conduct demolition to minimize interference with adjacent and occupied building areas.
- B. Cease operations immediately when structure appears to be in danger and notify Architect/Engineer.
- C. Disconnect remove, cap, and identify designated utilities within demolition areas.
- D. Demolish in orderly and careful manner. Protect existing improvements, supporting structural members and protecting existing finishes.
- E. Carefully remove building components indicated to be reused.
 - 1. Disassemble components as required to permit removal.
 - 2. Package small and loose parts to avoid loss.
 - 3. Mark components and packaged parts to permit reinstallation.
 - 4. Store components, protected from construction operations, until reinstalled.
- F. Remove demolished materials from site except where specifically noted otherwise. Do not burn or bury materials on site.
- G. Remove materials as Work progresses. Upon completion of Work, leave areas in clean condition.
- H. Remove temporary Work.

3.4 SCHEDULES

- A. Remove, store and protect the following materials and equipment:
 - 1. Mechanical to be removed and reinstalled after curbs are raised.

END OF SECTION

SECTION 07550
MODIFIED BITUMEN ROOFING

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. 2-Ply Low Sloped Roofing
- B. Edge Treatment and Roof Penetration Flashings.

1.2 SUMMARY OF WORK – All Modified Bituminous Membranes Must Be Manufactured/Supplied and Warranted by One Manufacturer.

- A. Scope of Work:
 - 1. Remove existing roofing assembly down to light weight concrete or structural deck.
 - 2. Install polyisocyanurate insulation (1.5-inch min.) See roof plans for depth of insulation. Verify if insulation can be saved prior to roof demolition of each section.
 - 3. Fully adhere ½" asphalt coated wood fiberboard insulation (recovery board) in Type IV asphalt.
 - 4. Install factory tapered crickets as required to create positive slope to drains.
 - 5. Install perlite cant strips at all 90 degree angles.
 - 6. In field, fully adhere one ply of SBS modified smooth surfaced membrane with specified tensile and tear strengths in Type IV asphalt.
 - 7. In field, fully adhere one ply of modified surfacing membrane with specified tensile and tear strengths in Type IV asphalt.
 - 8. At all base flashings, fully adhere one ply of modified smooth surfaced membrane with specified tensile and tear strengths in Type IV asphalt.
 - 9. Over smooth surfaced base flashing ply, fully adhere one ply of thermoplastic membrane in low rise adhesive/Type IV asphalt/bonding adhesive.
 - 10. Strip in base flashing membrane to field surfacing membrane with asphalt mastic, reinforced with fiberglass mesh; broadcast granules into top layer of asphalt mastic.
 - 11. Install new metal flashings, including but not limited to drip edge, copings, counter flashings, slip flashings, scuppers, lead jacks, lead at drains, and pitch pans/covers.
 - 12. Properly support all conduit, gas lines and any other roof top lines to complete the roof with UV resistant and galvanized supports blocking.
 - 13. Spray apply acrylic white coating to surfaced membrane, base flashings, pipe penetrations, and miscellaneous areas; application must be applied in two coats in cross-hatch manner.

1.3 REFERENCES

- A. Roofing Terminology:
 - 1. RCI "Glossary of Building Envelope Terms."
 - 2. Glossary of Terms: SMACNA "Architectural Sheet Metal Manual."
 - 3. ASTM D 1079 "Standard Terminology Relating to Roofing & Waterproofing."
 - 4. Glossary of Terms: "National Roofing Contractors Association Roofing and Waterproofing Manual."

1.4 DESIGN / PERFORMANCE REQUIREMENTS

- A. Perform work in accordance with all federal, state and local codes.
- B. Exterior Fire Test Exposure: Roof system submitted shall achieve a UL, Intertek-WH or FM Class rating. Rating must meet state and local codes.
- C. Design Requirements – Manufacture to provide fastening pattern.

1.5 SUBMITTALS

- A. Submit under provisions of Section 01300.
- B. Product Data: Manufacturer's data sheets on each product to be used, including:
 - 1. Preparation instructions and recommendations.
 - 2. Storage and handling requirements and recommendations.
 - 3. Installation instructions.
- C. Shop Drawings: Contractor must submit shop drawings including installation details of roofing, flashing, fastening, insulation, including notation of roof slopes and fastening patterns of insulation and base modified bitumen membrane, prior to job start.
- D. Design Pressure Calculations: Manufacturer must submit fastening patterns from provided design pressure calculations for the site-specific roof areas in accordance with ASCE 7 and local Building Code requirements.
- E. Verification Samples: For each product specified, two samples, minimum size 6 inches (150 mm) square, representing actual product, color, and patterns.
- F. Test Reports: Submit test reports, prepared by an independent testing agency, for all modified bituminous surfacing sheets, indicating compliance with ASTM D5147.
- G. Manufacturer's Fire Compliance Certificate: Certify that the roof system furnished is tested by a third party in accordance with ASTM E108 or UL 790 and meets local or nationally recognized building codes.
- H. Closeout Submittals: Provide manufacturer's maintenance instructions that include recommendations for periodic inspection and maintenance of all completed roofing work.

1.6 QUALITY ASSURANCE

- A. Perform Work in accordance with NRCA Roofing and Waterproofing Manual.
- B. Installer Qualifications: Company specializing in performing work of this section with a minimum of five (5) years documented experience and is certified and pre-approved by the manufacturer unless stated differently in the RFP.
- C. Installer's Field Supervision: Maintain a full-time foreman on job site during all phases of roofing work while roofing work is in progress.

1.7 PRODUCT INFORMATION REQUIRED WITH BID SUBMITTAL AND DUE AT BID OPENING

- A. Required Product Information to be submitted with bid:
 - 1. Product identification: including Manufacturer's current literature and Manufacturer's name and address.
 - 2. Letter from manufacturer stating they will provide field inspections no less than a minimum of one (1) day each week, on during, and until all construction work is completed and accepted by the Owner and Architect.
- B. Products will not be considered if:
 - 1. Product or method of major waterproofing field components to be considered does not have a minimum of five (5) years of successful performance in roofing and reroofing applications in Arizona.
 - 2. The independent test data does not meet or exceed the minimum performance standards specified.
 - 3. Acceptance will require substantial revision of Contract Documents.
 - 4. Architect/ Owner reserves the right to be the final authority on the acceptance or rejection of any and all products.

1.8 PRE-INSTALLATION MEETINGS

- A. Convene minimum two weeks prior to commencing Work of this section.
- B. Review installation procedures and coordination required with related Work.
- C. Inspect and make notes of job conditions prior to installation:
 - 1. Record minutes of the conference and provide copies to all parties present.
 - 2. Identify all outstanding issues in writing designating the responsible party for follow-up action and the timetable for completion.
 - 3. Installation of roofing system shall not begin until all outstanding issues are resolved to the satisfaction of the Architect.

1.9 DELIVERY, STORAGE, AND HANDLING

- A. Deliver and store products in manufacturer's unopened packaging with labels intact until ready for installation.
- B. Store all roofing materials in a dry place, on pallets or raised platforms, out of direct exposure to the elements until time of application. Store materials at least 4 inches above ground level and covered with "breathable" tarpaulins.
- C. Stored in accordance with the instructions of the manufacturer prior to their application or installation. Store roll goods on end on a clean flat surface. No wet or damaged materials will be used in the application.
- D. Refer to manufacturer's published requirements for additional storing recommendations.

1.10 COORDINATION

- A. Coordinate Work with installing associated metal flashings as work of this section proceeds.

1.11 PROJECT CONDITIONS

- A. Maintain environmental conditions (temperature, humidity, and ventilation) within limits recommended by manufacturer for optimum results. Do not install products under environmental conditions outside manufacturer's absolute limits.

1.12 WARRANTY

- A. Upon completion of the work, provide the Manufacturer's written and signed NDL (no dollar limit) Warranty. Warranty shall cover defective material or defective workmanship by the installing contractor. The manufacturer shall provide the Owner, at the Manufacturer's expense, with the labor and material necessary to return the defective area to a watertight condition.
 - 1. Warranty Period:
 - a) 20 years NDL from date of acceptance. (NDL) material and labor warranty to be provided by the manufacturer for all the types of roofing failures which will include roof leaks, blisters, ponding, sliding materials, and loss of granules.
- B. Installer is to guarantee all work against defects in materials and workmanship for the period indicated following final acceptance of the Work.
 - 1. Warranty Period:
 - a) 2 years from date of acceptance.

PART 2 PRODUCTS

- 2.1 MANUFACTURERS –The Products specified are intended and the Standard of Quality for the products required for this project.

2.2 2-PLY LOW SLOPED ROOFING

- A. Inter-Ply Adhesive: ASTM D 312, Type IV special steep asphalt approved by membrane manufacturer.
- B. Waterproofing Assembly: Multi Ply SBS Modified Bitumen Roofing System with a minimum of two and a maximum of three plies, where the combination of the plies meets or exceeds 500 lbf. / in. of tensile strength and 850 lbf. / in. of tear strength when tested per ASTM D 5147 @ 73.4 +/- 3.6 deg F.
 - 1. All plies may contain any combination of the following scrim reinforcements:
 - a) Polyester Scrim Reinforcement - ASTM D 6164.
 - b) Fiberglass Scrim Reinforcement - ASTM D 6163.
 - c) Dual Fiberglass Scrim Reinforcements - ASTM D 6162.
- C. Flashing Cap Ply Sheet: 60-mil high-performance reinforced thermoplastic membrane approved by membrane manufacturer.
- D. Surfacing: White elastomeric Energy Star coating approved by membrane manufacturer.

2.3 ACCESSORIES:

- A. Fasteners: Non-ferrous metal or galvanized steel, except that hard copper nails shall be used with copper; aluminum or stainless steel nails shall be used with aluminum; and stainless steel nails shall be used with stainless steel, Fasteners shall be self-clinching type of penetrating type as recommended by the deck manufacturer. Fasten nails and fasteners flush-driven through flat metal discs not less than 1 inch (25 mm) diameter. Omit metal discs when one-piece composite nails or fasteners with heads not less than 1 inch (25 mm) diameter are used.
- B. Asphalt Primer: Approved by Membrane Manufacturer for 20-year NDL warranty.
- C. Flashing Cap Adhesive: Approved by Membrane Manufacturer for 20-year NDL warranty. .
- D. Base Sheet for tie ins: Approved by Membrane Manufacturer for 20-year NDL warranty. .
- E. Asphalt Mastic: Approved by Membrane Manufacturer for 20-year NDL warranty.
- F. Three Course Reinforcing Mesh: Approved by Membrane Manufacturer for 20-year NDL warranty.
- G. Wood Nailers
- H. Pipe, Conduit, Power-runs & Condensate Line Supports: Approved by Membrane Manufacturer for 20-year NDL warranty.
- I. Urethane Sealant: One part, non-sag sealant Approved by Membrane Manufacturer for 20-year NDL warranty.
- J. Structural Adhesive: Single component, 100% solids structural adhesive Approved by Membrane Manufacturer for 20-year NDL warranty.
- K. Butyl Tape: 100% solids, asbestos free and compressive tape designed to seal as recommended and furnished by the membrane manufacturer for 20-year NDL warranty.
- L. Liquid Flashing Reinforced w/ Polyester: Polyurethane-based, low-odor, liquid flashing membrane Approved by Membrane Manufacturer for 20-year NDL warranty.
- M. Liquid Flashing Reinforcement: Strong, elastic, polyester reinforcing fabric Approved by Membrane Manufacturer for 20-year NDL warranty for 20-year NDL warranty.
- N. Roof Insulation:
 - 1. Rigid Polyisocyanurate Roof Insulation; ASTM C1289 Approved by Membrane Manufacturer for 20-year NDL warranty.
 - a. Thickness: Identified in drawings.
 - 2. Tapered Polyisocyanurate Roof Insulation; ASTM C1289.
 - 3. High Density Fiberboard Roof insulation; ASTM C208.
 - 4. Cant and Tapered Edge Strips; ASTM C728.
 - 5. Tapered Perlite Roof Insulation; ASTM C728.

2.4 EDGE TREATMENT AND ROOF PENETRATION FLASHINGS

- A. Drain Flashings should be 4lb (1.8kg) sheet lead formed and rolled.
- B. Plumbing Stacks should be 4lb (1.8kg) sheet lead formed and rolled.
- C. Cylinder Support Pipes Flashings should be 4lb (1.8kg) sheet lead formed and rolled.
- D. Fabricated Flashings: Fabricated flashings and trim:
 - 1. Fabricated flashings and trim shall conform to the detail requirements of SMACNA "Architectural Sheet Metal Manual" and/or the CDA Copper Development Association "Copper in Architecture - Handbook" as applicable. Match existing.
 - 2. Approved by Membrane Manufacturer.

PART 3 EXECUTION

3.1 EXAMINATION

- A. Do not begin installation until substrates have been properly prepared.
- B. Inspect and approve the deck condition, slopes and fastener backing if applicable, parapet walls, expansion joints, roof drains, stack vents, vent outlets, nailers and surfaces and elements.
- C. Verify that work penetrating the roof deck, or which may otherwise affect the roofing, has been properly completed.
- D. If substrate preparation and other conditions are the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.

3.2 PREPARATION

- A. General: Clean surfaces thoroughly prior to installation.
 - 1. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.
 - 2. Fill substrate surface voids that are greater than 1/4" wide with an acceptable fill material.
 - 3. Roof surface to receive roofing system shall be smooth, clean, free from loose gravel, dirt and debris, dry and structurally sound.
 - 4. Wherever necessary, all surfaces to receive roofing materials shall be power broom and vacuumed to remove debris and loose matter prior to starting work.
 - 5. Do not apply roofing during inclement weather. Do not apply roofing components to damp or wet surfaces.

3.3 INSULATION INSTALLATION (General)

- A. Metal Deck Mechanical Attachment:
 - 1. Mechanically attach approved insulation board per manufacturer's wind uplift calculations with plates and fasteners.
 - 2. Embed second layer of insulation board in solid moppings of hot asphalt after first layer has been attached as recommended by insulation manufacturer. Stagger end joints of boards so all open joints will be eliminated. Walk in each piece of insulation

- and leave boards completely adhered to base felt or deck. Each insulation board shall be butt firmly against adjoining panels. All open joints shall be eliminated.
3. Approved insulation shall be tapered around roof drains and scuppers. Tapered insulation sump shall start with a thickness of one-half at drain bowl to the specified dimension of three feet from the center line of the drain. Install tapered insulation sump in such a way to provide proper slope for runoff. Shape insulation with tool as required so completed surface is smooth and flush with ring of drain. Under no circumstances will the membrane be left unsupported in an area greater than one quarter (1/4) inch. Install recovery board over tapered insulation sump as required.
 4. Approved recovery board one half (1/2) inch thickness shall be installed over base tapered insulation using hot asphalt at the rate of approximately thirty-three (33) pounds per square.
 5. All boards shall be cut and fitted where the roof deck intersects a vertical surface. The boards shall be cut to fit a minimum of one quarter (1/4) inch away from the vertical surface.
 6. Install no more insulation at one time than can be roofed on the same day.
 7. Install temporary water cut-offs at completion of each day's work and remove upon resumption of work.
 8. Cant Strips/Tapered Edge Strips: Install preformed forty five (45) degree cant strip at junctures of vertical surfaces. Provide preformed, tapered edge strips at perimeter of edges of roof that do not terminate at vertical surfaces and/or indicated on the drawings.
 9. Minimum penetration into deck shall be as recommended by the fastener manufacturer. There is a one (1) inch minimum for metal.

B. Wood Deck Mechanical Attachment:

1. Mechanically attach approved insulation board per manufacturer's wind uplift calculations with plates and fasteners.
2. Embed second layer of insulation board in solid moppings of hot asphalt after first layer has been attached as recommended by insulation manufacturer. Stagger end joints of boards so all open joints will be eliminated. Walk in each piece of insulation and leave boards completely adhered to base felt or deck. Each insulation board shall be butt firmly against adjoining panels. All open joints shall be eliminated.
3. Approved insulation shall be tapered around roof drains and scuppers. Tapered insulation sump shall start with a thickness of one-half at drain bowl to the specified dimension of three feet from the center line of the drain. Install tapered insulation sump in such a way to provide proper slope for runoff. Shape insulation with tool as required so completed surface is smooth and flush with ring of drain. Under no circumstances will the membrane be left unsupported in an area greater than one quarter (1/4) inch. Install recovery board over tapered insulation sump as required.
4. Approved recovery board one half (1/2) inch thickness shall be installed over base tapered insulation using hot asphalt at the rate of approximately thirty-three (33) pounds per square.
5. All boards shall be cut and fitted where the roof deck intersects a vertical surface. The boards shall be cut to fit a minimum of one quarter (1/4) inch away from the vertical surface.
6. Install no more insulation at one time than can be roofed on the same day.

7. Install temporary water cut-offs at completion of each day's work and remove upon resumption of work.
8. Cant Strips/Tapered Edge Strips: Install preformed forty five (45) degree cant strip at junctures of vertical surfaces. Provide preformed, tapered edge strips at perimeter of edges of roof that do not terminate at vertical surfaces and/or indicated on the drawings.
9. Minimum penetration into deck shall be as recommended by the fastener manufacturer. There is a one (1) inch minimum for wood.

C. Light Weight Concrete Deck, Tectum Deck, and Gypsum Deck Mechanical Attachment:

1. Mechanically attach base sheet to deck per manufacturer's wind uplift calculations with plates and fasteners.
2. Over base sheet, embed one layer of rigid insulation board in solid moppings of hot asphalt at the rate and temperature recommended by insulation manufacturer. Stagger end joints of boards so all open joints will be eliminated. Walk in each piece of insulation and leave boards completely adhered to deck. Each insulation board shall be butt firmly against adjoining panels. All open joints shall be eliminated.
3. Embed second layer of insulation board in solid moppings of hot asphalt after first layer has been attached as recommended by insulation manufacturer. Stagger end joints of boards so all open joints will be eliminated. Walk in each piece of insulation and leave boards completely adhered to base felt or deck. Each insulation board shall be butt firmly against adjoining panels. All open joints shall be eliminated.
4. Approved insulation shall be tapered around roof drains and scuppers. Tapered insulation sump shall start with a thickness of one-half at drain bowl to the specified dimension of three feet from the center line of the drain. Install tapered insulation sump in such a way to provide proper slope for runoff. Shape insulation with tool as required so completed surface is smooth and flush with ring of drain. Under no circumstances will the membrane be left unsupported in an area greater than one quarter (1/4) inch. Install recovery board over tapered insulation sump as required.
5. Approved recovery board one half (1/2) inch thickness shall be installed over base tapered insulation using hot asphalt at the rate of approximately thirty-three (33) pounds per square.
6. All boards shall be cut and fitted where the roof deck intersects a vertical surface. The boards shall be cut to fit a minimum of one quarter (1/4) inch away from the vertical surface.
7. Install no more insulation at one time than can be roofed on the same day.
8. Install temporary water cut-offs at completion of each day's work and remove upon resumption of work.
9. Cant Strips/Tapered Edge Strips: Install preformed forty five (45) degree cant strip at junctures of vertical surfaces. Provide preformed, tapered edge strips at perimeter of edges of roof that do not terminate at vertical surfaces and/or indicated on the drawings.

D. Concrete Deck Attachment:

1. Over the entire deck surface, prime concrete surfaces with asphalt primer at the rate of 1 (one) gallon per one hundred (100) square feet.

2. Embed one layer of rigid insulation board in solid moppings of hot asphalt at the rate and temperature recommended by insulation manufacturer. Stagger end joints of boards so all open joints will be eliminated. Walk in each piece of insulation and leave boards completely adhered to deck. Each insulation board shall be butt firmly against adjoining panels. All open joints shall be eliminated.
3. Embed second layer of insulation board in solid moppings of hot asphalt after first layer has been attached as recommended by insulation manufacturer. Stagger end joints of boards so all open joints will be eliminated. Walk in each piece of insulation and leave boards completely adhered to base felt or deck. Each insulation board shall be butt firmly against adjoining panels. All open joints shall be eliminated.
4. Approved insulation shall be tapered around roof drains and scuppers. Tapered insulation sump shall start with a thickness of one-half at drain bowl to the specified dimension of three feet from the center line of the drain. Install tapered insulation sump in such a way to provide proper slope for runoff. Shape insulation with tool as required so completed surface is smooth and flush with ring of drain. Under no circumstances will the membrane be left unsupported in an area greater than one quarter (1/4) inch. Install recovery board over tapered insulation sump as required.
5. Approved recovery board one half (1/2) inch thickness shall be installed over base tapered insulation using hot asphalt at the rate of approximately thirty-three (33) pounds per square.
6. All boards shall be cut and fitted where the roof deck intersects a vertical surface. The boards shall be cut to fit a minimum of one quarter (1/4) inch away from the vertical surface.
7. Install no more insulation at one time than can be roofed on the same day.
8. Install temporary water cut-offs at completion of each day's work and remove upon resumption of work.
9. Cant Strips/Tapered Edge Strips: Install preformed forty five (45) degree cant strip at junctures of vertical surfaces. Provide preformed, tapered edge strips at perimeter of edges of roof that do not terminate at vertical surfaces and/or indicated on the drawings.
10. Tape joints of insulation as per manufacturer's requirements.

3.4 INSTALLATION - GENERAL

- A. Install modified bitumen membranes and flashings in accordance with manufacturer's instructions and with the recommendations provided by the National Roofing Contractors Association's Roofing & Waterproofing Manual, the Asphalt Roofing Manufacturers Association, and applicable codes.
- B. General: Avoid installation of modified bitumen membranes at temperatures lower than 40-45 degrees F. When work at such temperatures unavoidable use the following precautions:
 1. Take extra care during cold weather installation and when ambient temperatures are affected by wind or humidity, to ensure adequate bonding is achieved between the surfaces to be joined. Use extra care at material seam welds and where adhesion of the applied product to the appropriately prepared substrate as the substrate can be affected by such temperature constraints as well.
 2. Unrolling of cold materials, under low ambient conditions must be avoided to prevent the likelihood of unnecessary stress cracking. Rolls must be at least 40 degrees F at

the time of application. If the membrane roll becomes stiff or difficult to install, it must be replaced with roll from a heated storage area.

- C. Commence installation of the roofing system at the lowest point of the roof (or roof area), working up the slope toward the highest point. Lap sheets shingle fashion so as to constantly shed water
- D. All slopes greater than 2:12 require back-nailing to prevent slippage of the ply sheets. Use ring or spiral-shank 1 inch cap nails, or screws and plates at a rate of 1 fastener per ply (including the membrane) at each insulation stop. Place insulation stops at 16 ft. o.c. for slopes less than 3:12 and 4 feet o.c. for slopes greater than 3:12. On non-insulated systems, nail each ply directly into the deck at the rate specified above. When slope exceeds 2:12, install all plies parallel to the slope (strapping) to facilitate back-nailing. Install 4 additional fasteners at the upper edge of the membrane when strapping the plies.

3.5 INSTALLATION HOT APPLIED ROOF SYSTEM

- A. Base Ply: Install base ply in twenty-five (25) lbs. (11.3kg) per square of bitumen shingled uniformly to achieve one or more plies over the entire prepared substrate. Shingle in direction of slope of roof to shed water on each area of roof. Do not step on base rolls until asphalt has cooled, fish mouths should be cut and patched.
 - 1. Lap ply sheet ends 8 inches (203 mm). Stagger end laps 2 inches (304mm) minimum.
 - 2. Install base flashing ply to all perimeter and projection details after membrane application.
 - 3. Extend plies 2 inches beyond top edges of cants at wall and projection bases.
 - 4. Install base flashing ply to all perimeter and projection details.
 - 5. Allow the one ply of base sheet to cure at least 30 minutes before installing the modified membrane. However, the modified membrane must be installed the same day as the base plies.
- B. Modified Cap Ply: Solidly bond the modified membrane to the base layers with specified material at the rate of 25 to thirty 30 lbs. (11-13kg) per 100 square feet.
 - 1. Roll must push a puddle of hot material in front of it with material slightly visible at all side laps. Use care to eliminate air entrapment under the membrane. Exercise care during application to eliminate air entrapment under the membrane.
 - 2. Apply pressure to all seams to ensure that the laps are solidly bonded to substrate.
 - 3. Install subsequent rolls of modified membrane as above with a minimum of 4 inch (101 mm) side laps and 8 inch (203 mm) end laps. Stagger end laps. Apply membrane in the same direction as the previous layers but stagger the laps so they do not coincide with the laps of the base layers.
 - 4. Apply hot material no more than 5 feet (1.5 m) ahead of each roll being embedded.
 - 5. Extend membrane 2 inches (50 mm) beyond top edge of all cants in full moppings of the specified asphalt.
- C. Fibrous Cant Strips: Provide non-combustible cant strips at all wall/curb detail treatments where angle changes are greater than 45 degrees. Cant may be set in approved cold adhesives, hot asphalt or mechanically attached with approved plates and fasteners.
- D. Wood Blocking, Nailers and Cant Strips: Provide wood blocking, nailers and cant strips as

specified.

1. Provide nailers at all roof perimeters and penetrations (as required by primary roofing manufacturer) for fastening membrane flashings and sheet metal components.
 2. Wood nailers should match the height of any insulation, providing a smooth and even transition between flashing and insulation areas.
 3. Nailer lengths should be spaced with a minimum 1/8 inch gap for expansion and contraction between each length or change of direction.
 4. Nailers and flashings should be fastened in accordance with Factory Mutual "Loss Prevention Data Sheet 1- 49, Perimeter Flashing."
- E. Metal Work: Provide new metal flashings, counter flashings, and parapet coping caps. Install in accordance with the SMACNA "Architectural Sheet Metal Manual" or the NRCA Roofing Waterproofing manual, finish to match existing.
- F. Termination Bar: Provide a metal termination bar or approved top edge securement at the terminus of all flashing sheets at walls and curbs. Fasten the bar a minimum of 8 inches (203 mm) o/c through butyl tape to achieve constant compression. Provide suitable, sealant at the top edge if required.
- G. Flashing Base Ply General:
1. Seal curb, wall and parapet flashings with an application of mastic and mesh on a daily basis. Do not permit conditions to exist that will allow moisture to enter behind, around or under the roof or flashing membrane.
 2. Prepare all walls, penetrations, expansion joints and surfaces to be flashed with required primer at the rate of 100 square feet per gallon. Allow primer to dry tack free.
 3. Extend flashing base ply four inches above cant and four inches below cant.
 4. Solidly adhere the entire sheet of flashing base ply membrane to the substrate.
 5. Coordinate counter flashing, cap flashings, expansion joints, and similar work with modified bitumen roofing work as specified.
 6. Coordinate roof accessories, miscellaneous sheet metal accessory items, including piping vents and other devices with the roofing system work.
- H. Flashing Cap Ply General:
1. Seal curb, wall and parapet flashings with an application of mastic and mesh on a daily basis. Do not permit conditions to exist that will allow moisture to enter behind, around or under the roof or flashing membrane.
 2. Prepare all walls, penetrations, expansion joints and where shown on the Drawings to be flashed with required primer at the rate of 100 square feet per gallon. Allow primer to dry tack free.
 3. Adhere the flashing cap ply with specified adhesive. Nail off at a minimum of 8 inches (203 mm) o.c. from the finished roof at all vertical surfaces. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 4. Coordinate counter flashing, cap flashings, expansion joints and similar work with modified bitumen roofing work as specified.
 5. Coordinate roof accessories, miscellaneous sheet metal accessory items with the roofing system work.
 6. Secure the top edge of the flashing sheet using a termination bar only when the wall surface above is waterproofed, or nailed 4 inches on center and covered with an

acceptable counter flashing.

- I. Surface Coatings: Apply roof coating in strict conformance with the manufacturer's recommended procedures.
 1. Remove dust, dirt, debris and excess roofing granules from field and base flashings receiving coating.
 2. Install 2.5 gallons per square (1.25 gal per coat, two coat application) in a cross hatch manner of specified acrylic white energy star coating to all field, wall and penetrations.

3.6 INSTALLATION EDGE TREATMENT AND ROOF PENETRATION FLASHING

- A. Metal Edge:
 1. Inspect the nailers to assure proper attachment and configuration.
 2. Run one ply over the edge. Assure coverage of all wood nailers. Fasten plies with ring shank nails at 8 inches (203 mm) o.c.
 3. Install continuous cleat and fasten at 6 inches (152 mm) o.c.
 4. Install new metal edge hooked to continuous cleat and set in bed of roof cement. Fasten flange to wood nailers every 3 inches (76 mm) o.c. staggered.
 5. Prime metal edge at a rate of 100 square feet per gallon and allow to dry.
 6. Strip in flange with base flashing ply covering entire flange in bitumen with 6 inches (152 mm) on to the field of roof. Assure ply laps do not coincide with metal laps.
 7. Install a second ply of modified flashing ply in bitumen over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Seal outside edge with rubberized cement.
- B. Roof Edge with Gutter:
 1. Inspect the nailer to assure proper attachment and configuration. Increase slope at metal edge by additional degree of slope in first board.
 2. Run one ply over the edge. Assure coverage of all wood nailers. Fasten plies with ring shank nails at 8 inches (203 mm) o.c.
 3. Install gutter and strapping.
 4. Install continuous cleat and fasten at 6 inches (152 mm) o.c.
 5. Install new metal edge hooked to continuous cleat and set in bed of roof cement. Fasten flange to wood nailer every 3 inches (76 mm) o.c. staggered.
 6. Prime metal edge at a rate of 100 square feet per gallon and allow to dry.
 7. Strip in flange with base flashing ply covering entire flange in bitumen with 6 inches (152 mm) onto the field of the roof. Assure ply laps do not coincide with metal laps.
 8. Install a second ply of modified flashing ply in bitumen over the base flashing ply, 9 inches (228 mm) on to the field of the roof.
- C. Scupper Through Wall:
 1. Inspect the nailer to assure proper attachment and configuration.
 2. Run one ply over nailer, into scupper hole and up flashing as in typical wall flashing detail. Assure coverage of all wood nailers.
 3. Install a scupper box in a 1/4 inch (6 mm) bed of mastic. Assure all box seams are soldered and have a minimum 4 inch (101 mm) flange. Make sure all corners are closed and soldered. Prime scupper at a rate of 100 square feet per gallon and allow to dry.
 4. Fasten flange of scupper box every 3 inches (76 mm) o.c. staggered.
 5. Strip in flange of scupper box with base flashing ply covering entire area with 6 inch

- (152 mm) overlap on to the field of the roof and wall flashing.
6. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
- D. Scupper Through Wall (Overflow):
1. Inspect the nailer to assure proper attachment and configuration.
 2. Run one ply over nailer up the overflow, into the scupper hole and up flashing as in typical wall flashing detail. Assure coverage of all wood nailers.
 3. Install scupper box in a 1/4 inch (6 mm) bed of mastic. Assure all box seams are soldered and have a minimum 4 inch (101 mm) flange. Make sure all corners are closed and soldered. Prime scupper at a rate of 100 square feet per gallon and allow to dry.
 4. Fasten flange of scupper box every 3 inches (76 mm) o.c. staggered.
 5. Strip in flange scupper box with base flashing ply covering entire area with 6 inch (152 mm) overlap on to the field of the roof and wall flashing.
 6. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
- E. Coping Cap:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Install continuous cleat and fasten at 6 inches (152 mm) o.c. to outside wall.
 6. Install new metal coping cap hooked to continuous cleat.
 7. Fasten inside cap 24 inches (609 mm) o.c. with approved fasteners and neoprene washers through slotted holes, which allow for expansion and contraction.
- F. Surface Mounted Counterflashing/Coping Cap:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Apply butyl tape to wall behind flashing. Secure termination bar through flashing, butyl

- tape and into wall. Alternatively use caulk to replace the butyl tape.
 6. Secure counterflashing set on butyl tape above flashing. Fasten 8 inches (203 mm) o.c. and caulk top of counterflashing.
 7. Cover tapered board and all exposed wood with base flashing ply. Fasten inside and out at 8 inches (203 mm) o.c.
 8. Install continuous cleat and fasten at 6 inches (152 mm) o.c. to outside wall.
 9. Install new metal coping cap hooked to continuous cleat.
 10. Fasten inside of cap 24 inch (609 mm) o.c. with approved fasteners and neoprene washers.
- G. Surface Mounted Counterflashing:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Apply butyl tape to wall behind flashing. Secure termination bar through flashing, butyl tape and into wall. Alternatively use caulk to replace the butyl tape.
 6. Secure counterflashing set on butyl tape above flashing at 8 inches (203 mm) o.c. and caulk top of counterflashing.
- H. Reglet Mounted Counterflashing:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Apply butyl tape to wall behind flashing. Secure termination bar through flashing, butyl tape and into wall. Alternatively use caulk to replace the butyl tape.
 6. Cut reglet in masonry one joint above flashing.
 7. Secure reglet counterflashing with expansion fasteners and caulk reglet opening.
- I. Expansion Joint:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to

- the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
5. Install pre-manufactured expansion joint cover. Fasten sides at 12 inches (609 mm) o.c. with fasteners and neoprene washers. Furnish all joint cover laps with butyl tape between metal covers.

J. Area Divider:

1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
5. Install pre-manufactured cover. Fasten sides at 24 inches (609 mm) o.c. with fasteners and neoprene washers through slotted holes. Furnish all joint cover laps with butyl tape between metal covers.

K. Equipment Support:

1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
5. Install pre-manufactured cover. Fasten sides at 24 inches (609 mm) o.c. with fasteners and neoprene washers. Furnish all joint cover laps with butyl tape between metal covers.
6. Set equipment on neoprene pad and fasten as required by equipment manufacturer.

L. Curb Detail/Air Handling Station:

1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
5. Install pre-manufactured counterflashing with fasteners and neoprene washers or per manufacturer's recommendations.
6. Set equipment on neoprene pad and fasten as required by equipment manufacturer.

- M. Skylight:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Install pre-manufactured lens and fasten flashing sides at 8 inches (203 mm) o.c. with fasteners and neoprene washers.
- N. Pre-manufactured Curb for Equipment Support:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Install pre-manufactured cover. Fasten sides at 24 inches (609 mm) o.c. with fasteners and neoprene washers. Furnish all joint cover laps with butyl tape between metal covers.
 6. Set equipment on neoprene pad and fasten as required by equipment manufacturer.
- O. Exhaust Fan:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Install metal exhaust fan over the wood nailers and flashing to act as counterflashing. Fasten per manufacturer's recommendation.
- P. Passive Vent/Air Intake:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.

4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
5. Install passive vent/air intake over the wood nailers and flashing to act as counterflashing. Fasten per manufacturer's recommendations.

Q. Roof Drain:

1. Plug drain to prevent debris from entering plumbing.
2. Taper insulation to drain minimum of 24 inches (609 mm) from center of drain.
3. Run roof system plies over drain. Cut out plies inside drain bowl.
4. Set lead flashing (30 inch square minimum) in 1/4 inch bed of mastic. Run lead into drain a minimum of 2 inches (50 mm). Prime lead at a rate of 100 square feet per gallon and allow to dry.
5. Install base flashing ply (40 inch square minimum) in bitumen.
6. Install modified membrane (48 inch square minimum) in bitumen.
7. Install clamping ring and assure that all plies are under the clamping ring.
8. Remove drain plug and install strainer.

R. Plumbing Stack & Cylinder Supports:

1. Minimum stack height is 12 inches (609 mm).
2. Run roof system over the entire surface of the roof. Seal the base of the stack with elastomeric sealant.
3. Prime flange of new sleeve. Install properly sized sleeves set in 1/4 inch (6 mm) bed of roof cement.
4. Install base flashing ply in bitumen.
5. Install membrane in bitumen.
6. Caulk the intersection of the membrane with elastomeric sealant.
7. Turn sleeve a minimum of 1 inch (25 mm) down inside of stack.

S. Heat Stack:

1. Minimum stack height is 12 inches (609 mm).
2. Run roof system over the entire surface of the roof. Seal the base of the stack with elastomeric sealant.
3. Prime flange of new sleeve. Install properly sized sleeves set in 1/4 inch (6 mm) bed of roof cement.
4. Install base flashing ply in bitumen.
5. Install modified membrane in bitumen.
6. Caulk the intersection of the membrane with elastomeric sealant.
7. Install new collar over cape. Weld collar or install stainless steel draw brand.

T. Liquid Flashing:

1. Mask target area on roof membrane with tape.
2. Clean all non-porous areas with isopropyl alcohol.
3. Apply 32 wet mil base coat of liquid flashing over masked area.
4. Embed polyester reinforcement fabric into the base coat of the liquid flashing.
5. Apply 48-64 wet mil top coat of the liquid flashing material over the fabric extending 2 inches (51 mm) past the scrim in all directions.
6. Apply minerals immediately or allow the liquid flashing material to cure 15-30 days

and then install reflective coating.

3.7 PROTECTION

- A. Provide traffic ways, erect barriers, fences, guards, rails, enclosures, chutes and the like to protect personnel, roofs and structures, vehicles and utilities.
- B. Protect exposed surfaces of finished walls with tarps to prevent damage.
- C. Special permission shall be obtained from the Manufacturer before any traffic shall be permitted over new roofing.

3.8 FIELD QUALITY CONTROL

- A. Inspection: Provide manufacturer's field observations at a minimum of one (1) time a week.
- B. Warranty shall be issued upon manufacturer's acceptance of the installation and the from the completion date listed on the certificate of completion.
- C. Field observations shall be performed by the Technical Representative contracted by or employed by the manufacturer, and whose primary job description is to assist, inspect and approve membrane installations for the manufacturer.
- D. Provide observation reports from the Technical Representative upon each site visit including electronic, written and photo documentation. These reports must be sent to the Architect after each inspection.
- E. Provide a final report from the Technical Representative, certifying that the roofing system has been satisfactorily installed according to the project specifications, approved details and good general roofing practice.

END OF SECTION

SECTION 07 62 00

SHEET METAL FLASHING AND TRIM

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fabricated sheet metal items, including flashings, counterflashings, and downspouts.
- B. Cleaning and repair of existing gutters.

1.02 REFERENCES

- A. ASTM A 653/A 653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2005a.
- B. ASTM D 4586 - Standard Specification for Asphalt Roof Cement, Asbestos-Free; 2000.
- C. SMACNA (ASMM) - Architectural Sheet Metal Manual; Sheet Metal and Air Conditioning Contractors' National Association; 2003.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Shop Drawings: Indicate material profile, jointing pattern, jointing details, fastening methods, flashings, terminations, and installation details.

1.04 QUALITY ASSURANCE

- A. Perform work in accordance with SMACNA Architectural Sheet Metal Manual requirements and standard details, except as otherwise indicated.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Stack material to prevent twisting, bending, and abrasion, and to provide ventilation. Slope metal sheets to ensure drainage.
- B. Prevent contact with materials which may cause discoloration or staining.

PART 2 PRODUCTS

2.01 SHEET MATERIALS

- A. Galvanized Steel: ASTM A 653/A 653M, with G90/Z275 zinc coating; minimum 0.02 inch thick base metal.

2.02 ACCESSORIES

- A. Fasteners: Galvanized steel, with soft neoprene washers.
- B. Primer: Zinc chromate type.
- C. Protective Backing Paint: Zinc molybdate alkyd.
- D. Sealant: Silicone as specified in Section 07 90 05.
- E. Plastic Cement: ASTM D 4586, Type I.

2.03 FABRICATION

- A. Form sections true to shape, accurate in size, square, and free from distortion or defects.
- B. Form pieces in longest possible lengths.

- C. Hem exposed edges on underside 1/2 inch; miter and seam corners.
- D. Form material with flat lock seams, except where otherwise indicated. At moving joints, use sealed lapped, bayonet-type or interlocking hooked seams.
- E. Fabricate corners from one piece with minimum 18 inch long legs; seam for rigidity, seal with sealant.
- F. Fabricate vertical faces with bottom edge formed outward 1/4 inch and hemmed to form drip.
- G. Fabricate flashings to allow toe to extend 2 inches over roofing gravel. Return and brake edges.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify roof openings, curbs, pipes, sleeves, ducts, and vents through roof are solidly set, reglets in place, and nailing strips located.
- B. Verify roofing termination and base flashings are in place, sealed, and secure.

3.02 PREPARATION

- A. Install starter and edge strips, and cleats before starting installation.
- B. Back paint concealed metal surfaces with protective backing paint to a minimum dry film thickness of 15 mil.

3.03 INSTALLATION

- A. Secure flashings in place using concealed fasteners. Use exposed fasteners only where permitted.
- B. Apply plastic cement compound between metal flashings and felt flashings.
- C. Fit flashings tight in place. Make corners square, surfaces true and straight in planes, and lines accurate to profiles.
- D. Seal metal joints watertight.
- E. Clean existing gutters and prepare for field painting.
- F. Secure existing gutters and downspouts in place using fasteners.

END OF SECTION

SECTION 07 71 00
ROOF SPECIALTIES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Manufactured roof specialties, including copings, fascias, and gravel stops.

1.02 REFERENCES

- A. ASTM D 4586 - Standard Specification for Asphalt Roof Cement, Asbestos-Free; 2000.
- B. SMACNA (ASMM) - Architectural Sheet Metal Manual; Sheet Metal and Air Conditioning Contractors' National Association; 2003.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data on shape of components, materials and finishes, anchor types and locations.

1.04 QUALITY ASSURANCE

- A. Perform work in accordance with SMACNA Architectural Sheet Metal Manual details.

PART 2 PRODUCTS

2.01 COMPONENTS

- A. Copings: Extruded aluminum, 0.050 inch thick, shaped as indicated, including special supports spaced at 24 inches on center. Include cover plates to conceal and weather seal joints and attachment flanges.
 - 1. Finish: Mill finish.

2.02 ACCESSORIES

- A. Roof Cement: ASTM D 4586, Type II.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that deck, curbs, roof membrane, base flashing, and other items affecting work of this Section are in place and positioned correctly.

3.02 INSTALLATION

- A. Install components in accordance with manufacturer's instructions.
- B. Coordinate installation of components of this section with installation of roofing membrane and base flashings.
- C. Coordinate installation of sealants and roofing cement with work of this section to ensure water tightness.

END OF SECTION

SECTION 07 90 05

JOINT SEALERS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Sealants and joint backing.

1.02 REFERENCES

- A. ASTM C 834 - Standard Specification for Latex Sealants; 2005.
- B. ASTM C 919 - Standard Practice for Use of Sealants in Acoustical Applications; 2002.
- C. ASTM C 920 - Standard Specification for Elastomeric Joint Sealants; 2005.
- D. ASTM C 1193 - Standard Guide for Use of Joint Sealants; 2005a.
- E. SCAQMD 1168 - South Coast Air Quality Management District Rule No.1168; current edition; www.aqmd.gov.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data indicating sealant chemical characteristics and color availability.

1.04 ENVIRONMENTAL REQUIREMENTS

- A. Maintain temperature and humidity recommended by the sealant manufacturer during and after installation.

1.05 COORDINATION

- A. Coordinate the work with all sections referencing this section.

1.06 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals, for additional warranty requirements.
- B. Correct defective work within a five year period after Date of Substantial Completion.
- C. Warranty: Include coverage for installed sealants and accessories which fail to achieve airtight seal, exhibit loss of adhesion or cohesion, or do not cure.

PART 2 PRODUCTS

2.01 SEALANTS

- A. Sealants and Primers - General: Provide only products having lower volatile organic compound (VOC) content than required by the more stringent of the South Coast Air Quality Management District Rule No.1168.
- B. Type ES-1 - General Purpose Exterior Sealant: Polyurethane; ASTM C 920, Grade NS, Class 25, Uses M, G, and A; single component.
 - 1. Color: Standard colors matching finished surfaces.
 - 2. Applications: Use for:
 - a. Joints between metal frames and other materials.
 - b. Other exterior joints for which no other sealant is indicated.

- C. Type ES-2 - General Purpose Interior Sealant: Acrylic emulsion latex; ASTM C 834, Type OP, Grade NF single component, paintable.
 - 1. Color: Standard colors matching finished surfaces.
 - 2. Applications: Use for:
 - a. Interior wall and ceiling control joints.
 - b. Joints between door and window frames and wall surfaces.
 - c. Other interior joints for which no other type of sealant is indicated.
- D. Type ES-3 - Bathtub/Tile Sealant: White silicone; ASTM C 920, Uses I, M and A; single component, mildew resistant.
 - 1. Applications: Use for:
 - a. Joints between plumbing fixtures and floor and wall surfaces.
 - b. Joints between kitchen and bath countertops and wall surfaces.
- E. Type ES-4 - Acoustical Sealant: Butyl or acrylic sealant; ASTM C 920, Grade NS, Class 12-1/2, Uses M and A; single component, solvent release curing, non-skinning.
 - 1. Applications: Use for concealed locations only:
 - a. Sealant bead between top plate and structure and between sill plate and floor.
- F. Type ES-5 - Silicone Sealant: ASTM C 920, Grade NS, Class 25, Uses NT, A, G, M, O; single component, solvent curing, non-sagging, non-staining, fungus resistant, non-bleeding.
 - 1. Color: Standard colors matching finished surfaces.
 - 2. Movement Capability: Plus and minus 25 percent.
 - 3. Service Temperature Range: -65 to 180 degrees F.
 - 4. Shore A Hardness Range: 15 to 35.
 - 5. Applications: Use for:
 - a. Joints between pre-finished flashings and copings.

2.02 ACCESSORIES

- A. Primer: Non-staining type, recommended by sealant manufacturer to suit application.
- B. Joint Cleaner: Non-corrosive and non-staining type, recommended by sealant manufacturer; compatible with joint forming materials.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that substrate surfaces are ready to receive work.
- B. Verify that joint backing and release tapes are compatible with sealant.

3.02 PREPARATION

- A. Remove loose materials and foreign matter which might impair adhesion of sealant.
- B. Clean and prime joints in accordance with manufacturer's instructions.
- C. Perform preparation in accordance with manufacturer's instructions and ASTM C 1193.
- D. Protect elements surrounding the work of this section from damage or disfigurement.

3.03 INSTALLATION

- A. Perform work in accordance with sealant manufacturer's requirements for preparation of surfaces and material installation instructions.
- B. Perform installation in accordance with ASTM C 1193.
- C. Perform acoustical sealant application work in accordance with ASTM C 919.
- D. Install sealant free of air pockets, foreign embedded matter, ridges, and sags.

- E. Apply sealant within recommended application temperature ranges. Consult manufacturer when sealant cannot be applied within these temperature ranges.

3.04 CLEANING

- A. Clean adjacent soiled surfaces.

3.05 PROTECTION OF FINISHED WORK

- A. Protect sealants until cured.

END OF SECTION

SECTION 09 90 00

PAINTING AND COATING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Surface preparation.
- B. Field application of paints.
- C. Surfaces to be finished are indicated in this section and on the Drawings.

1.02 REFERENCES

- A. 40 CFR 59, Subpart D - National Volatile Organic Compound Emission Standards for Architectural Coatings; U.S. Environmental Protection Agency; current edition.
- B. MPI (APL) - Master Painters Institute Approved Products List; Master Painters and Decorators Association; current edition, www.paintinfo.com.
- C. MPI (APSM) - Master Painters Institute Architectural Painting Specification Manual; Master Painters and Decorators Association; 2004.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide complete list of all products to be used, with the following information for each:
 - 1. Manufacturer's name, product name and/or catalog number, and general product category (e.g. "alkyd enamel").
 - 2. MPI product number (e.g. MPI #47).
 - 3. Cross-reference to specified paint system(s) product is to be used in; include description of each system (copy of relevant MPI Manual page is acceptable).
- C. Samples: Submit three paper "drop" samples, 8-1/2 by 11 inches in size, illustrating range of colors available for each finishing product specified.
 - 1. Where sheen is specified, submit samples in only that sheen.
 - 2. Where sheen is not specified, discuss sheen options with Architect before preparing samples, to eliminate sheens definitely not required.

1.04 QUALITY ASSURANCE

- A. Material Safety Data Sheets: At project site maintain file of MSDS sheets for each product used; become familiar with and follow manufacturer's stated application and safety requirements.
 - 1. Submit copies of MSDS sheets to Owner.

1.05 MOCK-UP

- A. See Section 01 40 00 - Quality Requirements, for general requirements for mock-up.
- B. Provide wall panel, 8 feet long by 8 feet wide, illustrating coating color, texture, and finish.
- C. Provide door and frame assembly illustrating coating color, texture, and finish.
- D. Locate where directed.
- E. Mock-up may remain as part of the Work.

1.06 DELIVERY, STORAGE, AND PROTECTION

- A. Deliver products to site in sealed and labeled containers; inspect to verify acceptability.

- B. Container Label: Include manufacturer's name, type of paint, brand name, lot number, brand code, coverage, surface preparation, drying time, cleanup requirements, color designation, and instructions for mixing and reducing.
- C. Paint Materials: Store at minimum ambient temperature of 45 degrees F and a maximum of 90 degrees F, in ventilated area, and as required by manufacturer's instructions.

1.07 ENVIRONMENTAL REQUIREMENTS

- A. Do not apply materials when surface and ambient temperatures are outside the temperature ranges required by the paint product manufacturer.
- B. Follow manufacturer's recommended procedures for producing best results, including testing of substrates, moisture in substrates, and humidity and temperature limitations.
- C. Minimum Application Temperatures for Latex Paints: 45 degrees F for interiors; 50 degrees F for exterior; unless required otherwise by manufacturer's instructions.
- D. Provide lighting level of 80 ft candles measured mid-height at substrate surface.

1.08 EXTRA MATERIALS

- A. See Section 01 60 00 - Product Requirements, for additional provisions.
- B. Supply 1 gallon of each color; store where directed.
- C. Label each container with color in addition to the manufacturer's label.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Provide all paint and coating products used in any individual system from the same manufacturer; no exceptions.
- B. Provide all paint and coating products from the same manufacturer to the greatest extent possible.

2.02 MATERIALS - GENERAL

- A. Volatile Organic Compound (VOC) Content:
 - 1. Provide coatings that comply with the most stringent requirements specified in the following:
 - a. 40 CFR 59, Subpart D--National Volatile Organic Compound Emission Standards for Architectural Coatings.
 - 2. Determination of VOC Content: Testing and calculation in accordance with 40 CFR 59, Subpart D (EPA Method 24), exclusive of colorants added to a tint base and water added at project site; or other method acceptable to authorities having jurisdiction.
- B. Paints and Coatings: Provide products listed in Master Painters Institute Approved Product List, current edition available at www.paintinfo.com, for specified MPI Categories, except as otherwise indicated.
 - 1. Provide ready mixed paints and coatings, except field-catalyzed coatings.
 - 2. Provide materials that are compatible with one another and the substrates indicated under conditions of service and application, as demonstrated by manufacturer based on testing and field experience.

2.03 PAINT SYSTEMS

- A. Provide Premium Grade systems (2 top coats) as defined in MPI Architectural Painting Specification Manual, except as otherwise indicated.

- B. Where a specified paint system does not have a Premium Grade, provide Custom Grade system.
- C. Where sheen is not specified or more than one sheen is specified, sheen will be selected later by Architect from the manufacturer's full line.
- D. Provide colors as directed by Architect.

2.04 EXTERIOR PAINT SYSTEMS

- A. Galvanized Metal, Not Chromate Passivated:
 - 1. Applications include but are not limited to doors.
 - 2. EXT 5.3J W.B. Light Industrial Coating: W.B. Primer MPI #134, W.B. Light Industrial Coating MPI #110, gloss level 5.
- B. Aluminum:
 - 1. EXT 5.4G W.B. Light Industrial Coating: Q.D. Primer MPI #95, W.B. Light Industrial Coating MPI #110, gloss level 5.
- C. Stucco Walls and Soffits: Match existing color and paint type from one of the following selections:
 - 1. EXT 9.1A Latex: Latex MPI #10, 11 or 119, semi-gloss.
 - 2. EXT 9.1B W.B. Light Industrial Coating: W.B. Light Industrial Coating MPI #110, gloss level 5.
 - 3. EXT 9.1C Elastomeric: Elastomeric MPI #113, semi-gloss.

2.05 INTERIOR PAINT SYSTEMS

- A. Gypsum Board:
 - 1. Applications include but are not limited to walls, ceilings, and soffits.
 - 2. INT 9.2A Latex: Latex Primer Sealer MPI #50, Latex #43, 44, 52, 53, 54 or 114, Gloss level 4.

PART 3 EXECUTION

3.01 SCOPE -- SURFACES TO BE FINISHED

- A. Paint all exposed surfaces except where indicated not to be painted or to remain natural; the term "exposed" includes areas visible through permanent and built-in fixtures when they are in place.
- B. Paint the surfaces described in PART 2, indicated on the Drawings, and as follows:
 - 1. If a surface, material, or item is not specifically mentioned, paint in the same manner as similar surfaces, materials, or items, regardless of whether colors are indicated or not.
 - 2. Paint surfaces behind movable equipment and furnishings the same as similar exposed surfaces.
 - 3. Paint surfaces to be concealed behind permanently installed fixtures, equipment, and furnishings, using primer only, prior to installation of the permanent item.
 - 4. Paint back sides of access panels and removable and hinged covers to match exposed surfaces.
 - 5. Finish top, bottom, and side edges of exterior doors the same as exposed faces.
 - 6. Paint all insulated and exposed pipes, conduit, boxes, insulated and exposed ducts, hangers, brackets, collars and supports, mechanical equipment, and electrical equipment occurring in finished areas to match background surfaces, unless otherwise indicated.
 - 7. Paint shop-primed mechanical and electrical items occurring in finished areas.
 - 8. Paint interior surfaces of air ducts and convectors and baseboard heating cabinets with flat, nonspecular black paint where visible through registers, grilles, or louvers.

9. Paint dampers exposed behind louvers, grilles, and convector and baseboard cabinets to match face panels.
- C. Do Not Paint or Finish the Following Items:
1. Items fully factory-finished unless specifically noted; factory-primed items are not considered factory-finished.
 2. Items indicated to receive other finish.
 3. Items indicated to remain naturally finished.
 4. Fire rating labels, equipment serial number and capacity labels, and operating parts of equipment.

3.02 EXAMINATION

- A. Verify that surfaces are ready to receive Work as instructed by the product manufacturer.
- B. Examine surfaces scheduled to be finished prior to commencement of work. Report any condition that may potentially affect proper application.
- C. Test shop-applied primer for compatibility with subsequent cover materials; report incompatible primer conditions and submit recommended changes for Architect's approval.
- D. Measure moisture content of surfaces using an electronic moisture meter. Do not apply finishes unless moisture content of surfaces are below the following maximums:
 1. Plaster and Gypsum Board: 12 percent.

3.03 PREPARATION

- A. Prepare surfaces as specified in MPI Architectural Painting Specification Manual and as follows for the applicable surface and coating; if multiple preparation treatments are specified, use as many as necessary for best results; where the Manual references external standards for preparation (e.g. SSPC standards), prepare as specified in those standards; comply with coating manufacturer's specific preparation methods or treatments, if any.
- B. Coordinate painting work with cleaning and preparation work so that dust and other contaminants do not fall on newly painted, wet surfaces.
- C. Surface Appurtenances: Prior to preparing surfaces or finishing, remove electrical plates, hardware, light fixtures, light fixture trim, escutcheons, machined surfaces, fittings, and similar items already installed that are not to be painted.
 1. If removal is impractical or impossible because of the size or weight of the item, provide surface-applied protection before preparation and finishing.
 2. After completing painting in each space or area, reinstall items removed using workers skilled in the trades involved.
- D. Surfaces: Correct defects and clean surfaces which affect work of this section. Remove or repair existing coatings that exhibit surface defects.
- E. Marks: Seal with shellac those which may bleed through surface finishes.
- F. Impervious Surfaces: Remove mildew by scrubbing with solution of tetra-sodium phosphate and bleach. Rinse with clean water and allow surface to dry.
- G. Gypsum Board Surfaces to be Painted: Fill minor defects with filler compound. Spot prime defects after repair.
- H. Plaster Surfaces to be Painted: Fill hairline cracks, small holes, and imperfections with latex patching plaster. Make smooth and flush with adjacent surfaces. Wash and neutralize high alkali surfaces.
- I. Aluminum Surfaces to be Painted: Remove surface contamination by steam or high pressure water. Remove oxidation with acid etch and solvent washing. Apply etching primer immediately following cleaning.

- J. Galvanized Surfaces to be Painted: Remove surface contamination and oils and wash with solvent. Apply coat of etching primer.

3.04 APPLICATION

- A. Apply products in accordance with manufacturer's instructions and as specified or recommended by MPI Manual, using the preparation, products, sheens, textures, and colors as indicated.
1. Remove, refinish, or repaint work not complying with requirements.
- B. Do not apply finishes over dirt, rust, scale, grease, moisture, scuffed surfaces, or other conditions detrimental to formation of a durable coating film; do not apply finishes to surfaces that are not dry.
- C. Use applicators and methods best suited for substrate and type of material being applied and according to manufacturer's instructions.
1. Brush Application: Use brushes best suited for the type of material applied; use brush of appropriate size for the surface or item being painted; produce results free of visible brush marks.
 2. Roller Application: Use rollers of carpet, velvet back, or high-pile sheep's wool as recommended by manufacturer for material and texture required.
 3. Spray Application: Use airless spray equipment with orifice size as recommended by manufacturer for material and texture required.
 4. Where application method is listed in the MPI Manual for the paint system that application method is required; otherwise any application method recommended by manufacturer for material used and objects to be painted is acceptable.
- D. Minimum Coating Thickness: Apply paint materials no thinner than manufacturer's recommended spreading rate; provide total dry film thickness of entire system as recommended by manufacturer.
1. Number of coats and film thickness required are the same regardless of application method.
 2. If undercoats, stains, or other conditions show through final coat of paint, apply additional coats until paint film is of uniform finish, color, and appearance.
 3. Give special attention to ensure edges, corners, crevices, welds, and exposed fasteners receive dry film thickness equivalent to that of flat surfaces.
- E. Apply finish to completely cover surfaces with uniform appearance without brush marks, runs, sags, laps, ropiness, holidays, spotting, cloudiness, or other surface imperfections.
1. Before applying finish coats, apply a prime coat of material recommended by manufacturer, unless the surface has been prime coated by others; where evidence of suction spots or unsealed areas in first coat appear, recoat primed and sealed surfaces to ensure finish coat with no burn through or other defects due to insufficient sealing.
 2. Apply first coat to surface that has been cleaned, pretreated, or otherwise prepared as soon as practical after preparation and before subsequent surface deterioration.
 3. Do not apply succeeding coats until the previous coat has cured as recommended by manufacturer.
 4. Do not recoat until paint has dried to where it feels firm, does not deform or feel sticky under moderate thumb pressure, and application of another coat will not cause the undercoat to lift or lose adhesion.
 5. If manufacturer's instructions recommend sanding to produce a smooth, even surface, sand between coats.
 6. Before applying next coat vacuum clean surfaces of loose particles. Use tack cloth to remove dust and particles just prior to applying next coat.

3.05 CLEANING AND PROTECTION

- A. Collect waste material which may constitute a fire hazard, place in closed metal containers, and remove daily from site.

- B. At the end of each workday, remove empty cans, rags, rubbish, and other discarded paint materials from site.
- C. Protect other work, whether being painted or not, against damage by painting. Correct damage by cleaning, repairing or replacing, and repainting as approved by Architect.
- D. Provide "Wet Paint" signs to protect newly painted finishes. Remove temporary protective wrappings provided by others to protect their work after completing painting operations.
- E. At completion of construction activities of other trades, touch up and restore damaged or defaced painted surfaces. Comply with procedures specified in MPI Manual.

END OF SECTION